

# Kiski Area School District

Our Focus is the Students - Our Mission is Excellence

Jim Perlik  
Director of Building and Grounds

November, 2018

Dear Staff and Parents:

As you may be aware, the Kiski Area School District has completed radon testing at all schools and at the Warehouse. **We are pleased to report that all the tests were below 4 pCi/L, the level at which the Pennsylvania Department of Environmental Protection (DEP) and the U.S. Environmental Protection Agency recommend that action be taken. Therefore, no further action is needed at this time.**


We did encounter 1 of 5 samples from the Upper Elementary gym that was above 4 pCi/L, however, this sample was found in a tampered condition and was not valid. A complete list of radon testing results has been posted on our website along with information about how to interpret the results.

Kiski Area School District followed the process described below to conduct radon measurements:

The purpose of initial testing is to identify rooms that have a potential for elevated radon levels (e.g., levels of 4 pCi/L or greater) during the school year. To achieve this purpose, EPA recommends that initial measurements be conducted:

- Under closed conditions (closed windows/doors except for normal exit/entry)
- After 12-hours of closed conditions when using a 2 to 5-day test (e.g., initiate testing after a weekend)
- During colder months (October through March, depending on geographical location)
- During weekdays with HVAC systems operating normally when conducting a 2 to 5-day test


Sincerely,



James Perlik  
Director of Building & Grounds

200 Poplar Street, Vandergrift, PA 15690-1491  
Phone (724) 568-3418 Fax (724) 568-1517

### Decision-Making Flow Chart

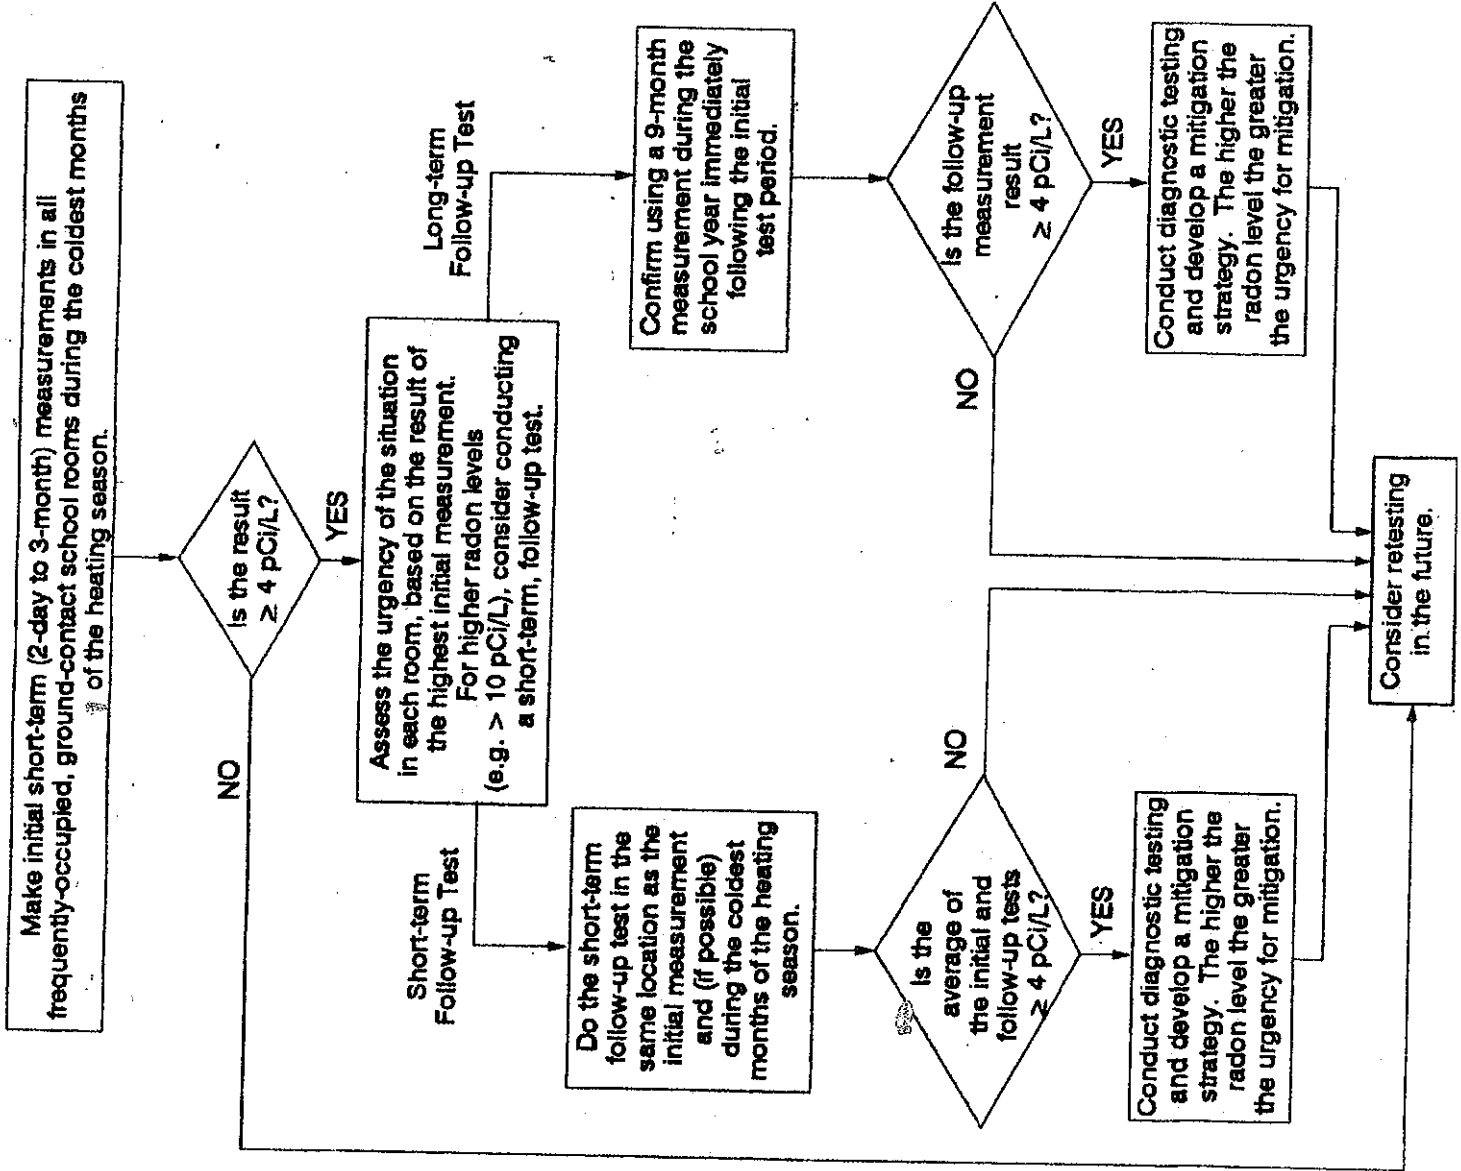

	Test Kit Serial #	Test Location	Results pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
1	AE651990	Support Professional Office	1.3	3:01 p.m.	3/5/18	AK	3:15 p.m.	3/7/18	AK	Y	
2	AE651984	Director of Building And Grounds	1.7	3:02 p.m.	3/5/18	AK	3:14 p.m.	3/7/18	AK	Y	
3	AE651983	Lunch Room	1.3	3:03 p.m.	3/5/18	AK	3:20 p.m.	3/7/18	AK	Y	
4	AE651969	Warehouse	1.2	2:57 p.m.	3/5/18	AK	3:17 p.m.	3/7/18	AK	Y	
5	AE651957	Warehouse B	1.0	2:58 p.m.	3/5/18	AK	3:20 p.m.	3/7/18	AK	Y	
6	AE651970	Warehouse	1.6	2:59 p.m.	3/5/18	AK	3:19 p.m.	3/7/18	AK	Y	
7	AE651975	Support Professional Office-Duplicate	1.3	3:03 p.m.	3/5/18	AK	3:16 p.m.	3/7/18	AK	Y	
8	AE652020	Blank	<0.7	3:04 p.m.	3/5/18	AK	3:13 p.m.	3/7/18	AK	Y	

## Kiski Area School District – North Primary Elementary – Radon Testing

## DEVICE PLACEMENT LOG

Test Kit Serial #	Test Location	Result pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
1	Secretary's Office	0.6	5:48 p.m.	3/12/18	CR	5:50 p.m.	3/14/18	MS	Y	
2	Principal's Office	<1.1	5:47 p.m.	3/12/18	CR	5:49 p.m.	3/14/18	CR	Y	
3	Conference Room	1.0	5:47 p.m.	3/12/18	CR	5:50 p.m.	3/14/18	CR	Y	
4	Nurse's Room	0.8	5:45 p.m.	3/12/18	MS	5:48 p.m.	3/14/18	MS	Y	
5	Room 153	0.8	5:44 p.m.	3/12/18	CR	5:47 p.m.	3/14/18	CR	Y	
6	Room 153 Duplicate	<0.9	5:44 p.m.	3/12/18	CR	5:47 p.m.	3/14/18	CR	Y	
7	Blank	<0.8	5:43 p.m.	3/12/18	JP	5:48 p.m.	3/14/18	JP	Y	
8	Room 146	<0.5	5:42 p.m.	3/12/18	CR	5:47 p.m.	3/14/18	MS	Y	
9	Room 144	0.9	5:42 p.m.	3/12/18	MS	5:46 p.m.	3/14/18	CR	Y	
10	Room 140	<0.7	5:31 p.m.	3/12/18	CR	5:41 p.m.	3/14/18	MS	Y	
11	Room 141	<0.7	5:37 p.m.	3/12/18	CR	5:42 p.m.	3/14/18	CR	Y	
12	Room 142	<0.4	5:39 p.m.	3/12/18	MS	5:43 p.m.	3/14/18	CR	Y	
13	Room 135	<0.5	5:40 p.m.	3/12/18	CR	5:43 p.m.	3/14/18	CR	Y	
14	Room 134	<0.8	5:38 p.m.	3/12/18	MS	5:43 p.m.	3/14/18	MS	Y	
15	Room 134 Duplicate	<0.7	5:38 p.m.	3/12/18	MS	5:43 p.m.	3/14/18	MS	Y	
16	Music	<0.5	5:49 p.m.	3/12/18	CR	5:49 p.m.	3/14/18	CR	Y	

## Kiski Area School District – North Primary Elementary – Radon Testing

## DEVICE PLACEMENT LOG

Test Kit Serial #	Test Location	Result pCi/L	Time	Deployment Date	Initials	Time	3/14/18	Initials	Y	Comments
17	Room 133	<0.5	5:36 p.m.	3/12/18	MS	5:42 p.m.	3/14/18	MS	Y	
18	Room 132	<0.4	5:35 p.m.	3/12/18	CR	5:40 p.m.	3/14/18	CR	Y	
19	Room 131	0.8	5:34 p.m.	3/12/18	MS	5:39 p.m.	3/14/18	CR	Y	
20	Room 130	0.7	5:33 p.m.	3/12/18	CR	5:39 p.m.	3/14/18	MS	Y	
21	Room 129	0.9	5:32 p.m.	3/12/18	MS	5:37 p.m.	3/14/18	CR	Y	
22	Room 130 Duplicate	0.7	5:33 p.m.	3/12/18	CR	5:39 p.m.	3/14/18	MS	Y	
23	Room 119	0.5	5:03 p.m.	3/12/18	CR	5:22 p.m.	3/14/18	MS	Y	
24	Room 120	<0.6	4:59 p.m.	3/12/18	CR	5:11 p.m.	3/14/18	CR	Y	
25	Room 120 Duplicate	<0.5	4:59 p.m.	3/12/18	CR	5:11 p.m.	3/14/18	CR	Y	
26	Blank	<0.3	5:00 p.m.	3/12/18	JP	5:13 p.m.	3/14/18	JP	Y	
27	Room 128 Music	<0.6	5:49 p.m.	3/12/18	CR	5:49 p.m.	3/14/18	MS	Y	
28	Gym	<0.3	5:00 p.m.	3/12/18	MS	5:12 p.m.	3/14/18	MS	Y	
29	Gym	<0.6	5:01 p.m.	3/12/18	MS	5:12 p.m.	3/14/18	MS	Y	
30	Gym	<0.7	5:02 p.m.	3/12/18	MS	5:13 p.m.	3/14/18	CR	Y	
31	Custodial Office	<0.7	5:04 p.m.	3/12/18	CR	5:16 p.m.	3/14/18	CR	Y	
32	Faculty Office	<0.7	5:05 p.m.	3/12/18	CR	5:16 p.m.	3/14/18	MS	Y	

	Test Kit Serial #	Test Location	Result pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
33	Ae652292	Cafeteria	1.1	5:06 p.m.	3/12/18	MS	5:17 p.m.	3/14/18	MS	Y	
34	AE652303	Cafeteria	1.4	5:15 p.m.	3/12/18	CR	5:17 p.m.	3/14/18	CR	Y	
35	AE652250	Kitchen	1.1	5:08 p.m.	3/12/18	CR	5:18 p.m.	3/14/18	CR	Y	
36	AE652258	Kitchen	0.7	5:09 p.m.	3/12/18	CR	5:18 p.m.	3/14/18	MS	Y	
37	AE652282	Library	<0.7	5:15 p.m.	3/12/18	MS	5:24 p.m.	3/14/18	MS	Y	
38	AE652273	Library	<1.0	5:16 p.m.	3/12/18	MS	5:25 p.m.	3/14/18	MS	Y	
39	AE652281	Library Office	<0.8	5:16 p.m.	3/12/18	CR	5:24 p.m.	3/14/18	CR	Y	
40	AE652313	Room 165	<0.6	5:18 p.m.	3/12/18	CR	5:27 p.m.	3/14/18	CR	Y	
41	AE652294	Room 164	1.1	5:18 p.m.	3/12/18	MS	5:28 p.m.	3/14/18	MS	Y	
42	AE652306	Room 163	<0.8	5:19 p.m.	3/12/18	CR	5:30 p.m.	3/14/18	CR	Y	
43	AE652305	Room 163 Duplicate	0.8	5:19 p.m.	3/12/18	CR	5:30 p.m.	3/14/18	CR	Y	
44	AE652319	Room 162	1.1	5:20 p.m.	3/12/18	MS	5:30 p.m.	3/14/18	MS	Y	
45	AE652285	Room 161	<0.7	5:21 p.m.	3/12/18	CR	5:31 p.m.	3/14/18	CR	Y	
46	AE652290	Room 160	<0.7	5:22 p.m.	3/12/18	MS	5:31 p.m.	3/14/18	MS	Y	
47	AE652284	Room 159	<0.6	5:27 p.m.	3/12/18	CR	5:32 p.m.	3/14/18	CR	Y	

	Test Kit Serial #	Test Location	Result pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
48	AE652274	Room 158	<0.5	5:28 p.m.	3/12/18	MS	5:32 p.m.	3/14/18	MS	Y	
49	AE652277	Room 157	<0.5	5:29 p.m.	3/12/18	CR	5:35 p.m.	3/14/18	CR	Y	
50	AE652293	Room 156	<0.8	5:29 p.m.	3/12/18	MS	5:33 p.m.	3/14/18	MS	Y	
51	AE652358	Blank	<0.6	5:30 p.m.	3/12/18	JP	5:34 p.m.	3/14/18	JP	Y	
52	AE652298	Library/Speech/Lang.	<0.5	5:20 p.m.	3/12/18	CR	5:25 p.m.	3/14/18	CR	Y	

	Kit Serial	Test Location	Result pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
1	AE652011	Custodial Office	2.1	4:05 p.m.	3/6/18	AK	4:06 p.m.	3/8/18	AK	Y	
2	AE651979	Room 116	<0.8	4:07 p.m.	3/6/18	MS	4:08 p.m.	3/8/18	MS	Y	
3	AE652030	Room 117	1.0	4:08 p.m.	3/6/18	MS	4:09 p.m.	3/8/18	MS	Y	
4	AE651973	Room 118	<1.1	4:09 p.m.	3/6/18	AK	4:10 p.m.	3/8/18	AK	Y	
5	AE691981	Nurse's Office	<0.6	4:11 p.m.	3/6/18	AK	4:12 p.m.	3/8/18	AK	Y	
6	AE652021	Kitchen	<0.8	3:32 p.m.	3/6/18	AK	3:35 p.m.	3/8/18	AK	Y	
7	AE652006	Cafeteria #1	<0.7	3:28 p.m.	3/6/18	AK	3:33 p.m.	3/8/18	AK	Y	
8	AE652027	Cafeteria #1- Duplicate	<0.8	3:30 p.m.	3/6/18	MS	3:32 p.m.	3/8/18	MS	Y	
9	AE651958	Duplicate	<0.6	3:31 p.m.	3/6/18	MS	3:32 p.m.	3/8/18	MS	Y	
10	AE652008	Blank	<0.7	3:32 p.m.	3/6/18	JP	3:34 p.m.	3/8/18	JP	Y	
11	AE652005	Stage	<0.9	3:29 p.m.	3/6/18	AK	3:36 p.m.	3/8/18	AK	Y	
12	AE651968	Gym		3:36 p.m.	3/6/18	MS		3/8/18	MS	Y	SAMPLE MISSING
13	AE652014	Gym	<0.6	3:34 p.m.	3/6/18	MS	3:37 p.m.	3/8/18	MS	Y	
14	AE651954	Gym	<0.7	3:35 p.m.	3/6/18	AK	3:38 p.m.	3/8/18	AK	Y	
15	AE651967	Room 145	<0.8	3:38 p.m.	3/6/18	AK	3:43 p.m.	3/8/18	AK	Y	
16	AE652013	Room 146	<0.9	3:39 p.m.	3/6/18	AK	3:44 p.m.	3/8/18	AK	Y	



	Kit Serial	Test Location	Result pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
17	AE652036	Room 147	<0.6	3:41 p.m.	3/6/18	MS	4:46 p.m.	3/8/18	MS	Y	
18	AE652012	Room 147-Duplicate	0.9	3:43 p.m.	3/6/18	AK	4:46 p.m.	3/8/18	AK	Y	
19	AE652028	Faculty Room	<0.7	3:43 p.m.	3/6/18	AK	3:50 p.m.	3/8/18	AK	Y	
20	AE652019	Room 107	1.2	3:47 p.m.	3/6/18	MS	3:51 p.m.	3/8/18	MS	Y	
21	AE652018	Room 108	2.1	3:50 p.m.	3/6/18	MS	3:52 p.m.	3/8/18	MS	Y	
22	AE652022	Room 109	2.0	3:53 p.m.	3/6/18	MS	3:54 p.m.	3/8/18	MS	Y	
23	AE652004	Room 106		3:54 p.m.	3/6/18	AK		3/8/18	AK	Y	MISSING SAMPLE
24	AE651955	Room 104	1.6	4:00 p.m.	3/6/18	AK	4:01 p.m.	3/8/18	AK	Y	
25	AE651980	Room 103	<0.8	4:01 p.m.	3/6/18	MS	4:02 p.m.	3/8/18	MS	Y	
26	AE651988	Room 105	1.6	3:57 p.m.	3/6/18	MS	3:58 p.m.	3/8/18	MS	Y	
27	AE651994	Room 105 Duplicate	1.2	3:55 p.m.	3/6/18	MS	3:57 p.m.	3/8/18	MS	Y	
28	AE651987	Room 111	1.7	3:51 p.m.	3/6/18	AK	3:53 p.m.	3/8/18	AK	Y	
29	AE652010	Room 112	1.5	3:48 p.m.	3/6/18	MS	3:52 p.m.	3/8/18	MS	Y	
30	AE652015	Library Office	1.1	3:45 p.m.	3/6/18	AK	3:51 p.m.	3/8/18	AK	Y	
31	AE651998	Library	<0.6	3:45 p.m.	3/6/18	MS	3:51 p.m.	3/8/18	MS	Y	
32	AE652016	Blank	<0.6	3:45 p.m.	3/6/18	JP	3:50 p.m.	3/8/18	JP	Y	

	Kit Serial	Test Location	Results pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
1	AE651962	Principals Office	1.0	4:21 p.m.	3/5/15	AK	4:31 p.m.	3/7/18	AK	Y	
2	AE652002	Conference Room	<0.8	4:20 p.m.	3/5/18	AK	4:31 p.m.	3/7/18	AK	Y	
3	AE651959	Guidance Office	1.8	4:19 p.m.	3/5/18	AK	4:29 p.m.	3/7/18	AK	Y	
4	AE651993	Office	1.2	4:22 p.m.	3/5/18	AK	4:32 p.m.	3/7/18	AK	Y	
5	AE651977	Nurse's Office	<1.0	4:16 p.m.	3/5/18	AK	4:26 p.m.	3/7/18	AK	Y	
6	AE651992	Room 113	1.1	4:12 p.m.	3/5/18	BK	4:23 p.m.	3/7/18	BK	Y	
7	AE651996	Faculty Room	<0.5	4:10 p.m.	3/5/18	AK	4:21 p.m.	3/7/18	AK	Y	
8	AE651985	Faculty Room- Duplicate	<0.9	4:11 p.m.	3/5/18	AK	4:21 p.m.	3/7/18	AK	Y	
9	AE651965	Computer Room	<0.8	4:15 p.m.	3/5/18	AK	4:24 p.m.	3/7/18	AK	Y	
10	AE651964	Media Center	1.8	4:18 p.m.	3/5/18	AK	4:26 p.m.	3/7/18	AK	Y	
11	AE651961	Room 114	<1.2	4:07 p.m.	3/5/18	BK	4:16 p.m.	3/7/18	BK	Y	
12	AE651995	Room 115 Music	<0.5	4:05 p.m.	3/5/18	AK	4:15 p.m.	3/7/18	AK	Y	
13	AE651972	Room 117	<0.7	4:04 p.m.	3/5/18	BK	4:13 p.m.	3/7/18	BK	Y	
14	AE651946	Room 106	0.9	3:59 p.m.	3/5/18	BK	4:11 p.m.	3/7/18	BK	Y	
15	AE651966	Room 18	1.1	3:53 p.m.	3/5/18	AK	4:06 p.m.	3/7/18	AK	Y	
16	AE652031	Room 18- Duplicate	1.7	3:55 p.m.	3/5/18	BK	4:06 p.m.	3/7/18	BK	Y	

Kit Serial	Test Location	Results pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
17	Room 17	2.2	3:58 p.m.	3/5/18	AK	4:05 p.m.	3/7/18	AK	Y	
18	Blank	<1.0	3:57 p.m.	3/5/18	JP	3:59 p.m.	3/7/18	JP	Y	
19	Reading Room	1.4	3:58 p.m.	3/5/18	AK	4:05 p.m.	3/7/18	AK	Y	
20	Janitor's Office	3.9	3:56 p.m.	3/5/18	BK	4:03 p.m.	3/7/18	BK	Y	
21	Gym Office	3.0	4:02 p.m.	3/5/18	BK	4:03 p.m.	3/7/18	BK	Y	
22	Gym	1.3	3:47 p.m.	3/5/18	BK	3:58 p.m.	3/7/18	BK	Y	
23	Gym	<0.9	3:48 p.m.	3/5/18	AK	3:59 p.m.	3/7/18	AK	Y	
24	Gym	1.3	3:49 p.m.	3/5/18	AK	3:58 p.m.	3/7/18	AK	Y	
25	Stage	3.6	3:40 p.m.	3/5/18	BK	3:45 p.m.	3/7/18	BK	Y	
26	Stage	2.1	3:41 p.m.	3/5/18	BK	3:46 p.m.	3/7/18	BK	Y	
27	Cafeteria #1	2.1	3:34 p.m.	3/5/18	BK	3:48 p.m.	3/7/18	BK	Y	
28	Cafeteria	2.1	3:39 p.m.	3/5/18	AK	3:55 p.m.	3/7/18	AK	Y	
29	Cafeteria	2.5	3:35 p.m.	3/5/18	AK	3:50 p.m.	3/7/18	AK	Y	
30	Cafeteria #1-Duplicate	2.4	3:36 p.m.	3/5/18	BK	3:47 p.m.	3/7/18	BK	Y	
31	Kitchen	1.6	3:42 p.m.	3/5/18	AK	3:49 p.m.	3/7/18	AK	Y	
Kit Serial	Test Location	Results pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments

32	AE652009	Kitchen	1.7	3:44 p.m.	3/5/18	AK	3:48 p.m.	3/7/18	AK	Y	
33	AE652017	Kitchen	1.7	3:43 p.m.	3/5/18	AK	3:49 p.m.	3/7/18	AK	Y	
34	AE651956	Blank	0.8	3:44 p.m.	3/5/18	JP	3:51 p.m.	3/7/18	JP	Y	
35	AE651948	SGI	<0.9	4:09 p.m.	3/5/18	BK	4:19 p.m.	3/7/18	BK	Y	

	Test Kit Serial #	Test Location	Result pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
1	AE651991	Room 119	1.0	4:36 p.m.	3/12/18	MS	4:38 p.m.	3/14/18	CR	Y	
2	AE652297	Room 120	1.2	4:36 p.m.	3/12/18	CR	4:36 p.m.	3/14/18	CR	Y	
3	AE652289	Room 120	1.3	4:35 p.m.	3/12/18	CR	4:36 p.m.	3/14/18	MS	Y	
4	AE652299	Room 121	1.5	4:33 p.m.	3/12/18	CR	4:34 p.m.	3/14/18	MS	Y	
5	AE652283	Room 122	1.5	4:38 p.m.	3/12/18	CR	4:39 p.m.	3/14/18	CR	Y	
6	AE651997	Stage	1.3	3:52 p.m.	3/12/18	MS	4:01 p.m.	3/14/18	CR	Y	
7	AE652037	Cafeteria	1.5	3:52 p.m.	3/12/18	CR	4:00 p.m.	3/14/18	MS	Y	
8	AE652029	Cafeteria	1.4	3:57 p.m.	3/12/18	CR	3:59 p.m.	3/14/18	CR	Y	Moved to a vertical position
9	AE652042	Kitchen	1.1	3:54 p.m.	3/12/18	MS	3:57 p.m.	3/14/18	MS	Y	
10	AE651989	Kitchen	0.5	3:53 p.m.	3/12/18	MS	3:57 p.m.	3/14/18	CR	Y	
11	AE652033	Gym	1.3	3:44 p.m.	3/12/18	MS	3:54 p.m.	3/14/18	MS	Y	
12	AE651953	Gym	6.6	3:45 p.m.	3/12/18	MS	3:55 p.m.	3/14/18	MS	Y	Found on the floor
13	AE652045	Gym	0.9	3:46 p.m.	3/12/18	MS	3:56 p.m.	3/14/18	MS	Y	
14	AE652024	Gym	0.9	3:46 p.m.	3/12/18	CR	3:54 p.m.	3/14/18	CR	Y	
15	AE652026	Gym	1.2	3:47 p.m.	3/12/18	CR	3:55 p.m.	3/14/18	CR	Y	

	Test Kit Serial #	Test Location	Result pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
16	AE652039	Custodial Office	1.4	3:49 p.m.	3/12/18	CR	4:03 p.m.	3/14/18	MS	Y	
17	AE652355	Blank Room 114	<0.5	3:50 p.m.	3/12/18	JP	4:04 p.m.	3/14/18	JP	Y	
18	AE652256	Duplicate Guidance	1.3	4:02 p.m.	3/12/18	CR	4:08 p.m.	3/14/18	CR	Y	
19	AE652025	003D Guidance	1.6	4:21 p.m.	3/12/18	MS	4:23 p.m.	3/14/18	CR	Y	
20	AE652044	003 Guidance	0.8	4:21 p.m.	3/12/18	MS	4:23 p.m.	3/14/18	CR	Y	
21	AE652263	Room 105	<0.7	4:09 p.m.	3/12/18	MS	4:16 p.m.	3/14/18	CR	Y	
23	AE652271	Room 105 Duplicate	<1.0	4:10 p.m.	3/12/18	MS	4:16 p.m.	3/14/18	CR	Y	
23	AE652267	Room 106	<0.8	4:09 p.m.	3/12/18	CR	4:16 p.m.	3/14/18	MS	Y	
24	AE652252	Room 108	0.7	4:08 p.m.	3/12/18	CR	4:13 p.m.	3/14/18	CR	Y	
25	AE652278	Room 109	1.1	4:08 p.m.	3/12/18	MS	4:13 p.m.	3/14/18	MS	Y	
26	AE652353	Blank	<1.0	4:07 p.m.	3/12/18	JP	4:12 p.m.	3/14/18	JP	Y	
27	AE652260	Room 110	<0.7	4:07 p.m.	3/12/18	CR	4:11 p.m.	3/14/18	CR	Y	
28	AE652043	Room 111	0.8	4:06 p.m.	3/12/18	MS	4:10 p.m.	3/14/18	MS	Y	
29	AE652259	Faculty Lounge	1.1	4:05 p.m.	3/12/18	CR	4:10 p.m.	3/14/18	CR	Y	
30	AE652270	Room 113	1.0	4:05 p.m.	3/12/18	MS	4:09 p.m.	3/14/18	MS	Y	

Test Kit Serial #	Test Location	Result pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
31	Room 114	0.9	4:03 p.m.	3/12/18	CR	4:08 p.m.	3/14/18	CR	Y	
32	Room 115	0.8	4:02 p.m.	3/12/18	MS	4:07 p.m.	3/14/18	CR	Y	
33	Room 116	1.2	4:02 p.m.	3/12/18	CR	4:06 p.m.	3/14/18	MS	Y	
34	Room 117	1.2	4:01 p.m.	3/12/18	MS	4:05 p.m.	3/14/18	MS	Y	
35	Room 116 Duplicate	0.9	4:01 p.m.	3/12/18	MS	4:06 p.m.	3/14/18	MS	Y	
36	Room 118	1.1	3:59 p.m.	3/12/18	CR	4:05 p.m.	3/14/18	CR	Y	
37	Room 118 Duplicate	1.4	4:00 p.m.	3/12/18	CR	4:05 p.m.	3/14/18	CR	Y	
38	Room 012	<0.4	4:31 p.m.	3/12/18	MS	4:33 p.m.	3/14/18	CR	Y	
39	Secretary Office	<0.8	4:28 p.m.	3/12/18	CR	4:29 p.m.	3/14/18	MS	Y	
40	Assistant Principal	<0.8	4:27 p.m.	3/12/18	CR	4:28 p.m.	3/14/18	MS	Y	
41	Principal's Office	<0.6	4:27 p.m.	3/12/18	CR	4:28 p.m.	3/14/18	CR	Y	
42	Conference	<0.5	4:25 p.m.	3/12/18	CR	4:28 p.m.	3/14/18	MS	Y	
43	Guidance 003A Media Center	1.5	4:20 p.m.	3/12/18	MS	4:25 p.m.	3/14/18	CR	Y	
44	Computer Classroom	2.5	4:12 p.m.	3/12/18	CR	4:20 p.m.	3/14/18	CR	Y	
45	Classroom	1.1	4:12 p.m.	3/12/18	CR	4:19 p.m.	3/14/18	CR	Y	
46	Room 101	0.4	4:12 p.m.	3/12/18	MS	4:19 p.m.	3/14/18	MS	Y	

	Test Kit Serial #	Test Location	Result pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
47	AE652265	Room 102	1.5	4:15 p.m.	3/12/18	MS	4:22 p.m.	3/14/18	CR	Y	
48	AE652268	Room 002C	1.4	4:17 p.m.	3/12/18	CR	4:23 p.m.	3/14/18	CR	Y	
49	AE652035	Room 002A	1.1	4:17 p.m.	3/12/18	CR	4:22 p.m.	3/14/18	MS	Y	Found on the floor
50	AE652266	Room 100	2.0	4:23 p.m.	3/12/18	CR	4:26 p.m.	3/14/18	CR	Y	
51	AE652269	Nurse's Office Duplicate	1.2	4:30 p.m.	3/12/18	MS	4:31 p.m.	3/14/18	CR	Y	
52	AE652261	Nurse's Office	1.7	4:30 p.m.	3/12/18	MS	4:31 p.m.	3/14/18	CR	Y	
53	AE652339	Blank	<0.5	4:10 p.m.	3/12/18	JP	4:17 p.m.	3/14/18	JP	Y	
54	AE652279	Room 103	1.2	4:11 p.m.	3/12/18	MS	4:18 p.m.	3/14/18	CR	Y	
55	AE652280	Room 104	1.1	4:12 p.m.	3/12/18	CR	4:18 p.m.	3/14/18	MS	Y	
56	AE652257	Media Center Office	1.7	4:11 p.m.	3/12/18	MS	4:21 p.m.	3/14/18	CR	Y	



## Kiski Area School District -- Intermediate School Radon Testing

## DEVICE PLACEMENT LOG

	Test Kit Serial #	Test Location	Result pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
1	AE651921	Room 100	<0.9	3:35 p.m.	3/19/18	CR	3:59 p.m.	3/21/18	BK	Y	
2	AE651858	Room 101	0.9	3:36 p.m.	3/19/18	BK	3:59 p.m.	3/21/18	CR	Y	
3	AE651899	Room 102	1.2	3:38 p.m.	3/19/18	CR	4:03 p.m.	3/21/18	CR	Y	
4	AE651844	Room 103	<0.5	3:39 p.m.	3/19/18	BK	4:05 p.m.	3/21/18	JP	Y	
5	AE652344	Room 104	<0.7	3:40 p.m.	3/19/18	CR	4:06 p.m.	3/21/18	BK	Y	
6	AE651875	Room 105	<0.5	3:41 p.m.	3/19/18	BK	4:08 p.m.	3/21/18	CR	Y	
7	AE651857	Room 106	<0.8	3:22 p.m.	3/19/18	BK	3:41 p.m.	3/21/18	CR	Y	
8	AE651897	Room 107	<1.0	3:22 p.m.	3/19/18	CR	3:42 p.m.	3/21/18	BK	Y	
9	AE651865	Room 108	<0.9	3:24 p.m.	3/19/18	BK	3:43 p.m.	3/21/18	CR	Y	
10	AE651848	Room 108-Duplicate	<0.4	3:24 p.m.	3/19/18	BK	3:43 p.m.	3/21/18	CR	Y	
11	AE651929	Room 109	0.9	3:24 p.m.	3/19/18	CR	3:44 p.m.	3/21/18	BK	Y	
12	AE651850	Room 110	<0.9	3:25 P.M.	3/19/18	BK	3:45 p.m.	3/21/18	CR	Y	
13	AE651864	Room 111	1.0	3:26 p.m.	3/19/18	BK	3:47 p.m.	3/21/18	CR	Y	

Test Kit Serial #	Test Location	Result pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
14 AE651922	Room 112	0.7	3:24 p.m.	3/19/18	CR	3:45 p.m.	3/21/18	BK	Y	
15 AE651873	Room 114	0.9	3:36 p.m.	3/19/18	CR	4:02 p.m.	3/21/18	CR	Y	
16 AE652346	Nurse	1.0	3:36 p.m.	3/19/18	BK	3:57 p.m.	3/21/18	CR	Y	
17 AE651907	Principal	1.7	3:27 p.m.	3/19/18	CR	3:52 p.m.	3/21/18	JP	Y	
18 AE651856	Assistant Principal	1.1	3:30 p.m.	3/19/18	CR	3:49 p.m.	3/21/18	CR	Y	
19 AE651882	Asst. Principal Duplicate	0.7	3:30 p.m.	3/19/18	CR	3:49 p.m.	3/21/18	CR	Y	
20 AE651860	Guidance A-L	<1.3	3:29 p.m.	3/19/18	BK	3:51 p.m.	3/21/18	JP	Y	
21 AE651851	Guidance M-Z	0.7	3:28 p.m.	3/19/18	BK	3:49 p.m.	3/21/18	CR	Y	
22 AE651854	Office	<1.0	3:27 p.m.	3/19/18	BK	3:48 p.m.	3/21/18	BK	Y	
23 AE651881	Lunch Room	<0.7	3:31 p.m.	3/19/18	CR	3:48 p.m.	3/21/18	BK	Y	
24 AE651890	CCTV Room	1.7	3:28 p.m.	3/19/18	CR	3:55 p.m.	3/21/18	CR	Y	
25 AE651867	Student Council	<0.4	3:22 p.m.	3/19/18	MS	3:45 p.m.	3/21/18	AK	Y	
26 AE651849	Faculty Room	0.8	3:21 p.m.	3/19/18	AK	3:44 p.m.	3/21/18	MS	Y	
27 AE651845	Faculty Room Duplicate	1.1	3:42 p.m.	3/19/18	AK	3:44 p.m.	3/21/18	AK	Y	

## Kiski Area School District – Intermediate School Radon Testing

## DEVICE PLACEMENT LOG

Test Kit Serial #	Test Location	Result pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
28	Kitchen	1.0	3:30 p.m.	3/19/18	MS	3:52 p.m.	3/21/18	MS	Y	
29	Kitchen	<0.6	3:31 p.m.	3/19/18	AK	3:52 p.m.	3/21/18	AK	Y	
30	Cafe	0.8	3:24 p.m.	3/19/18	AK	3:47 p.m.	3/21/18	AK	Y	
31	Cafe	<0.9	3:24 p.m.	3/19/18	MS	3:47 p.m.	3/21/18	MS	Y	
32	Media Center	1.0	3:28 p.m.	3/19/18	AK	3:50 p.m.	3/21/18	AK	Y	
33	Media Center	1.1	3:29 p.m.	3/19/18	MS	3:50 p.m.	3/21/18	AK	Y	
34	Stage	1.5	3:26 p.m.	3/19/18	AK	3:49 p.m.	3/21/18	MS	Y	
35	Weight Room	<0.8	3:21 p.m.	3/19/18	CR	3:39 p.m.	3/21/18	BK	Y	
36	Weight Room Duplicate	0.5	3:21 p.m.	3/19/18	BK	3:39 p.m.	3/21/18	BK	Y	
37	FACS	<0.8	3:19 p.m.	3/19/18	CR	3:38 p.m.	3/21/18	CR	Y	
38	Art Room	0.8	3:19 p.m.	3/19/18	AK	3:42 p.m.	3/21/18	AK	Y	
39	Gym	0.8	3:16 p.m.	3/19/18	AK	3:40 p.m.	3/21/18	AK	Y	
40	Gym	<0.6	3:16 p.m.	3/19/18	AK	3:38 p.m.	3/21/18	AK	Y	
41	Gym	1.4	3:17 p.m.	3/19/18	AK	3:39 p.m.	3/21/18	MS	Y	

## Kiski Area School District – Intermediate School Radon Testing

## DEVICE PLACEMENT LOG

	Test Kit Serial #	Test Location	Result pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
42	AE651916	Gym	0.8	3:17 p.m.	3/19/18	AK	3:40 p.m.	3/21/18	MS	Y	
43	AE651846	Band	<0.8	3:37 p.m.	3/19/18	MS	3:55 p.m.	3/21/18	MS	Y	
44	AE651915	Chorus	<0.9	3:36 p.m.	3/19/18	MS	3:54 p.m.	3/21/18	AK	Y	
45	AE651855	Chorus Duplicate	<0.9	3:36 p.m.	3/19/18	AK	3:54 p.m.	3/21/18	AK	Y	
46	AE651889	Tech Ed Shop	0.5	3:39 p.m.	3/19/18	AK	3:57 p.m.	3/21/18	AK	Y	
47	AE651870	Tech Ed Classroom	<0.6	3:39 p.m.	3/19/18	AK	3:56 p.m.	3/21/18	MS	Y	
48	AE652326	Custodian's Office	<0.9	3:41 p.m.	3/19/18	AK	3:57 p.m.	3/21/18	AK	Y	
49	AE652098	Blank	<0.6	3:30 p.m.	3/19/18	JP	3:57 p.m.	3/21/18	JP	Y	
50	AE652090	Blank	<0.6	3:20 p.m.	3/19/18	JP	3:38 p.m.	3/21/18.	JP	Y	
51	AE652351	Blank	<0.5	3:38 p.m.	3/19/18	JP	3:56 p.m.	3/21/18	JP	Y	

	Test Kit Serial #	Test Location	Results pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
1	AE652069	Athletic Custodian Office	<1.0	5:23 p.m.	3/19/18	CR	5:30 p.m.	3/21/18	BK	Y	
2	AE652138	Team Room	<0.7	5:17 p.m.	3/19/18	CR	5:37 p.m.	3/21/18	BK	Y	
3	AE652118	Weight Room 607	1.3	5:14 p.m.	3/19/18	CR	5:36 p.m.	3/21/18	BK	Y	
4	AE652076	Weight Room 607	<1.0	5:15 p.m.	3/19/18	BK	5:35 p.m.	3/21/18	BK	Y	Damaged Sampler
5	AE652050	Weight Room 605	<0.7	5:12 p.m.	3/19/18	CR	5:33 p.m.	3/21/18	CR	Y	
6	AE652085	Trainer's Room 609	0.8	5:18 p.m.	3/19/18	CR	5:37 p.m.	3/21/18	BK	Y	
7	AE652061	Trainer's Room 609a	<0.7	5:19 p.m.	3/19/18	BK	5:37 p.m.	3/21/18	CR	Y	
8	AE652084	Trainer's Room 609a Duplicate	0.9	5:19 p.m.	3/19/18	CR	5:37 p.m.	3/21/18	CR	Y	
9	AE652141	Weight Room 606	<0.4	5:16 p.m.	3/19/18	CR	5:33 p.m.	3/21/18	JP	Y	
10	AE652082	Concessions	<0.9	5:10 p.m.	3/19/18	BK	5:32 p.m.	3/21/18	BK	Y	
11	AE652112	Gym B	<0.8	5:11 p.m.	3/19/18	AK	5:23 p.m.	3/21/18	AK	Y	
12	AE652145	Gym B	Error	5:11 p.m.	3/19/18	AK	10:00 a.m.	3/22/18	MS	Y	Missing found 3/22/18 upside down
13	AE652060	Gym B	<0.5	5:12 p.m.	3/19/18	AK	5:24 p.m.	3/21/18	AK	Y	

	Test Kit Serial #	Test Location	Results pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
14	AE652140	Gym B	<0.8	5:12 p.m.	3/19/18	AK	5:24 p.m.	3/21/18	AK	Y	
15	AE652334	Gym A	<0.5	5:14 p.m.	3/19/18	AK	5:31 p.m.	3/21/18	AK	Y	
16	AE651847	Gym A #1		5:14 p.m.	3/19/18	AK	MISSING	3/21/18			
17	AE652130	Gym A #1- Duplicate	<0.8	5:16 p.m.	3/19/18	MS	5:30 p.m.	3/21/18	AK	Y	
18	AE652146	Gym A	<1.0	5:18 p.m.	3/19/18	AK	5:30 p.m.	3/21/18	AK	Y	
19	AE652127	Gym A	<1.0	5:19 p.m.	3/19/18	AK	5:31 p.m.	3/21/18	AK	Y	
20	AE652142	Gym A		5:19 p.m.	3/19/18	AK	MISSING				
21	AE652107	Gym A	<0.4	5:20 p.m.	3/19/18	MS	5:32 p.m.	3/21/18	MS	Y	
22	AE652131	Gym A	<0.7	5:20 p.m.	3/19/18	MS	5:32 p.m.	3/21/18	MS	Y	
23	AE652143	Gym A	<1.1	5:20 p.m.	3/19/18	MS	5:32 p.m.	3/21/18	MS	Y	
24	AE652049	Gym A	<0.6	5:20 p.m.	3/19/18	MS	5:32 p.m.	3/21/18	MS	Y	
25	AE652128	Faculty Lounge	<0.6	5:02 p.m.	3/19/18	BK	5:26 p.m.	3/21/18	JP	Y	Bottom of sampler was wet
26	AE652126	Lower Cafeteria	0.8	4:49 p.m.	3/19/18	CR	5:24 p.m.	3/21/18	BK	Y	
27	AE652144	Lower Cafeteria #1	<0.8	4:49 p.m.	3/19/18	CR	5:22 p.m.	3/21/18	BK	Y	Found upside down

	Test Kit Serial #	Test Location	Results pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
28	AE652052	Lower Cafeteria #1- Duplicate	<1.1	4:49 p.m.	3/19/18	BK	5:22 p.m.	3/21/18	BK	Y	Found covered by other sampler
29	AE652119	Lower Cafeteria	<0.5	5:03 p.m.	3/19/18	CR	5:25 p.m.	3/21/18	JP	Y	
30	AE652134	Serving Area	0.7	5:03 p.m.	3/19/18	BK	5:26 p.m.	3/21/18	BK	Y	
31	AE652136	Food Manager Office	<1.3	5:05 p.m.	3/19/18	CR	5:26 p.m.	3/21/18	BK	Y	
32	AE652139	Kitchen	<0.7	5:05 p.m.	3/19/18	BK	5:27 p.m.	3/21/18	BK	Y	
33	AE652135	Kitchen	<1.1	5:05 p.m.	3/19/18	BK	5:27 p.m.	3/21/18	CR	Y	
34	AE652114	IT Office-DeLuca	1.2	4:50 p.m.	3/19/18	CR	5:10 p.m.	3/21/18	CR	Y	
35	AE652106	it Office-Smith	1.7	4:50 p.m.	3/19/18	BK	5:10 p.m.	3/21/18	BK	Y	
36	AE652137	IT Office-Storage	0.7	4:51 p.m.	3/19/18	CR	5:11 p.m.	3/21/18	JP	Y	
37	AE652129	IT Office-Trish	1.1	4:51 p.m.	3/19/18	BK	5:12 p.m.	3/21/18	CR	Y	
38	AE652065	IT Office-Trish-Duplicate	1.5	4:51 p.m.	3/19/18	BK	5:12 p.m.	3/21/18	CR	Y	
39	AE652123	Custodial Office	1.1	4:53 p.m.	3/19/18	BK	5:17 p.m.	3/21/18	CR	Y	
40	AE652070	Maintenance Office	<0.6	4:53 p.m.	3/19/18	CR	5:17 p.m.	3/21/18	CR	Y	
41	AE652110	Room 107 Chorus	<0.6	4:48 p.m.	3/19/18	BK	5:19 p.m.	3/21/18	BK	Y	Turned over and covered

	Test Kit Serial #	Test Location	Results pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
42	AE651912	Room 107A-Chorus	<1.0	4:52 p.m.	3/19/18	MS	5:17 p.m.	3/21/18	AK	Y	
43	AE652122	Room 108-Band	<0.8	4:55 p.m.	3/19/18	BK	5:15 p.m.	3/21/18	JP	Y	Moved to shelf over 7' high
44	AE651872	108A-Band	<0.4	4:50 p.m.	3/19/18	AK	5:15 p.m.	3/21/18	AK	Y	Found upside down
45	AE652111	Room 108-Band Office	<0.8	4:54 p.m.	3/19/18	CR	5:15 p.m.	3/21/18	JP	Y	
46	AE651925	Room 108A-Band Office	<0.7	4:50 a.m.	3/19/18	AK	5:15 p.m.	3/21/18	AK	Y	
47	AE652097	Nurse's Office A	1.1	4:45 p.m.	3/19/18	CR	5:08 p.m.	3/21/18	CR	Y	
48	AE651920	Nurse's Office B	<0.8	4:31 p.m.	3/19/18	AK	4:53 p.m.	3/21/18	AK	Y	
49	AE651868	Room 507a	<0.8	4:34 p.m.	3/19/18	AK	4:55 p.m.	3/21/18	AK	Y	
50	AE651869	Room 507	<0.7	4:33 p.m.	3/19/18	AK	4:55 p.m.	3/21/18	AK	Y	
51	AE652338	Room 508-Chorus		4:48 p.m.	3/19/18	AK	MISSING	3/21/18			
52	AE651885	Room 508-Duplicate		4:48 p.m.	3/19/18	AK	MISSING	3/21/18			
53	AE652003	Room 509	<0.5	4:46 p.m.	3/19/18	AK	5:05 p.m.	3/21/18	MS	Y	Found on floor upside down
54	AE651923	Stage	0.9	4:45 p.m.	3/19/18	AK	5:04 p.m.	3/21/18	AK	Y	



	Test Kit Serial #	Test Location	Results pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
55	AE651919	Auditorium	0.8	4:59 p.m.	3/19/18	AK	5:11 p.m.	3/21/18	AK	Y	
56	AE651917	Auditorium	<0.8	5:00 p.m.	3/19/18	AK	5:12 p.m.	3/21/18	AK	Y	
57	AE651909	Auditorium	<1.0	5:00 p.m.	3/19/18	MS	5:12 p.m.	3/21/18	MS	Y	
58	AE651911	Room 500	<0.9	4:35 p.m.	3/19/18	AK	4:56 p.m.	3/21/18	MS	Y	
59	AE651906	Room 501-Art	0.7	4:36 p.m.	3/19/18	AK	4:58 p.m.	3/21/18	AK	Y	
60	AE651892	Room 501-Art-Duplicate	<0.6	4:36 p.m.	3/19/18	AK	4:58 p.m.	3/21/18	AK	Y	
61	AE651918	Room 502-CADD	<1.0	4:37 p.m.	3/19/18	MS	4:58 p.m.	3/21/18	MS	Y	
62	AE651903	Room 503-Transportation	<0.5	4:38 p.m.	3/19/18	AK	4:59 p.m.	3/21/18	MS	Y	
63	AE651893	Room 504-Transportation Lab	<0.5	4:39 p.m.	3/19/18	AK	4:59 p.m.	3/21/18	MS	Y	
64	AE652331	Room 505-CNL Lab	<0.6	4:41 p.m.	3/19/18	MS	5:00 p.m.	3/21/18	AK	Y	
65	AE651877	Room 506-Mfg. Lab	<0.7	4:42 p.m.	3/19/18	AK	5:00 p.m.	3/21/18	AK	Y	
66	AE652092	Room 106-Comm Art	1.7	4:28 p.m.	3/19/18	CR	4:53 p.m.	3/21/18	CR	Y	
67	AE652109	Room 105-TV Studio	1.6	4:27 p.m.	3/19/18	BK	4:53 p.m.	3/21/18	BK	Y	
68	AE652124	Room 104-LGI		4:24 p.m.	3/19/18	BK	MISSING	3/21/18			

	Test Kit Serial #	Test Location	Results pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
69	AE652081	Room 104A-LGI		4:23 p.m.	3/19/18	CR	MISSING	3/21/18			
70	AE652121	Room 104-LGI-Duplicate		4:21 p.m.	3/19/18	CR	MISSING	3/21/18			
71	AE652113	Room 104-LGI Office	0.9	4:21 p.m.	3/19/18	BK	4:48 p.m.	3/21/18	BK	Y	
72	AE652096	Room 104B-LGI Conference	<1.2	4:21 p.m.	3/19/18	CR	4:46 p.m.	3/21/18	BK	Y	
73	AE652117	Room 103	<0.6	4:16 p.m.	3/19/18	CR	4:42 p.m.	3/21/18	CR	Y	
74	AE652104	Room 102	<1.1	4:15 p.m.	3/19/18	BK	4:39 p.m.	3/21/18	CR	Y	
75	AE652095	Room 101	<0.7	4:14 p.m.	3/19/18	CR	4:39 p.m.	3/21/18	BK	Y	
76	AE652096	Room 100	1.1	4:18 p.m.	3/19/18	BK	4:47 p.m.	3/21/18	CR	Y	
77	AE652116	Library	0.7	4:19 p.m.	3/19/18	BK	4:43 p.m.	3/21/18	BK	Y	
78	AE652120	Library	0.8	4:20 p.m.	3/19/18	CR	4:43 p.m.	3/21/18	CR	Y	
79	AE652062	Library	0.7	4:20 p.m.	3/19/18	BK	4:44 p.m.	3/21/18	BK	Y	
80	AE652105	Library	<0.9	4:18 p.m.	3/19/18	CR	4:45 p.m.	3/21/18	JP	Y	
81	AE652078	Attendance	<0.7	4:31 p.m.	3/19/18	BK	4:55 p.m.	3/21/18	BK	Y	
82	AE652086	Administration Suite-Duplicate	<0.7	4:31 p.m.	3/19/18	CR	4:57 p.m.	3/21/18	BK	Y	

	Test Kit Serial #	Test Location	Results pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
83	AE652132	Administration Suite	<0.9	4:32 p.m.	3/19/18	CR	4:57 p.m.	3/21/18	BK	Y	
84	AE652091	Administration Conf Room	0.9	4:32 p.m.	3/19/18	CR	4:56 p.m.	3/21/18	CR	Y	
85	AE652115	Resource Office	<0.4	4:32 p.m.	3/19/18	BK	5:00 p.m.	3/21/18	BK	Y	
86	AE652108	Assistant Principal #1	0.8	4:33 p.m.	3/19/18	CR	5:00 p.m.	3/21/18	CR	Y	
87	AE652099	Assistant Principal #2	<0.8	4:33 p.m.	3/19/18	BK	5:00 p.m.	3/21/18	CR	Y	
88	AE652100	Principal	0.5	4:34 p.m.	3/19/18	CR	5:00 p.m.	3/21/18	BK	Y	
89	AE652047	Staff	<1.0	4:35 p.m.	3/19/18	BK	5:02 p.m.	3/21/18	BK	Y	
90	AE652125	Guidance Counselor #1	<0.8	4:37 p.m.	3/19/18	BK	5:02 p.m.	3/21/18	BK	Y	
91	AE652102	Guidance Counselor #2	<0.7	4:38 p.m.	3/19/18	BK	5:03 p.m.	3/21/18	CR	Y	
92	AE652089	Guidance Counselor #3	<0.6	4:39 p.m.	3/19/18	CR	5:04 p.m.	3/21/18	JP	Y	
93	AE652058	Guidance Counselor #4	<0.8	4:40 p.m.	3/19/18	CR	5:04 p.m.	3/21/18	CR	Y	
94	AE652093	Office-Duplicate	1.0	4:41 p.m.	3/19/18	BK	5:05 p.m.	3/21/18	JP	Y	
95	AE652053	Office	<0.8	4:42 p.m.	3/19/18	CR	5:05 p.m.	3/21/18	JP	Y	
96	AE652133	Conference Room	<0.9	4:43 p.m.	3/19/18	BK	5:06 p.m.	3/21/18	JP	Y	

	Test Kit Serial #	Test Location	Results pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
97	AE652063	Guidance Office	<0.9	4:39 p.m.	3/19/18	BK	5:03 p.m.	3/21/18	JP	Y	
98	AE651880	Main Entrance Office	0.6	4:29 p.m.	3/19/18	AK	4:51 p.m.	3/21/18	AK	Y	
99	AE651924	Room 201	0.8	4:11 p.m.	3/19/18	AK	4:36 p.m.	3/21/18	MS	Y	
100	AE651871	Room 202	<1.0	4:12 p.m.	3/19/18	MS	4:35 p.m.	3/21/18	AK	Y	
101	AE651931	Room 203	<0.6	4:12 p.m.	3/19/18	AK	4:37 p.m.	3/21/18	AK	Y	
102	AE651884	Room 204A	1.3	4:13 p.m.	3/19/18	MS	4:37 p.m.	3/21/18	MS	Y	
103	AE651904	Room 204A-Duplicate	0.7	4:13 p.m.	3/19/18	MS	4:37 p.m.	3/21/18	MS	Y	
104	AE651928	Room 205	<0.8	4:14 p.m.	3/19/18	AK	4:38 p.m.	3/21/18	AK	Y	
105	AE651876	Room 206	<1.0	4:14 p.m.	3/19/18	MS	4:39 p.m.	3/21/18	AK	Y	
106	AE651936	Room 207	1.3	4:15 p.m.	3/19/18	AK	4:40 p.m.	3/21/18	MS	Y	
107	AE652347	Room 208	<0.5	4:16 p.m.	3/19/18	MS	4:41 p.m.	3/21/18	AK	Y	
108	AE651900	Room 209	<1.3	4:17 p.m.	3/19/18	AK	4:42 p.m.	3/21/18	MS	Y	
109	AE651910	Room 210	<0.7	4:22 p.m.	3/19/18	AK	4:47 p.m.	3/21/18	MS	Y	
110	AE651941	Room 211	<1.0	4:22 p.m.	3/19/18	AK	4:46 p.m.	3/21/18	MS	Y	

	Test Kit Serial #	Test Location	Results pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
111	AE651861	Room 212A	<0.7	4:20 p.m.	3/19/18	MS	4:46 p.m.	3/21/18	AK	Y	
112	AE651942	Room 212A-Duplicate	<1.0	4:20 p.m.	3/19/18	MS	4:46 p.m.	3/21/18	AK	Y	
113	AE652007	Room 213	<0.5	4:18 p.m.	3/19/18	MS	4:43 p.m.	3/21/18	AK	Y	
114	AE651888	Room 214	<0.6	4:18 p.m.	3/19/18	AK	4:43 p.m.	3/21/18	MS	Y	
115	AE651896	Room 215	<0.6	4:19 p.m.	3/19/18	AK	4:44 p.m.	3/21/18	AK	Y	
116	AE652087	Room 301	<1.0	4:13 p.m.	3/19/18	BK	4:37 p.m.	3/21/18	BK	Y	
117	AE652103	Room 302	<0.7	4:13 p.m.	3/19/18	BK	4:37 p.m.	3/21/18	CR	Y	
118	AE652071	Room 303	<0.6	4:08 p.m.	3/19/18	BK	4:28 p.m.	3/21/18	CR	Y	
119	AE652073	Room 304	<0.9	4:09 p.m.	3/19/18	CR	4:27 p.m.	3/21/18	CR	Y	
120	AE652088	Room 305A	<0.7	4:09 p.m.	3/19/18	BK	4:27 p.m.	3/21/18	BK	Y	
121	AE652072	Room 305A-Duplicate	1.0	4:09 p.m.	3/19/18	BK	4:27 p.m.	3/21/18	BK	Y	
122	AE652080	Room 306	<0.8	4:07 p.m.	3/19/18	CR	4:28 p.m.	3/21/18	JP	Y	
123	AE652094	Room 310	<0.9	4:06 p.m.	3/19/18	CR	4:31 p.m.	3/21/18	CR	Y	
124	AE652051	Room 307	0.5	4:04 p.m.	3/19/18	CR	4:34 p.m.	3/21/18	BK	Y	

	Test Kit Serial #	Test Location	Results pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
125	AE652079	Room 308	<0.9	4:05 p.m.	3/19/18	BK	4:35 p.m.	3/21/18	JP	Y	
126	AE652064	Room 309	<0.8	4:03 p.m.	3/19/18	BK	4:31 p.m.	3/21/18	BK	Y	
127	AE652057	Room 311	<0.7	4:03 p.m.	3/19/18	CR	4:33 p.m.	3/21/18	BK	Y	
128	AE652068	Room 312A	<0.5	4:01 p.m.	3/19/18	CR	4:32 p.m.	3/21/18	CR	Y	
129	AE652055	Room 312A-Duplicate	<0.8	4:01 p.m.	3/19/18	BK	4:32 p.m.	3/21/18	CR	Y	
130	AE651905	Room 401	0.8	4:03 p.m.	3/19/18	AK	4:29 p.m.	3/21/18	AK	Y	
131	AE651879	Room 402	<0.8	4:04 p.m.	3/19/18	MS	4:30 p.m.	3/21/18	AK	Y	
132	AE651930	Room 403	<1.0	4:05 p.m.	3/19/18	AK	4:30 p.m.	3/21/18	MS	Y	
133	AE652333	Room 404	<0.8	4:05 p.m.	3/19/18	MS	4:31 p.m.	3/21/18	AK	Y	
134	AE651932	Room 405	<0.4	4:06 p.m.	3/19/18	AK	4:32 p.m.	3/21/18	AK	Y	
135	AE651943	Room 406	<0.7	4:06 p.m.	3/19/18	MS	4:32 p.m.	3/21/18	MS	Y	
136	AE651933	Room 407	<1.0	3:52 p.m.	3/19/18	MS	4:19 p.m.	3/21/18	AK	Y	
137	AE651887	Room 408A	0.7	4:02 p.m.	3/19/18	AK	4:28 p.m.	3/21/18	MS	Y	
138	AE651937	Room 408A-Duplicate	<0.7	4:02 p.m.	3/19/18	AK	4:28 p.m.	3/21/18	MS	Y	

	Test Kit Serial #	Test Location	Results pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
139	AE651914	Room 409	<0.6	4:01 p.m.	3/19/18	AK	4:28 p.m.	3/21/18	AK	Y	
140	AE651895	Room 410	0.8	4:00 p.m.	3/19/18	MS	4:27 p.m.	3/21/18	MS	Y	
141	AE651927	Room 411	<1.0	4:00 p.m.	3/19/18	AK	4:25 p.m.	3/21/18	MS	Y	
142	AE651926	Room 412	0.6	3:59 p.m.	3/19/18	AK	4:26 p.m.	3/21/18	AK	Y	
143	AE652354	Room 413	<0.5	3:58 p.m.	3/19/18	MS	4:24 p.m.	3/21/18	MS	Y	
144	AE651939	Room 414	<1.3	3:57 p.m.	3/19/18	MS	4:23 p.m.	3/21/18	AK	Y	
145	AE651944	Room 415	1.0	3:56 p.m.	3/19/18	MS	4:23 p.m.	3/21/18	MS	Y	
146	AE651902	Room 416A	<1.0	3:55 p.m.	3/19/18	AK	4:22 p.m.	3/21/18	AK	Y	
147	AE651935	Room 416A-Duplicate	0.9	3:55 p.m.	3/19/18	AK	4:22 p.m.	3/21/18	AK	Y	
148	AE651940	Room 417	1.2	3:53 p.m.	3/19/18	AK	4:20 p.m.	3/21/18	AK	Y	
149	AE651934	Room 418	0.6	3:53 p.m.	3/19/18	MS	4:20 p.m.	3/21/18	MS	Y	
150	AE651938	Room 419-Student Store	<0.6	4:08 p.m.	3/19/18	AK	4:18 p.m.	3/21/18	AK	Y	
151	AE651913	Faculty	0.8	3:54 p.m.	3/19/18	MK	4:26 p.m.	3/21/18	AK	Y	
152	AE652067	Upper Cafeteria	<0.9	3:54 p.m.	3/19/18	CR	4:22 p.m.	3/21/18	JP	Y	

	Test Kit Serial #	Test Location	Results pCi/L	Time	Deployment Date	Initials	Time	Retrieval Date	Initials	Closed Y/N	Comments
153	AE652074	Upper Cafeteria	1.4	3:54 p.m.	3/19/18	BK	4:21 p.m.	3/21/18	JP	Y	
154	AE652075	Upper Cafeteria	<0.7	3:54 p.m.	3/19/18	CR	4:23 p.m.	3/21/18	JP	Y	
155	AE652083	Upper Cafeteria	<1.0	3:53 p.m.	3/19/18	BK	4:20 p.m.	3/21/18	JP	Y	
156	AE652054	Faculty Dining	1.2	3:52 p.m.	3/19/18	CR	4:17 p.m.	3/21/18	JP	Y	
157	AE652048	Faculty Dining-Duplicate	1.3	3:52 p.m.	3/19/18	BK	4:17 p.m.	3/21/18	JP	Y	
158	AE652059	Upper Kitchen	1.0	3:53 p.m.	3/19/18	BK	4:19 p.m.	3/21/18	CR	Y	
159	AE652066	Upper Kitchen	<0.8	3:53 p.m.	3/19/18	CR	4:19 p.m.	3/21/18	CR	Y	
160	AE652348	Blank	<0.4	5:17 p.m.	3/19/18	JP	5:35 p.m.	3/21/18	JP	Y	
161	AE652349	Blank	<0.8	5:21 p.m.	3/19/18	JP	5:34 p.m.	3/21/18	JP	Y	
162	AE652056	Blank	<0.8	4:21 p.m.	3/19/18	JP	4:49 p.m.	3/21/18	JP	Y	
163	AE652342	Blank	<0.7	4:20 p.m.	3/19/18	JP	4:47 p.m.	3/21/18	JP	Y	
164	AE652337	Blank	<0.6	4:02 p.m.	3/19/18	JP	4:31 p.m.	3/21/18	JP	Y	
165	AE652077	Blank	<0.8	3:54 p.m.	3/19/18	JP	4:21 p.m.	3/21/18	JP	Y	
166	AE652345	Blank	<0.5	3:52 p.m.	3/19/18	JP	4:18 p.m.	3/21/18	JP	Y	



167	AE652341	Blank	<0.8	4:47 p.m.	3/19/18	JP	5:00 p.m.	3/21/18	JP	Y
-----	----------	-------	------	-----------	---------	----	-----------	---------	----	---