

Public Works Department – Main Office

708 W Summer St., Greeneville, TN 37743

Brad Peters, P.E. - Director

12/1/19



LOCATION SUMMARY

The Public Works Department Office is the headquarters of the Public Works Department. The Department provides solid waste, street maintenance, fleet maintenance, and traffic control services for the Town.

Oversight of the facility rests with the department director, currently Brad Peters (423-787-6382, bpeters@greenevilletn.gov) and the assistant director, currently William Barner (423-638-6152, wbarner@greenevilletn.gov.)

ADA Checklist for Existing Facilities

Priority 1 – Approach & Entrance

Based on the 2010 ADA Standards for Accessible Design



Project: Greeneville ADA Assessment

Building: Greeneville Public Works

Location: 708 West Summer Street

Date: Dec. 10 2018

Surveyors: Dave Wright, Gail Stacy, Caroline Miller

Contact Information: 423-525-5093

An accessible route from site arrival points and an accessible entrance should be provided for everyone.

Priority 1 – Approach & Entrance	Comments	Possible Solutions
----------------------------------	----------	--------------------

1.1 Is there at least one route from site arrival points (parking, passenger loading zones, public sidewalks and public transportation stops) that does not require the use of stairs? [See 2010 ADA Standards for Accessible Design – 206.2.1]	Yes If yes, location of route:			Photo #:
--	---------------------------------------	--	--	----------

Parking Accessible parking spaces should be identified by size, access aisle and signage.
--

1.2 If parking is provided for the public, are an adequate number of accessible spaces provided? [208.2]	Yes Total #: 6 Accessible #: 1	<table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th style="padding: 5px;">Total Spaces</th> <th style="padding: 5px;">Accessible Spaces</th> </tr> </thead> <tbody> <tr> <td style="text-align: center; padding: 5px;">1 - 25</td> <td style="text-align: center; padding: 5px;">1</td> </tr> <tr> <td style="text-align: center; padding: 5px;">26 - 50</td> <td style="text-align: center; padding: 5px;">2</td> </tr> <tr> <td style="text-align: center; padding: 5px;">51 - 75</td> <td style="text-align: center; padding: 5px;">3</td> </tr> <tr> <td style="text-align: center; padding: 5px;">76 - 100</td> <td style="text-align: center; padding: 5px;">4</td> </tr> <tr> <td colspan="2" style="padding: 5px;">100+ see 2010 Standards 208.2</td> </tr> </tbody> </table>	Total Spaces	Accessible Spaces	1 - 25	1	26 - 50	2	51 - 75	3	76 - 100	4	100+ see 2010 Standards 208.2			
Total Spaces	Accessible Spaces															
1 - 25	1															
26 - 50	2															
51 - 75	3															
76 - 100	4															
100+ see 2010 Standards 208.2																
				Photo #:												

1.3 Of the accessible spaces, is at least one a van accessible space?*[208.2.4]	No	*For every 6 or fraction of 6 parking spaces required by the table above, at least 1 should be a van accessible space.		* If constructed before 3/15/2012, parking is compliant if at least 1 in every 8 accessible spaces is van accessible <ul style="list-style-type: none"> Reconfigure by repainting lines Budget Year: 2020
				Photo #:

Cost: \$200

1.4 Are accessible spaces at least 8 feet wide with an access aisle at least 5 feet wide?
[502.2, 502.3]

Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.

Yes

Measurement:
Space: 8'-0"
Aisle: 5'-0"




Photo #:

1.7 Are the access aisles marked so as to discourage parking in them?
[502.3.3]

Note: The marking method and color may be addressed by state/local requirements.

Yes

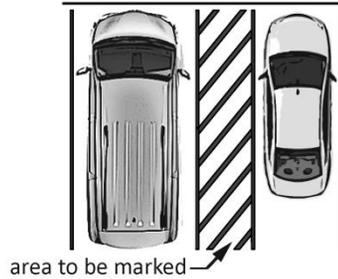


Photo #:

1.8 Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions?
[502.4]

No

Measurement:
1 ½:12
Cross ½:12



Photo #:

- Topography and underground fuel storage tanks make re-grading the slope unreasonable
- Will create signage directing accessibility through the breakroom

<p>1.12 Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]</p> <p>Note: If parking serves multiple entrances, accessible parking should be dispersed.</p>	<p>No</p>			<ul style="list-style-type: none"> • Reconfigure spaces <p>Budget Year: 2020</p> <p>Cost: \$100</p>
---	-----------	--	---	--




Photo #:

Exterior Accessible Route

<p>1.13 Is the route stable, firm and slip-resistant? [302.1]</p>	<p>Yes</p>			
--	------------	--	--	--

Photo #:

<p>1.14 Is the route at least 36 inches wide? [403.5.1]</p> <p>Note: The accessible route can narrow to 32 inches min. for a max. of 24 inches. These</p>	<p>Yes</p> <p>Measurement: 59 inches</p>			
--	--	--	--	--
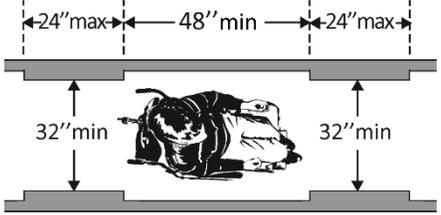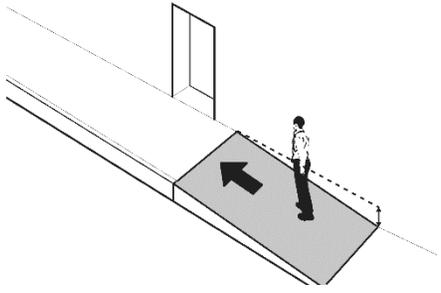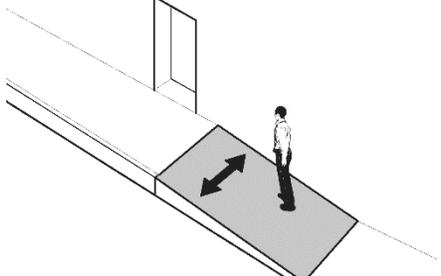
<p>narrower portions of the route must be at least 48 inches from each other.</p>			 <p>Photo #:</p>	
<p>1.17 Is the running slope no steeper than 1:20, i.e. for every inch of height change there are at least 20 inches of route run? [403.3]</p> <p>Note: If the running slope is steeper than 1:20, treat as a ramp and add features such as edge protection and handrails.</p>	<p>No</p> <p>Measurement: 1 ½:12</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> • Regrade to 1:20 max. • Relocate accessible parking <p>Budget Year: 2020</p> <p>Cost: \$100</p>
<p>1.18 Is the cross slope no steeper than 1:48? [403.3]</p>	<p>No</p> <p>Measurement: 1/2:12</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> • Regrade to 1:48 max. • Relocate accessible parking <p>Refer to 1.17</p>

Entrance

1.37 Is the main entrance accessible?

No

Photo #:

- Redesign to make it accessible
- Refer to 1.17

1.38 If the main entrance is not accessible, is there an alternative accessible entrance?

No

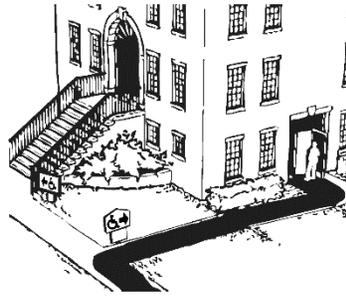


Photo #:

- Designate an entrance and make it accessible
- Refer to 1.17

1.41 Is the clear opening width of the accessible entrance door at least 32 inches, between the face of the door and the stop, when the door is open 90 degrees?
[404.2.3]

Yes
Measurement:
34 inches

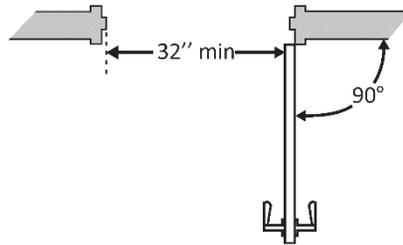


Photo #:

1.42 If there is a front approach to the pull side of the door, is there at least 18 inches of maneuvering clearance beyond the latch side plus at least 60 inches clear depth?

Note: See 2010 Standards 404.2.4 for maneuvering clearance requirements on the push side of the door and side approaches to the pull side of the door


On both sides of the door, is the ground or floor surface of the maneuvering clearance level (no steeper than 1:48)? [404.2.4]

No, potted plant within 18 inch pull side

Measurement:

No

Measurement:
Exterior: 2 ½ inch step, ¾:12 slope



- Remove obstructions

Budget year: 2020

Cost: \$0

Photo #:

1.43 If the threshold is vertical is it no more than ¼ inch high?

Or

No more than ½ inch high with the top ¼ inch beveled no steeper than 1:2, if the threshold was installed on or after the 1991 ADA Standards went into effect (1/26/93)?

Or

No more than ¾ inch high with the top ½ inch beveled no steeper than 1:2, if the threshold was installed before the 1991 ADA Standards went into effect (1/26/93)?
[404.2.5, 303.2]

Note: The first ¼ inch of the ½ or ¾ inch threshold may be vertical; the rest must be beveled.

NA
Measurement:

Yes
Measurement:

NA
Measurement:

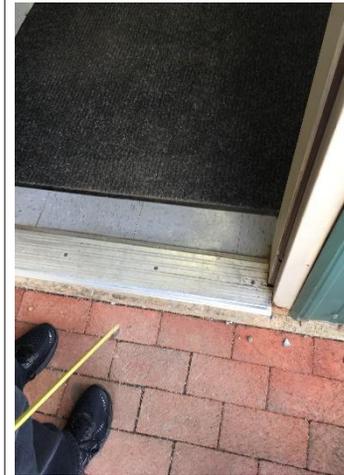



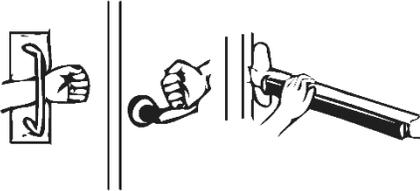
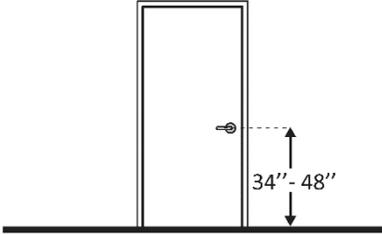
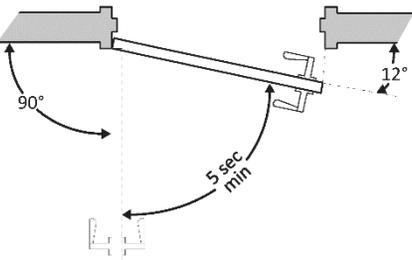


Photo #:

<p>1.44 Is the door equipped with hardware that is operable with one hand and does not require tight grasping, pinching or twisting of the wrist?</p> <p>Door handle?</p> <p>Lock (if provided)? [404.2.7]</p>	<p>Yes</p> <p>Yes</p> <p>NA</p>		 <p>Photo #:</p>	
<p>1.45 Are the operable parts of the door hardware no less than 34 inches and no greater than 48 inches above the floor or ground surface? [404.2.7]</p>	<p>Yes</p> <p>Measurement: 42 inches</p>		 <p>Photo #:</p>	

<p>1.46 If the door has a closer, does it take at least 5 seconds to close from an open position of 90 degrees to a position of 12 degrees from the latch? [404.2.8]</p>	<p>No</p> <p>Measurement:</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> • Adjust closer <p>Budget year: 2020</p> <p>Cost: \$0</p>
<p>1.48 If provided at the building entrance, are carpets or mats no higher than ½ inch thick? [302.2]</p>	<p>Yes</p> <p>Measurement:</p>		 <p>Photo #:</p>	
<p>1.49 Are edges of carpets or mats securely attached to minimize tripping hazards? [302.2]</p>	<p>No</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> • Secure carpeting or mats at edges <p>Budget year: 2020</p> <p>Cost: \$0</p>

Priority 2 – Access to Goods & Services		Comments	Possible Solutions
2.1	Does the accessible entrance provide direct access to the main floor, lobby and elevator? [See 2010 ADA Standards for Accessible Design – 206.4]	Yes	Photo #:
Interior Accessible Route			
2.2	Are all public spaces on at least one accessible route? [206.2.4]	Yes	 <p>Photo #:</p>
2.3	Is the route stable, firm and slip-resistant? [40.2, 302.1]	Yes	Photo #:

2.4 Is the route at least 36 inches wide?
[403.5.1]

Note: The accessible route can narrow to 32 inches min. for a max. of 24 inches. These narrower portions of the route must be at least 48 inches from each other.

Yes
Measurement:
52 inches

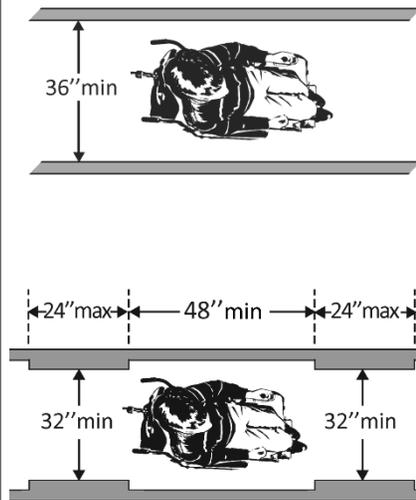


Photo #:

Controls – light switches, security and intercom systems, emergency/alarm boxes, etc.

2.50 Is there a clear floor space at least 30 inches wide by at least 48 inches long for a forward or parallel approach?
[305.3]

Are the operable parts no higher than 48 inches above the floor?*

[309.3, 308]

Yes
Measurement:
46 inches

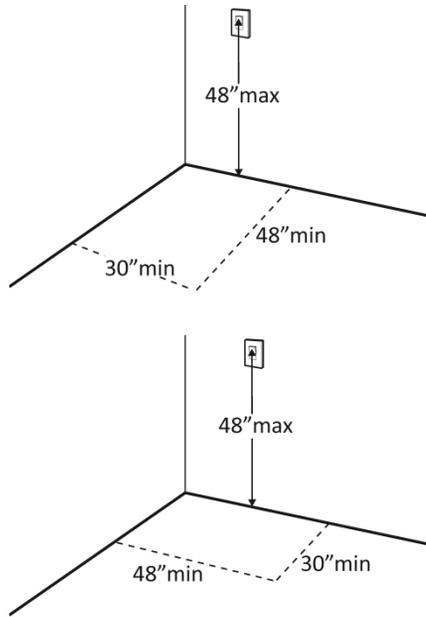


Photo #:

*If constructed before 3/15/2012 and a parallel approach is provided, controls can be 54 inches above the floor

2.51 Can the control be operated with one hand and without tight grasping, pinching, or twisting of the wrist?
[309.4]

Yes




Photo #:

Sales & Service Counters – banks, stores, dry cleaners, auto repair shops, fitness clubs, etc.


2.76 Is there a portion of at least one of each type of counter that is:

No higher than 36 inches above the floor?

At least 36 inches long?
[904.4.1]

No
Measurement:
43 inches

Yes
Measurement:47
inches

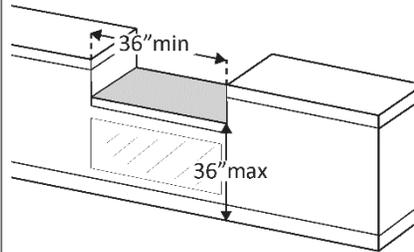

- Lower section of counter

Budget year: 2020
Cost: \$100



Photo #:

2.78 Is there a clear floor space at least 30 inches wide by at least 48 inches long for a forward or parallel approach?
[904.4]

Yes
Parallel
Measurement:

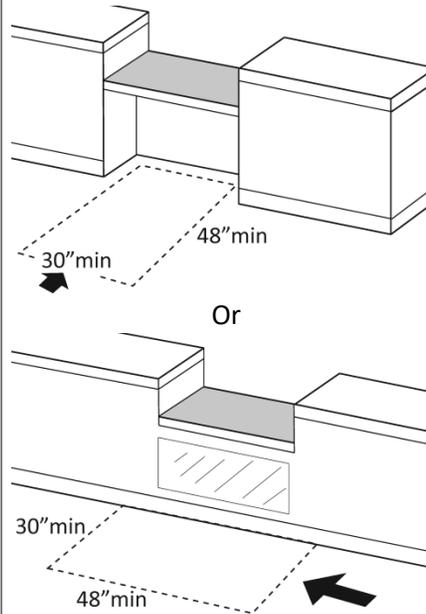


Photo #:

Priority 3 – Toilet Rooms

Comments

Possible Solutions

3.1 If toilet rooms are available to the public, is at least one toilet room accessible? (Either one for each sex, or one unisex.)

Note: If toilet rooms are chiefly for children, e.g., in elementary schools and day care centers, use the children’s specifications in Toilets - 604.1, 604.8, 604.9, 609.4 and Lavatories and Sinks – 606.2.

Yes

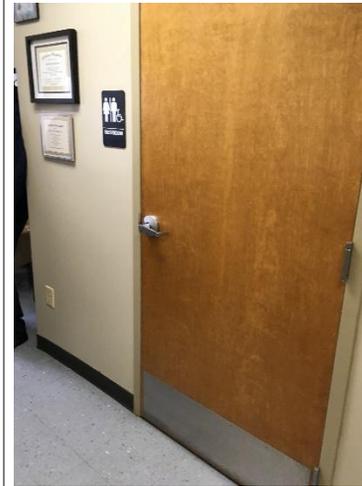


Photo #:

3.3 If not all toilet rooms are accessible, is there a sign at the accessible toilet room with the International Symbol of Accessibility?
[216.8]

Yes



Photo #:

Accessible Route

3.4 Is there an accessible route to the accessible toilet room?
[206.2.4]

Yes



Photo #:

Signs at Toilet Rooms

3.5 Do text characters contrast with their backgrounds?
[703.5]

Yes

Are text characters raised?
[703.2]

Yes


Is there Braille?
[703.3]

Yes

Is the sign mounted:
On the wall on the latch side of the door?
[703.4.2]

Yes

Note: Signs are permitted on the push side of doors with

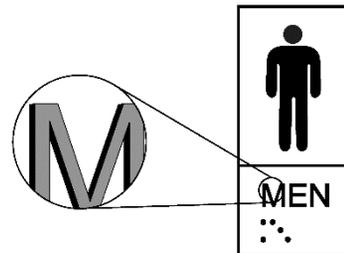

Constructed prior to 2012

*If constructed before 3/15/2012 and a person may approach within 3 inches of the sign without


closers and without hold-open devices.

With clear floor space beyond the arc of the door swing between the closed position and 45-degree open position, at least 18 x 18 inches centered on the tactile characters? * [703.4.2]

So the baseline of the lowest character is at least 48 inches above the floor and the baseline of the highest character is no more than 60 inches above the floor? * [703.4.1]


No

Measurement:

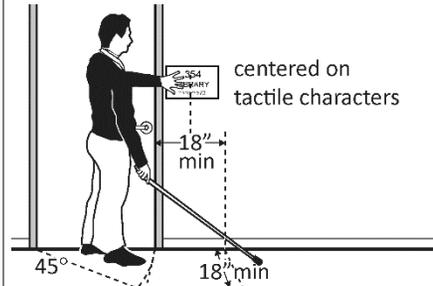

Yes

Measurement:
4'-7"

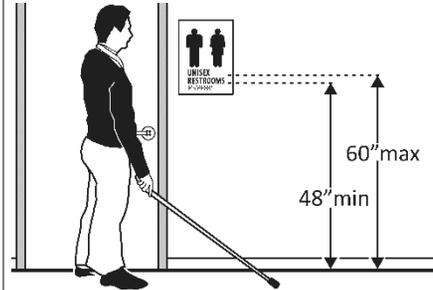

encountering protruding objects or standing within the door swing, relocation not required

*If constructed before 3/15/2012 and mounted no higher than 60 inches to the centerline of the sign, relocation is not required

Photo #:

Entrance

3.6 Is the door opening width at least 32 inches clear, between the face of the door and the stop, when the door is open 90 degrees? [404.2.3]

Yes

Measurement:
36 inches

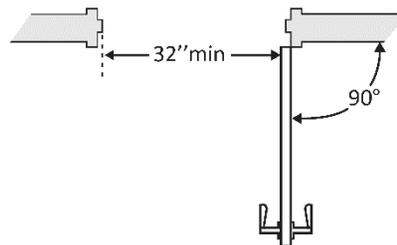


Photo #:

3.7 If there is a front approach to the pull side of the door is there at least 18 inches of maneuvering clearance beyond the latch side plus 60 inches clear depth?

Note: See 2010 Standards 404.2.4 for maneuvering clearance requirements on the push side of the door and side approaches to the pull side of the door

On both sides of the door, is the floor surface of the maneuvering clearance level (no steeper than 1:48)? [404.2.4]

Yes
Measurement:
34 inches





Photo #:

3.8 If the threshold is vertical is it no more than ¼ inch high?
Or
No more than ½ inch high with the top ¼ inch beveled no steeper than 1:2, if the threshold was installed on or after the 1991 ADA Standards went into effect (1/26/93)?

Or
No more than ¾ inch high with the top ½ inch beveled no steeper than 1:2, if the threshold was installed before

NA
No threshold
Measurement:
NA



NA
Measurement:



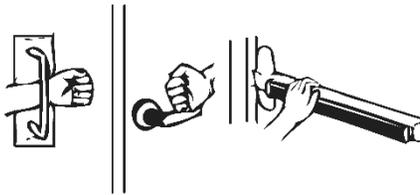
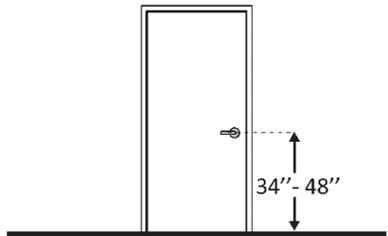

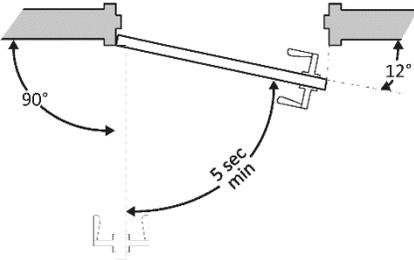


Photo #:

<p>the 1991 ADA Standards went into effect (1/26/93)? [404.2.5, 303.2]</p> <p>Note: The first ¼ inch of the ½ or ¾ inch threshold may be vertical; the rest must be beveled.</p>		 <p>3/4" max →</p>		
<p>3.9 Is the door equipped with hardware that is operable with one hand and does not require tight grasping, pinching or twisting of the wrist? Door handle? Lock (if provided)? [404.2.7]</p>	<p>Yes</p> <p>Yes</p> <p>Yes</p>		 <p>Photo #:</p>	
<p>3.10 Are the operable parts of the door hardware mounted no less than 34 inches and no greater than 48 inches above the floor? [404.2.7]</p>	<p>Yes</p> <p>Measurement: 40 inches</p>	 <p>34" - 48"</p>	 <p>Photo #:</p>	

<p>3.11 Can the door be opened easily (5 pounds maximum force)? [404.2.9] Note: You can use a pressure gauge or fish scale to measure force. If you do not have one you will need to judge whether the door is easy to open.</p>	<p>Yes Measurement:</p>		<p>Photo #:</p>	
<p>3.12 If the door has a closer, does it take at least 5 seconds to close from an open position of 90 degrees to a position of 12 degrees from the latch? [404.2.8.1]</p>	<p>Yes Measurement:</p>		 <p>Photo #:</p>	
In the Toilet Room				
<p>3.16 Is there a clear path to at least one of each type of fixture, e.g. lavatory, hand dryer, etc., that is at least 36 inches wide? [403.5.1]</p>	<p>Yes Measurement:</p>		 <p>Photo #:</p>	

3.17 Is there clear floor space available for a person in a wheelchair to turn around, i.e. a circle at least 60 inches in diameter or a T-shaped space within a 60-inch square? [603.2.1]

Yes
Measurement:

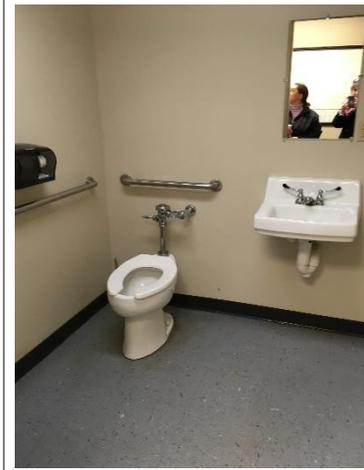
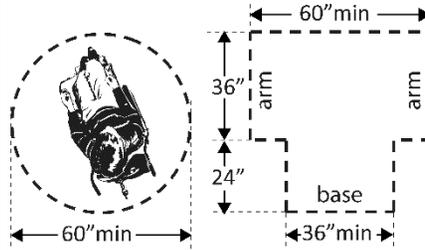


Photo #:

3.18 In a single user toilet room if the door swings in and over a clear floor space at an accessible fixture, is there a clear floor space at least 30 x 48 inches beyond the swing of the door? [603.2.3 Exception 2]

Yes
Measurement:

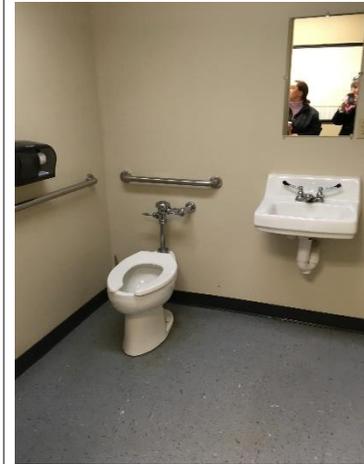

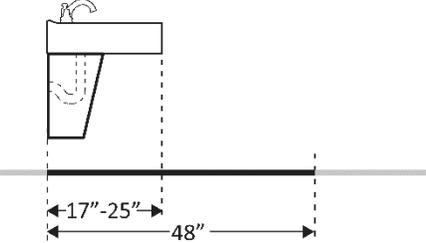
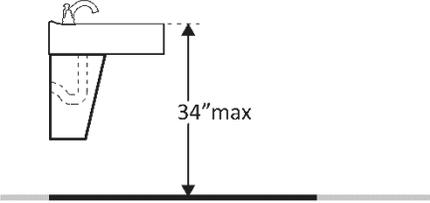


Photo #:

			 <p>Photo #:</p>	
<p>3.22 Do no less than 17 inches and no greater than 25 inches of the clear floor space extend under the lavatory so that a person using a wheelchair can get close enough to reach the faucet? [306.2]</p>	<p>Yes Measurement:</p>			

				
<p>3.23 Is the front of the lavatory or counter surface, whichever is higher, no more than 34 inches above the floor? [606.3]</p>	<p>Yes Measurement: 34 inches</p>			<p>Photo #:</p>

3.24 Is there at least 27 inches clearance from the floor to the bottom of the lavatory that extends at least 8 inches under the lavatory for knee clearance?
[306.3.3]

Yes
Measurement:

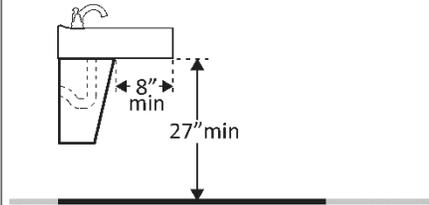


Photo #:

3.25 Is there toe clearance at least 9 inches high?
[306.3.3]

Yes

Note: Space extending greater than 6 inches beyond the available toe clearance at 9 inches above the floor is not considered toe clearance.

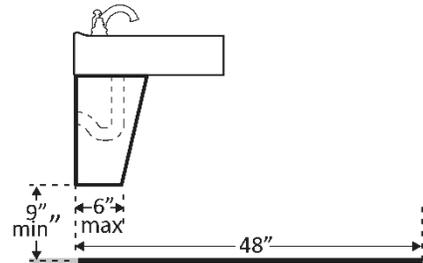


Photo #:

3.26 Are pipes below the lavatory insulated or otherwise configured to protect against contact?
[606.5]

Yes




Photo #:

3.27 Can the faucet be operated without tight grasping, pinching, or twisting of the wrist?

Is the force required to activate the faucet no greater than 5 pounds?
[606.4]

Yes

Yes

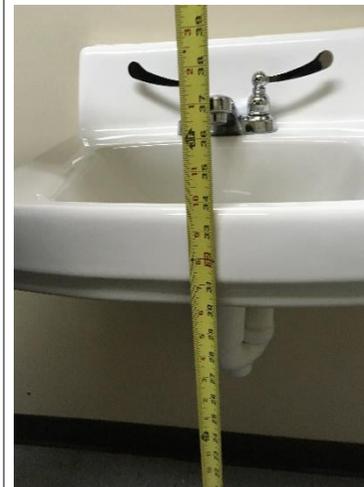



Photo #:

Soap Dispensers and Hand Dryers

3.28 Are the operable parts of the soap dispenser within one of the following reach ranges:


Above lavatories or counters no less than 20 inches and no greater than 25 inches deep: no higher than 44 inches above the floor?
[308.2.2]

Above lavatories less than 20 inches deep: no higher than 48 inches above the floor?

Not over an obstruction: no higher than 48 inches above the floor?
[308.2]


NA

Measurement:

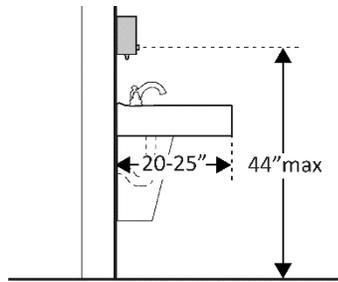

Yes

Measurement:
45 inches

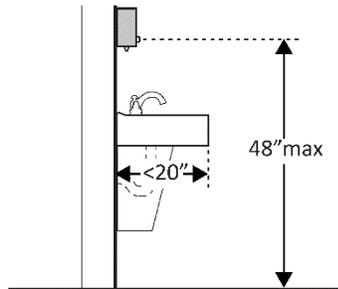

NA

Measurement:

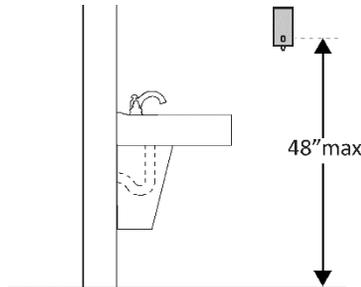


Photo #:

3.29 Are the operable parts of the hand dryer or towel dispenser within one of the following reach ranges:

Above lavatories or counters no less than 20 inches and no greater than 25 inches deep: no higher than 44 inches above the floor?

Above lavatories less than 20 inches deep: no higher than 48 inches above the floor?

Not over an obstruction: no higher than 48 inches above the floor?
[308.2]

Can the operable parts of the hand dryer or towel dispenser be operated without tight grasping, pinching or twisting of the wrist?

Is the force required to activate the hand dryer or towel dispenser no greater than 5 pounds?
[309.4]

NA
Measurement:

NA
Measurement:

Yes
Measurement:
51 inches

No

NA
Measurement:

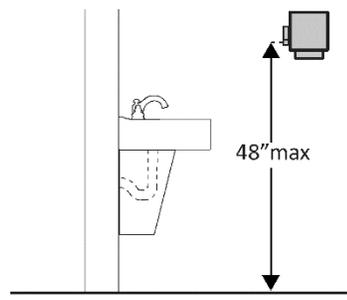
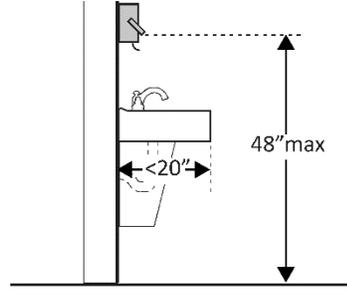
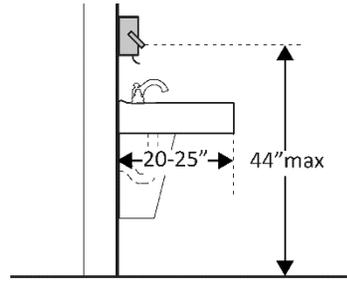


Photo #:

- Replace with or provide additional accessible dispensers

Budget year: 2020

Cost: \$50

Water Closets in Single-User Toilet Rooms and Compartments (Stalls) The 2010 Standards refer to toilets as water closets.

3.30 Is the centerline of the water closet no less than 16 inches and no greater than 18 inches from the side wall or partition? [604.2]

No
Measurement:
18- 5/8 inches





Photo #:


- Move toilet
 - Replace toilet
- Budget year: 2020
Cost: \$200

3.31 Is clearance provided around the water closet measuring at least 60 inches from the side wall and at least 56 inches from the rear wall?*[604.3.1]

No/Yes
Measurement:
43 inches



* If constructed before 3/15/12, clearances around water closets in single user toilet rooms can be 48 inches wide by 66 inches long or 48 inches wide by 56 inches long (depending on the approach to the water closet, see 1991 Standards Figure 28) and the lavatory may overlap that clearance if the door to the room does not swing into the required clearances at fixtures (such as lavatories, water closet and urinals) and the edge of the lavatory is at

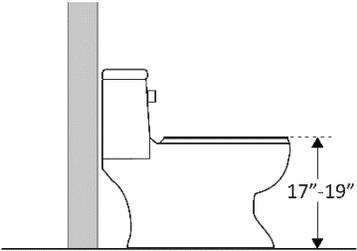				<p>least 18 inches from the centerline of the water closet</p> <ul style="list-style-type: none"> • Move toilet & lavatory <p>Budget year: 2020</p> <p>Cost: \$200</p>
<p>3.32 Is the height of the water closet no less than 17 inches and no greater than 19 inches above the floor measured to the top of the seat? [604.4]</p>	<p>Yes</p> <p>Measurement: 18 inches</p>			<p>Photo #:</p>

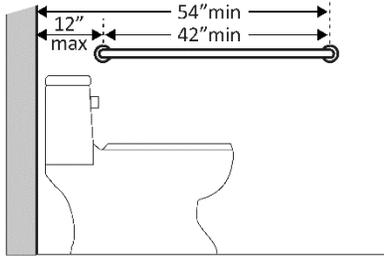
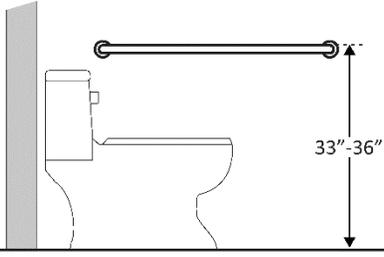
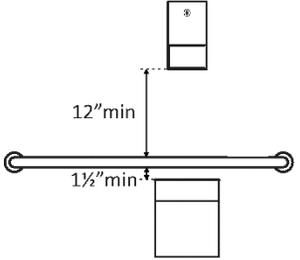
<p>3.33 Is there a grab bar at least 42 inches long on the side wall?</p> <p>Is it located no more than 12 inches from the rear wall?</p> <p>Does it extend at least 54 inches from the rear wall? [604.5.1]</p> <p>Is it mounted no less than 33 inches and no greater than 36 inches above the floor to the top of the gripping surface? [609.4]</p> <p>Is there at least 12 inches clearance between the grab bar and protruding objects above?*</p> <p>Is there at least 1½ inches clearance between the grab bar and projecting objects below?*</p> <p>Is the space between the wall and the grab bar 1 ½ inches? [609.3]</p>	<p>No Measurement: 30 inches</p> <p>No Measurement: 7 inches</p> <p>No Measurement:</p> <p>No Measurement: 37 inches</p> <p>No Measurement: 5 inches</p> <p>NA Measurement:</p> <p>Yes Measurement:</p>	  	 	<ul style="list-style-type: none"> • Install 42 inch grab bar • Relocate objects <p>Budget year: 2020</p> <p>Cost: \$30</p> <p>* If constructed before 3/15/2012 grab bars do not need to be relocated; there are no space requirements above and below grab bars in the 1991 Standards</p>
---	---	---	--	---



Photo #:

3.34 Is there a grab bar at least 36 inches long on the rear wall?

No
Measurement:

Does it extend at least 12 inches from the centerline of the water closet on one side (side wall)?

Yes
Measurement:
12 inches

Does it extend at least 24 inches on the other (open) side?
[604.5.2]

No
Measurement:

Is it mounted no less than 33 inches and no greater than 36 inches above the floor to the top of the gripping surface?
[609.4]

No
Measurement:
28 inches

Are there at least 12 inches clearance between the grab bar and protruding objects above?*






NA
Measurement:

Are there at least 1½ inches clearance between the grab bar and projecting objects below?*

Yes
Measurement:

Is the space between the wall and the grab bar 1½ inches?
[609.3]

Yes
Measurement:

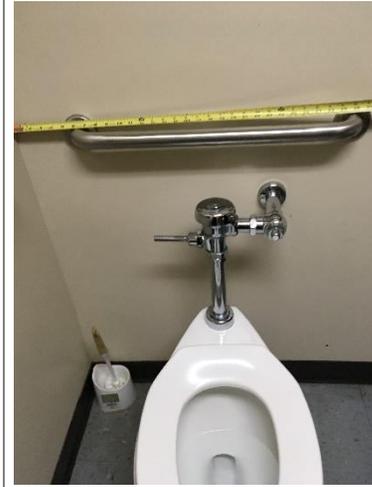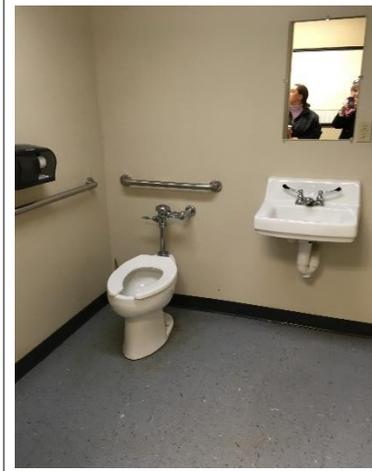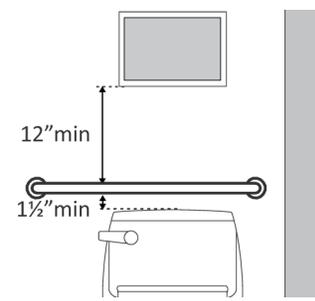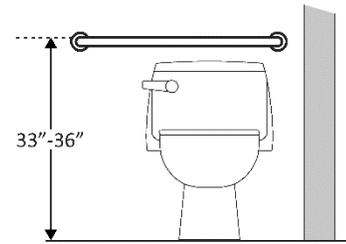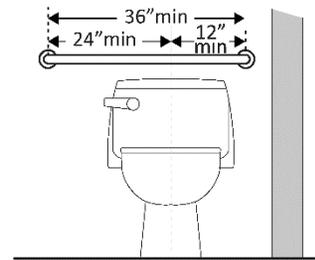

• Install 36 inch grab bar
Budget year: 2020
Cost: \$30

* If constructed before 3/15/2012 grab bars do not need to be relocated; there are no space requirements above and below grab bars in the 1991 Standards

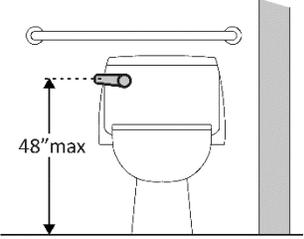
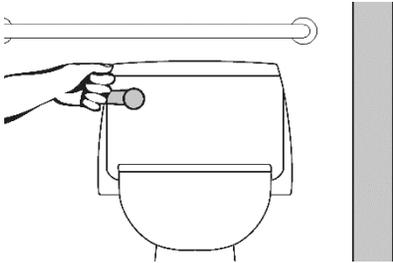
				
<p>3.35 If the flush control is hand operated, is the operable part located no higher than 48 inches above the floor? [604.6]</p>	<p>Yes Measurement:</p>			

Photo #:

Photo #:

<p>3.36 If the flush control is hand operated, can it be operated with one hand and without tight grasping, pinching, or twisting of the wrist?</p> <p>Is the force required to activate the flush control no greater than 5 pounds? [605.4]</p>	<p>Yes</p> <p>Yes</p> <p>Measurement:</p>		 <p>Photo #:</p>	
<p>3.37 Is the flush control on the open side of the water closet? [604.6]</p>	<p>No</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> • Move control <p>Refer to 3.31</p>

3.38 Is the toilet paper dispenser located no less than 7 inches and no greater than 9 inches from the front of the water closet to the centerline of the dispenser?*[604.7]

NA
Measurement:




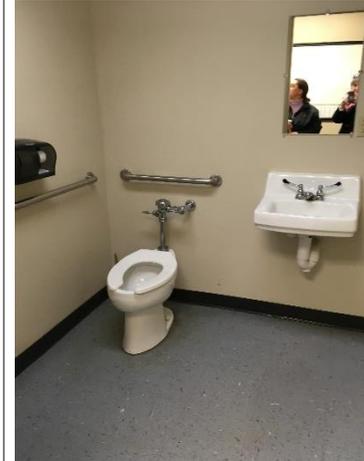


Photo #:

* If constructed before 3/15/2012 dispenser does not need to be relocated if it is within reach from the water closet seat; the 1991 Standards do not specify distance from the front of the water closet

<p>3.39 Is the outlet of the dispenser:</p> <p>Located no less than 15 inches and no greater than 48 inches above the floor?</p> <p>Not located behind grab bars? [604.7]</p>	<p>Yes</p> <p>Measurement:</p> <p>Yes</p>		 <p>Photo #:</p>	
<p>3.40 Does the dispenser allow continuous paper flow? [604.7]</p>	<p>Yes</p>		 <p>Photo #:</p>	

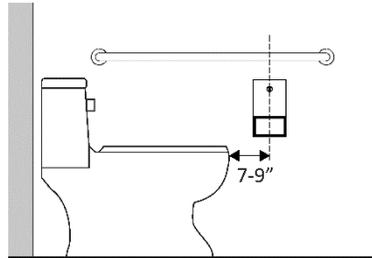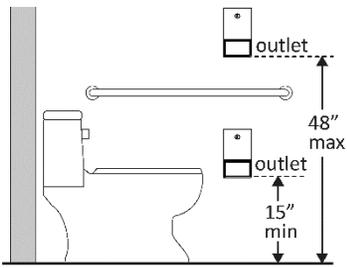