

**Eastview Recreation Center  
Administration**

**456 East Bernard Avenue**

**Town Administrator Todd Smith**

**Assessment October 23, 2018**



**LOCATION SUMMARY**

This facility houses the administration division of the Greenville Parks & Recreation Department. The center also has two 84' x 50' gymnasiums, a Splash Pad, dressing rooms/restrooms with shower facilities, storage areas, a banquet room, concessions area, and a covered picnic pavilion.

**Responsible for the Eastview Recreation Center ADA Transition Plan Section**

Director Butch Patterson – 423-638-3143 / [bpatterson@greenvilletn.gov](mailto:bpatterson@greenvilletn.gov)

Office Manager / Program Supervisor Lisa Scott Fisher – 423-638-3143 / [lfisher@greenvilletn.gov](mailto:lfisher@greenvilletn.gov)

Maintenance Supervisor John Darnell – 423-823-0720 / [jdarnell@greenvilletn.gov](mailto:jdarnell@greenvilletn.gov)



---

# ADA Checklist for Existing Facilities

---

Based on the 2010 ADA Standards for Accessible Design



**Project:** Greeneville TN ADA Assessment

---

**Building:** Eastview Recreation Center Administration

---

**Location:** 456 East Bernard Avenue

---

**Date:** June 25, 2018

---

**Surveyors:** Dave Wright, Gail Stacy, Caroline Miller

---

**Contact Information:** 423-525-5093

---

---

**An accessible route from site arrival points and an accessible entrance should be provided for everyone.**

---

**Priority 1 – Approach & Entrance**

**Comments**

**Possible Solutions**

**1.1** Is there at least one route from site arrival points (parking, passenger loading zones, public sidewalks and public transportation stops) that does not require the use of stairs? [See 2010 ADA Standards for Accessible Design – 206.2.1]

Yes  
If yes, location of route:



Photo #:

**Parking** Accessible parking spaces should be identified by size, access aisle and signage.


**1.2** If parking is provided for the public, are an adequate number of accessible spaces provided? [208.2]


Yes  
Total #: 112  
Accessible #: 6


Total Spaces	Accessible Spaces
1 - 25	1
26 - 50	2
51 - 75	3
76 - 100	4
100+ see 2010 Standards 208.2	


Photo #:


<p><b>1.3</b> Of the accessible spaces, is at least one a van accessible space?*</p> <p>[208.2.4]</p>	<p>Yes</p>	<p>*For every 6 or fraction of 6 parking spaces required by the table above, at least 1 should be a van accessible space.</p>	<p>Photo #:</p>	<p>* If constructed before 3/15/2012, parking is compliant if at least 1 in every 8 accessible spaces is van accessible</p>
---	------------	---	-----------------	---



<p><b>1.4</b> Are accessible spaces at least 8 feet wide with an access aisle at least 5 feet wide?</p> <p>[502.2, 502.3]</p> <p>Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.</p>	<p>Yes</p> <p>Measurement: 9'-0" +/- 8'-0" aisle</p>		 <p>Photo #:</p>	
---	--	--	---	--


<p><b>1.4</b> Are accessible spaces at least 8 feet wide with an access aisle at least 5 feet wide?</p> <p>[502.2, 502.3]</p> <p>Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.</p>	<p>No at side of building</p> <p>Measurement: No aisle</p>		 <p>Photo #:</p>	<p>Mark access aisles</p> <p>Budget Year: 2020</p> <p>Cost: \$50</p>
---	--	--	---	--
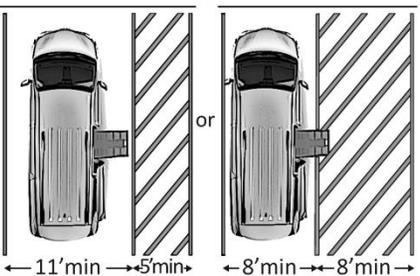
<p><b>1.5</b> Is the van accessible space:</p> <p>At least 11 feet wide with an access aisle at least 5 feet wide?</p> <p>Or</p> <p>At least 8 feet wide with an access aisle at least 8 feet wide?</p> <p>[502.2]</p>	<p>NA</p> <p>Measurement:</p> <p>Yes</p> <p>Measurement:</p> <p>+/-9'-0"</p> <p>8'-0" aisle</p>		 <p>Photo #:</p>	
--	---	--	---	--

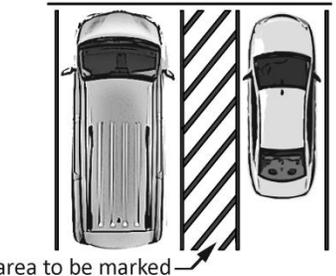
<p><b>1.7</b> Are the access aisles marked so as to discourage parking in them?</p> <p>[502.3.3]</p> <p>Note: The marking method and color may be addressed by state/local requirements.</p>	<p>Yes</p>		 <p>Photo #:</p>	
--	------------	---	--	--
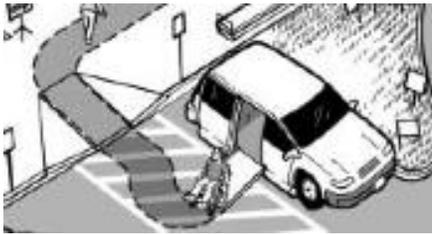
<p><b>1.8</b> Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]</p>	<p>Yes</p> <p>Measurement: 1:48</p>			
<p><b>1.9</b> Do the access aisles adjoin an accessible route? [502.3]</p>	<p>Yes</p>		<p>Photo #:</p>	<p>Photo #:</p>
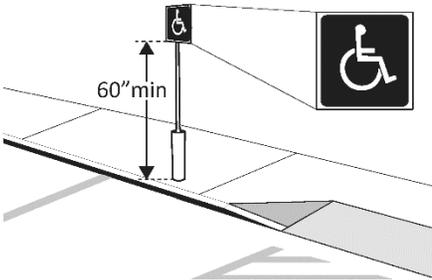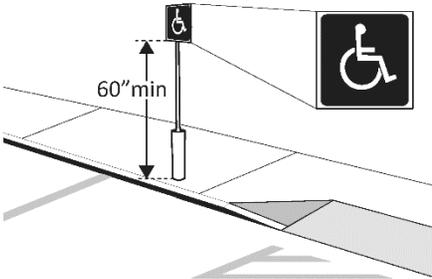
<p><b>1.10</b> Are accessible spaces identified with a sign that includes the International Symbol of Accessibility?</p> <p>Is the bottom of the sign at least 60 inches above the ground? [502.6]</p> <p>Note: The International Symbol of Accessibility is not required on the ground.</p>	<p>Yes</p> <p>Yes</p> <p>Measurement: 5'-0"</p>		 <p>Photo #:</p>	
<p><b>1.10</b> Are accessible spaces identified with a sign that includes the International Symbol of Accessibility?</p> <p>Is the bottom of the sign at least 60 inches above the ground? [502.6]</p> <p>Note: The International Symbol of Accessibility is not required on the ground.</p>	<p>Yes</p> <p>No</p> <p>Measurement: 4'-3" &amp; 1'-9"</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>• Relocate signs</li> </ul> <p>Budget Year: 2020</p> <p>Cost: \$75</p>
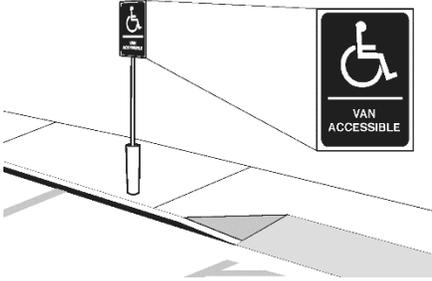
<p><b>1.11</b> Are there signs reading “van accessible” at van accessible spaces? [502.6]</p>	<p>Yes</p>	 <p>A 3D perspective diagram of a parking space. A signpost stands in the center, holding two signs: a standard wheelchair symbol and a sign that reads "VAN ACCESSIBLE". The parking space is marked with a white 'P' and a wheelchair symbol on the asphalt.</p>	 <p>A photograph of an outdoor parking lot. A van accessible parking space is visible, marked with a wheelchair symbol and the text "VAN ACCESSIBLE". The space is adjacent to a building with a glass facade and some trees.</p> <p>Photo #:</p>	<ul style="list-style-type: none"> <li>• Cut vegetation</li> </ul> <p>Budget Year: 2020</p> <p>Cost: \$75</p>
<p><b>1.12</b> Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]</p> <p>Note: If parking serves multiple entrances, accessible parking should be dispersed.</p>	<p>Yes</p>		 <p>A photograph showing a concrete sidewalk leading from a parking area towards a building entrance. The sidewalk is clear of obstacles and appears to be the accessible route.</p> <p>Photo #:</p>	

**Exterior Accessible Route**
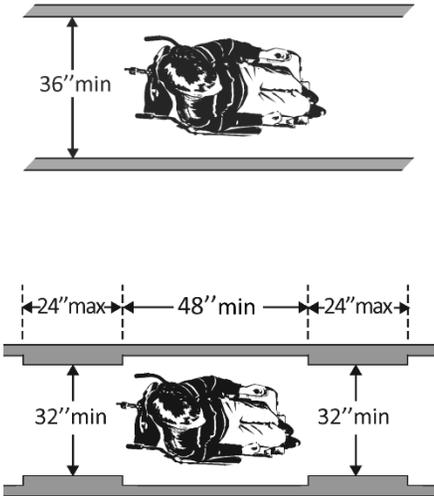
<p><b>1.13</b> Is the route stable, firm and slip-resistant? [302.1]</p>	<p>No</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>• Repair uneven paving</li> <li>• Fill small bumps and breaks with patches</li> </ul> <p>Budget Year: 2020</p> <p>Cost: \$100</p>
<p><b>1.14</b> Is the route at least 36 inches wide? [403.5.1]</p> <p>Note: The accessible route can narrow to 32 inches min. for a max. of 24 inches. These narrower portions of the route must be at least 48 inches from each other.</p>	<p>Yes</p> <p>Measurement: 5'-0"+</p>		 <p>Photo #:</p>	

**1.17** Is the running slope no steeper than 1:20, i.e. for every inch of height change there are at least 20 inches of route run? [403.3]

Note: If the running slope is steeper than 1:20, treat as a ramp and add features such as edge protection and handrails.

Yes  
Measurement:

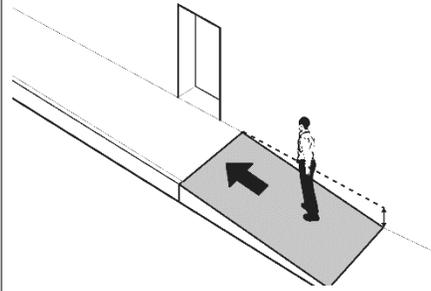


Photo #:

**1.18** Is the cross slope no steeper than 1:48? [403.3]

Yes  
Measurement:

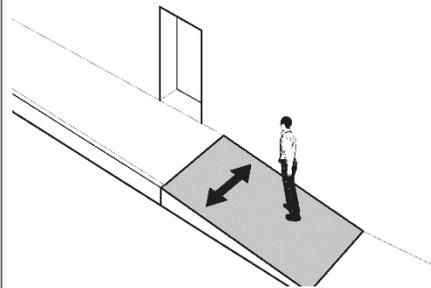
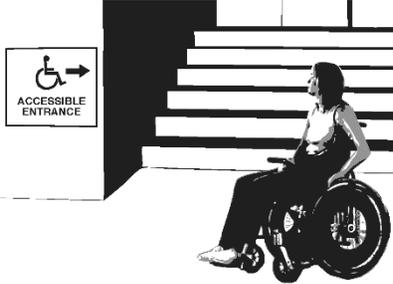
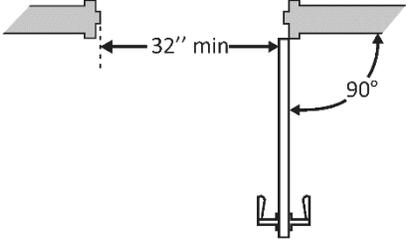

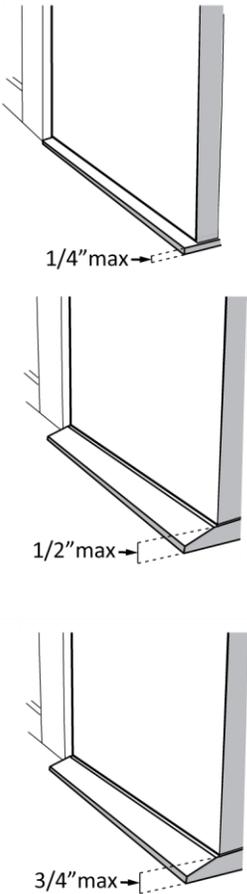
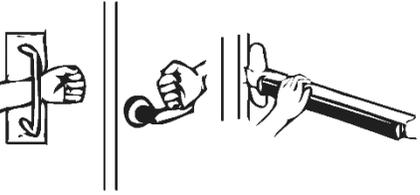


Photo #:

<p><b>1.37</b> Is the main entrance accessible?</p>	<p>Yes</p>		 <p>Photo #:</p>	
<p><b>1.39</b> Do all inaccessible entrances have signs indicating the location of the nearest accessible entrance? [216.6]</p>	<p>No</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>• Install signs</li> <li>• Install signs on route before people get to inaccessible entrances so that people do not have to turn around and retrace route</li> </ul> <p>Budget Year: 2020</p> <p>Cost: \$50</p>
<p><b>1.40</b> If not all entrances are accessible, is there a sign at the accessible entrance with the International Symbol of Accessibility? [216.6]</p>	<p>No</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>• Install sign</li> </ul> <p>Budget Year: 2020</p> <p>Cost: \$50</p>

<p>1.41 Is the clear opening width of the accessible entrance door at least 32 inches, between the face of the door and the stop, when the door is open 90 degrees? [404.2.3]</p>	<p>Yes Measurement: 34 inches</p>	 <p>A technical diagram of a door frame. The door is shown open at a 90-degree angle. A horizontal double-headed arrow indicates a clear opening width of 32 inches minimum between the door's face and the stop. A curved arrow indicates the 90-degree opening.</p>	 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>•</li> <li>•</li> <li>•</li> </ul>
<p>1.42 If there is a front approach to the pull side of the door, is there at least 18 inches of maneuvering clearance beyond the latch side plus at least 60 inches clear depth?</p> <p>Note: See 2010 Standards 404.2.4 for maneuvering clearance requirements on the push side of the door and side approaches to the pull side of the door</p> <p>On both sides of the door, is the ground or floor surface of the maneuvering clearance level (no steeper than 1:48)? [404.2.4]</p>	<p>Yes Measurement:</p> <p>Yes Measurement:</p>	 <p>A diagram showing a wheelchair positioned in a doorway. A dashed rectangle indicates the maneuvering clearance area. A horizontal double-headed arrow shows a width of 18 inches minimum. A vertical double-headed arrow shows a depth of 60 inches minimum. The wheelchair is shown from a top-down perspective.</p>	 <p>Photo #:</p>	

<p>1.43 If the threshold is vertical is it no more than ¼ inch high?</p> <p>Or</p> <p>No more than ½ inch high with the top ¼ inch beveled no steeper than 1:2, if the threshold was installed on or after the 1991 ADA Standards went into effect (1/26/93)?</p> <p>Or</p> <p>No more than ¾ inch high with the top ½ inch beveled no steeper than 1:2, if the threshold was installed before the 1991 ADA Standards went into effect (1/26/93)? [404.2.5, 303.2]</p> <p>Note: The first ¼ inch of the ½ or ¾ inch threshold may be vertical; the rest must be beveled.</p>	<p>NA</p> <p>Measurement:</p> <p>Yes</p> <p>Measurement:</p> <p>NA</p> <p>Measurement:</p>	 <p>The diagrams illustrate three different threshold profiles. The first shows a 1/4 inch maximum height. The second shows a 1/2 inch maximum height. The third shows a 3/4 inch maximum height. Each diagram includes a dashed line indicating the maximum height and a horizontal arrow pointing to it.</p>	 <p>Photo #:</p>	
<p>1.44 Is the door equipped with hardware that is operable with one hand and does not require tight grasping, pinching or twisting of the wrist?</p> <p>Door handle?</p> <p>Lock (if provided)? [404.2.7]</p>	<p>Yes</p> <p>Yes</p> <p>NA</p>	 <p>The diagrams show three types of door hardware: a lever handle, a push button, and a pull handle. Each diagram shows a hand operating the hardware.</p>	 <p>Photo #:</p>	

<p>1.45 Are the operable parts of the door hardware no less than 34 inches and no greater than 48 inches above the floor or ground surface? [404.2.7]</p>	<p>Yes</p> <p>Measurement:</p>		<p>Photo #:</p>	
<p>1.46 If the door has a closer, does it take at least 5 seconds to close from an open position of 90 degrees to a position of 12 degrees from the latch? [404.2.8]</p>	<p>No</p> <p>Measurement:</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> <li>• Adjust closer</li> </ul> <p>Budget Year: 2020</p> <p>Cost: 0</p>
<p>1.48 If provided at the building entrance, are carpets or mats no higher than 1/2 inch thick? [302.2]</p>	<p>Yes</p> <p>Measurement:</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> <li>•</li> </ul>
<p>1.49 Are edges of carpets or mats securely attached to minimize tripping hazards? [302.2]</p>	<p>No</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> <li>• Secure mat at edges</li> </ul> <p>Budget Year: 2020</p>

				Cost: \$0
--	--	--	--	-----------

Priority 2 – Access to Goods & Services		Comments	Possible Solutions
---	--	----------	--------------------

2.1	Does the accessible entrance provide direct access to the main floor, lobby and elevator? [See 2010 ADA Standards for Accessible Design – 206.4]	Yes		Photo #:	<ul style="list-style-type: none"> <li>•</li> <li>•</li> <li>•</li> </ul>
-----	---	-----	--	----------	---

Interior Accessible Route					
---------------------------	--	--	--	--	--

2.2	Are all public spaces on at least one accessible route? [206.2.4]	Yes		Photo #:	<ul style="list-style-type: none"> <li>•</li> <li>•</li> <li>•</li> </ul>
-----	--	-----	--	----------	---

2.3	Is the route stable, firm and slip-resistant? [40.2, 302.1]	Yes		Photo #:	<ul style="list-style-type: none"> <li>•</li> <li>•</li> <li>•</li> </ul>
-----	--	-----	--	----------	---

**2.4** Is the route at least 36 inches wide?  
[403.5.1]

Note: The accessible route can narrow to 32 inches min. for a max. of 24 inches. These narrower portions of the route must be at least 48 inches from each other.

Yes

Measurement:  
8'-0"

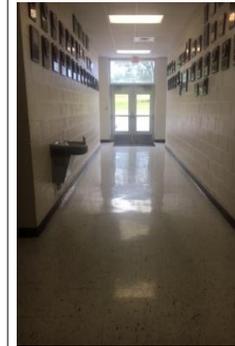
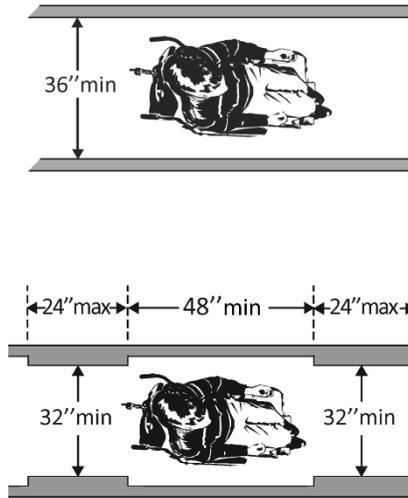


Photo #:

- 
- 

**2.8** Do all objects on circulation paths through public areas, e.g. fire extinguishers, drinking fountains, signs, etc., protrude no more than 4 inches into the path?

Or

If an object protrudes more than 4 inches, is the bottom leading edge at 27 inches or lower above the floor?  
[307.2]


Or

NA

Measurement:



Or

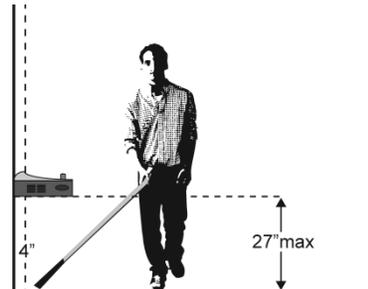

Or

Photo #1:



Add tactile warning such as cane skirt, permanent planter or partial walls


Budget Year: 2020

Cost: \$100

No

Is the bottom leading edge at 80 inches or higher above the floor?  
[307.4]

Measurement:

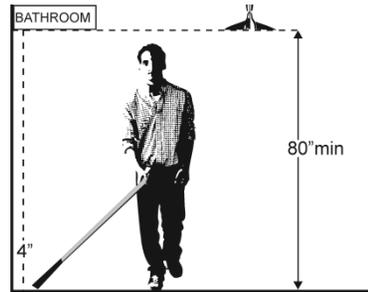

**Signs** "Tactile characters" are read using touch, i.e. raised characters and Braille.

**2.38** If there are signs designating permanent rooms and spaces not likely to change over time, e.g. room numbers and letters, room names, and exit signs:  
[216.2]

No signs

Do text characters contrast with their backgrounds?  
[703.5]

NA

Are text characters raised?  
[703.2]

NA

Is there Braille?  
[703.3]

NA

Is the sign mounted:  
On the wall on the latch side of the door?  
[703.4.2]

NA

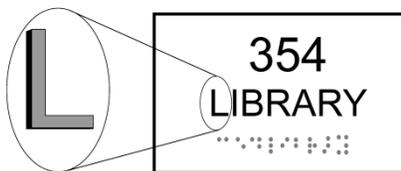


Photo #:

- Install tactile signs

Budget Year: 2020

Cost: \$400

Note: Signs are permitted on the push side of doors with closers and without hold-open devices.


With clear floor space beyond the arc of the door swing between the closed position and 45-degree open position, at least 18 x 18 inches centered on the tactile characters? \* [703.4.2]

So the baseline of the lowest character is at least 48 inches above the floor and the baseline of the highest character is no more than 60 inches above the floor? \* [703.4.1]

Note: If the sign is at double doors with one active leaf, the sign should be on the inactive leaf; if both leaves are active, the sign should be on the wall to the right of the right leaf.


NA

Measurement:

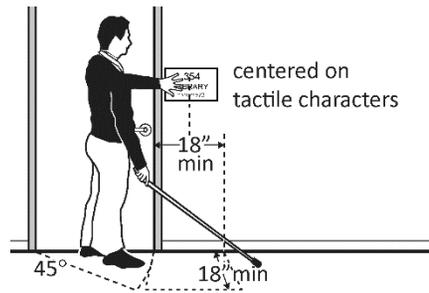



NA



Measurement:

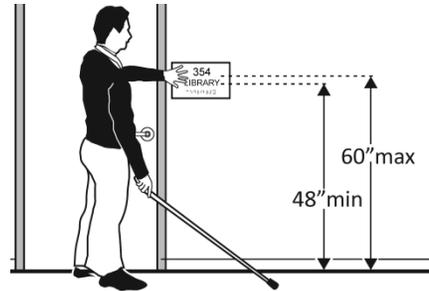

\*If constructed before 3/15/2012 and a person may approach within 3 inches of the sign without encountering protruding objects or standing within the door swing, relocation not required

\*If constructed before 3/15/2012 and mounted no higher than 60 inches to the centerline of the sign, relocation not required
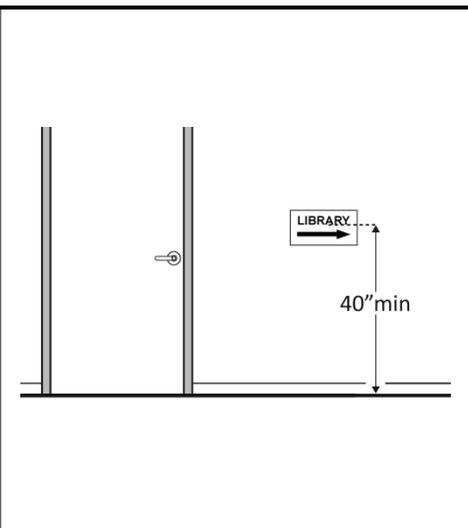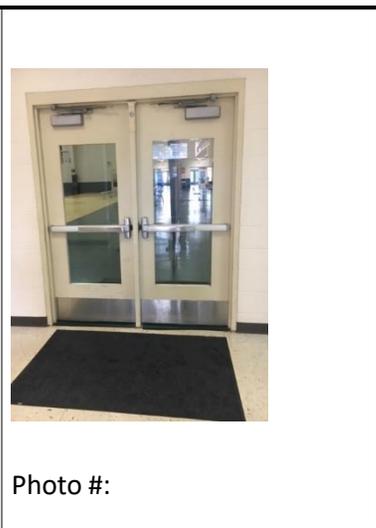
<p><b>2.39</b> If there are signs that provide direction to or information about interior spaces:</p> <p>Do text characters contrast with their backgrounds? [703.5.1]</p> <p>Is the sign mounted so that characters are at least 40 inches above the floor? [703.5.6]</p> <p>Note: Raised characters and Braille are not required.</p>	<p>No signs</p> <p>NA</p> <p>NA</p> <p>Measurement:</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>• Install signs with contrasting characters</li> </ul> <p>Budget Year: 2020</p> <p>Cost: \$100</p>
---	---	---	--	---

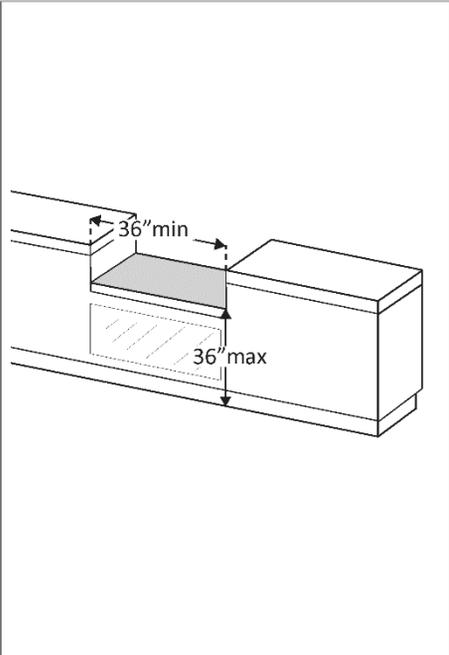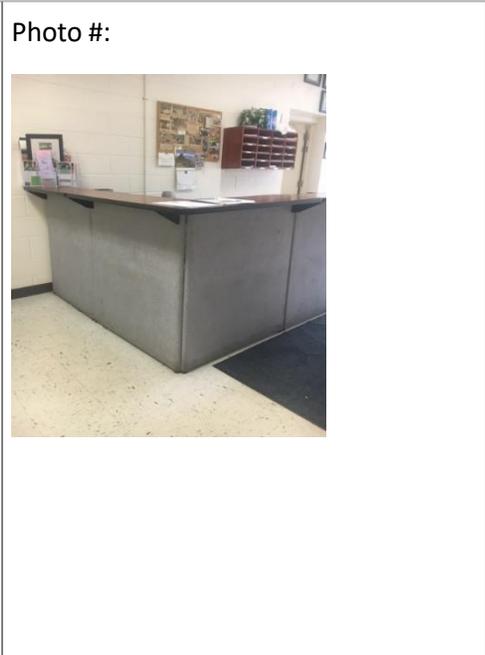Sales & Service Counters – Reception				
<p><b>2.76</b> Is there a portion of at least one of each type of counter that is:</p> <p>No higher than 36 inches above the floor?</p> <p>At least 36 inches long? [904.4.1]</p>	<p>No</p> <p>Measurement:</p> <p>No</p> <p>Measurement:</p>		<p>Photo #:</p> 	<ul style="list-style-type: none"> <li>• Lower section of counter</li> <li>• Lengthen section of counter</li> <li>• Replace counter</li> </ul> <p>Budget Year: 2023</p> <p>Cost: \$1,000</p>

**Priority 3 – Toilet Rooms  
Mens/Womens**

**Comments**

**Possible Solutions**

**3.1** If toilet rooms are available to the public, is at least one toilet room accessible?  
(Either one for each sex, or one unisex.)

Yes

Yes

Note: If toilet rooms are chiefly for children, e.g., in elementary schools and day care centers, use the children’s specifications in Toilets - 604.1, 604.8, 604.9, 609.4 and Lavatories and Sinks – 606.2.

Photo #:

**Accessible Route**

**3.4** Is there an accessible route to the accessible toilet room?  
[206.2.4]

Yes

Photo #:

- 
- 
-

## Signs at Toilet Rooms

**3.5** Do text characters contrast with their backgrounds? [703.5]

Are text characters raised? [703.2]

Is there Braille? [703.3]

Is the sign mounted:  
On the wall on the latch side of the door? [703.4.2]

Note: Signs are permitted on the push side of doors with closers and without hold-open devices.

With clear floor space beyond the arc of the door swing between the closed position and 45-degree open position, at least 18 x 18 inches centered on the tactile characters? \* [703.4.2]

Is the baseline of the lowest character is at least 48 inches above the floor and the baseline of the highest character is no more than 60 inches above the floor? \*

Yes

Yes

No

No

NA

NA

Doors swing in

Measurement:

NA

Measurement:


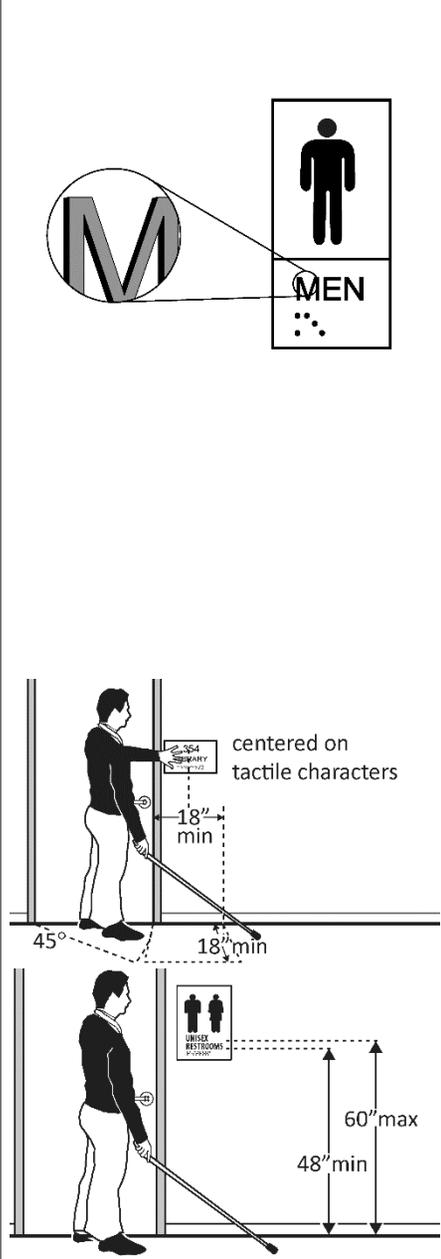


Photo : Men's Toilet Women's Toilet is similar

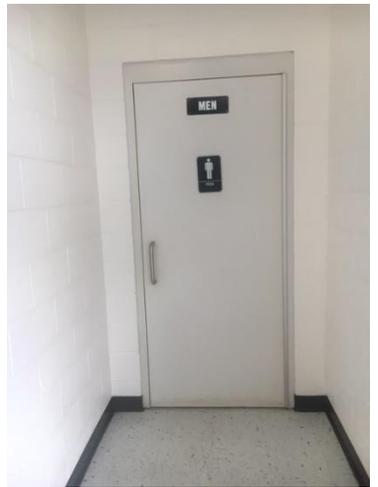



- Install tactile sign
  - Relocate sign
- Budget Year: 2020
- Cost: \$100


\*If constructed before 3/15/2012 and a person may approach within 3 inches of the sign without encountering protruding objects or standing within the door swing, relocation not required




<p>[703.4.1]</p> <p>Note: If the sign is at double doors with one active leaf, the sign should be on the inactive leaf; if both leaves are active, the sign should be on the wall to the right of the right leaf.</p>			<p>Photo #:</p>	<p>*If constructed before 3/15/2012 and mounted no higher than 60 inches to the centerline of the sign, relocation is not required</p>
---	--	--	-----------------	--


**Entrance**
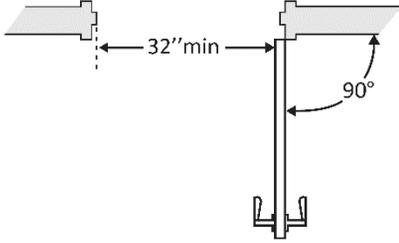
<p><b>3.6</b> Is the door opening width at least 32 inches clear, between the face of the door and the stop, when the door is open 90 degrees? [404.2.3]</p>	<p>Men/Women Yes Measurement:  34"</p>		 <p>Photo #:</p>	
--	--	--	---	--


<p><b>3.7</b> If there is a front approach to the pull side of the door is there at least 18 inches of maneuvering clearance beyond the latch side plus 60 inches clear depth?  Note: See 2010 Standards 404.2.4 for maneuvering clearance requirements on the push side of the door and side approaches to the pull side of the door</p>	<p>No Measurement: 10 Inches</p>		<p>Photo : Men's Toilet Women's is similar</p>	<ul style="list-style-type: none"> <li>• Add automatic door opener</li> </ul> <p>Budget Year: 2025 Cost: \$3,000</p>
---	--	--	--	--
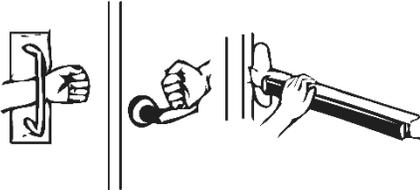
<p>On both sides of the door, is the floor surface of the maneuvering clearance level (no steeper than 1:48)? [404.2.4]</p>	<p>Yes Measurement:</p>			
<p><b>3.9</b> Is the door equipped with hardware that is operable with one hand and does not require tight grasping, pinching or twisting of the wrist? Door handle? Lock (if provided)? [404.2.7]</p>	<p>Yes  Yes  NA</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>•</li> <li>•</li> <li>•</li> </ul>
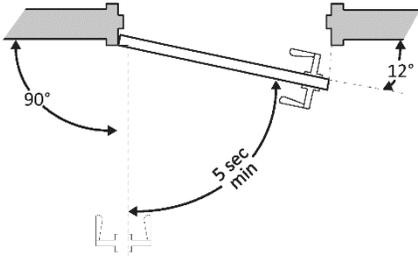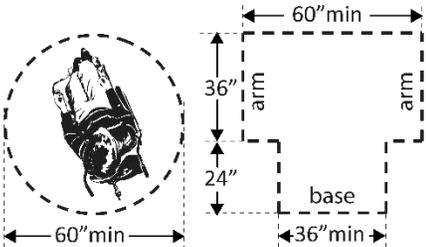
<p><b>3.11</b> Can the door be opened easily (5 pounds maximum force)? [404.2.9]</p> <p>Note: You can use a pressure gauge or fish scale to measure force. If you do not have one you will need to judge whether the door is easy to open.</p>	<p>Yes</p> <p>Measurement:</p>		<p>Photo #:</p>	
<p><b>3.12</b> If the door has a closer, does it take at least 5 seconds to close from an open position of 90 degrees to a position of 12 degrees from the latch? [404.2.8.1]</p>	<p>No</p> <p>Measurement:</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> <li>• Adjust closer</li> <li>• Replace closer</li> </ul> <p>Budget Year: 2020</p> <p>Cost: \$0</p>
<p><b>3.16</b> Is there a clear path to at least one of each type of fixture, e.g. lavatory, hand dryer, etc., that is at least 36 inches wide? [403.5.1]</p>	<p>Yes</p> <p>Measurement:</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> <li>•</li> <li>•</li> <li>•</li> </ul>
<p><b>3.17</b> Is there clear floor space available for a person in a wheelchair to turn around, i.e. a circle at least 60 inches in diameter or a T-shaped space within a 60-inch square? [603.2.1]</p>	<p>Men/Women Yes</p> <p>Measurement:</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> <li>•</li> <li>•</li> <li>•</li> </ul>
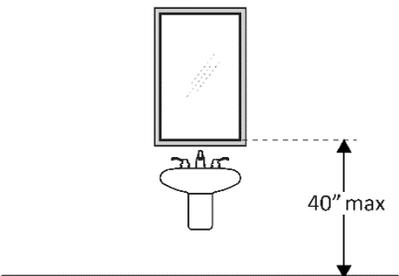
<p><b>3.19</b> If the mirror is over a lavatory or countertop, is the bottom edge of the reflecting surface no higher than 40 inches above the floor?</p> <p>Or</p> <p>If the mirror is not over the lavatory or countertop, is the bottom edge of the reflecting surface no higher than 35 inches above the floor?*</p> <p>[603.3]</p>	<p>Men/Women Yes</p> <p>Measurement: 40"</p> <p>NA</p> <p>Measurement:</p>		 <p>Photo #:</p>	<p>* If installed before 3/15/2012 and the bottom edge of the reflecting surface is no higher than 40 inches above the floor, lowering the mirror to 35 inches is not required</p> <ul style="list-style-type: none"> <li>•</li> <li>•</li> <li>•</li> </ul>

**Lavatories** The 2010 Standards refer to sinks in toilet rooms as lavatories.
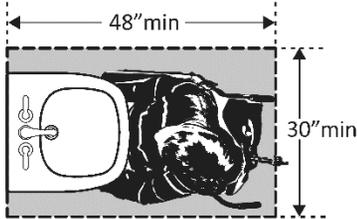
<p><b>3.21</b> Does at least one lavatory have a clear floor space for a forward approach at least 30 inches wide and 48 inches long?</p> <p>[606.2]</p>	<p>Rec Center Men/Women Yes</p> <p>Measurement:</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>•</li> <li>•</li> <li>•</li> </ul>
--	---	--	--	---

**3.23** Is the front of the lavatory or counter surface, whichever is higher, no more than 34 inches above the floor?  
[606.3]

Rec Center  
Men/Women  
Yes  
Measurement:  
31"

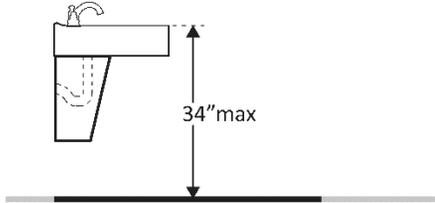


Photo #:

- 
- 
- 

**3.25** Is there toe clearance at least 9 inches high?  
[306.3.3]

Note: Space extending greater than 6 inches beyond the available toe clearance at 9 inches above the floor is not considered toe clearance.

Men/Women  
Yes

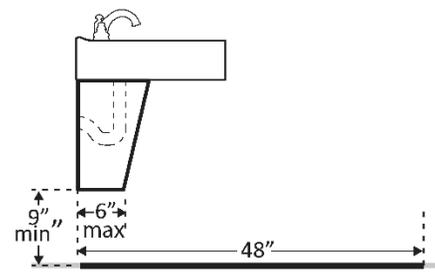




Photo #:

- 
- 
-

<p><b>3.26</b> Are pipes below the lavatory insulated or otherwise configured to protect against contact? [606.5]</p>	<p>Yes</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>•</li> <li>•</li> <li>•</li> </ul>
<p><b>3.27</b> Can the faucet be operated without tight grasping, pinching, or twisting of the wrist?  Is the force required to activate the faucet no greater than 5 pounds? [606.4]</p>	<p>Yes</p> <p>Yes</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>•</li> <li>•</li> <li>•</li> </ul>

## Soap Dispensers and Hand Dryers

**3.28** Are the operable parts of the soap dispenser within one of the following reach ranges:

Above lavatories or counters no less than 20 inches and no greater than 25 inches deep: no higher than 44 inches above the floor? [308.2.2]

Above lavatories less than 20 inches deep: no higher than 48 inches above the floor?

Not over an obstruction: no higher than 48 inches above the floor? [308.2]

Yes  
Measurement:  
36"

NA  
Measurement:

Men/Women  
NA  
Measurement:

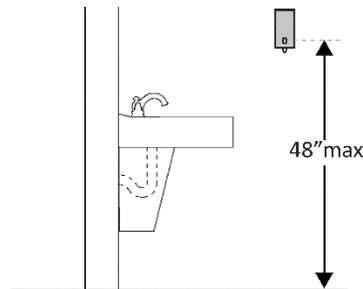
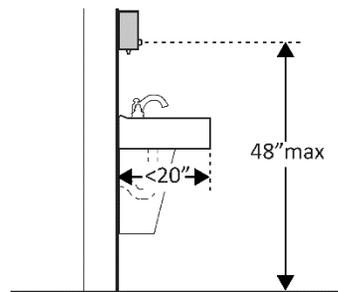
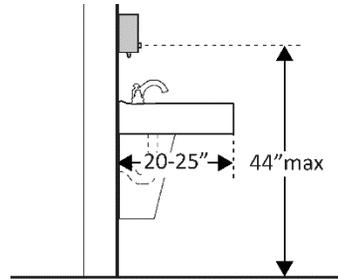


Photo #:

- 
- 
-

**3.29** Are the operable parts of the hand dryer or towel dispenser within one of the following reach ranges:

Above lavatories or counters no less than 20 inches and no greater than 25 inches deep: no higher than 44 inches above the floor?

Above lavatories less than 20 inches deep: no higher than 48 inches above the floor?

Not over an obstruction: no higher than 48 inches above the floor?  
[308.2]

Can the operable parts of the hand dryer or towel dispenser be operated without tight grasping, pinching or twisting of the wrist?

Is the force required to activate the hand dryer or towel dispenser no greater than 5 pounds?  
[309.4]

NA

Measurement:

NA

Measurement:

Yes

Measurement:  
40 inches

Men/Women

Yes

Yes

Measurement:

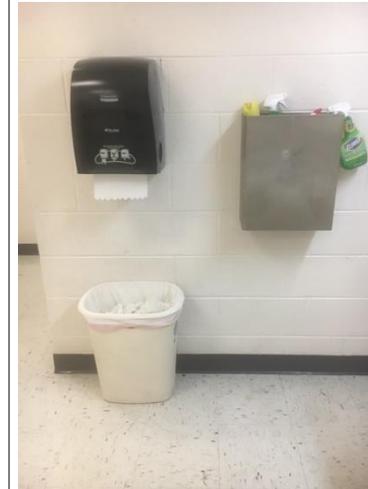
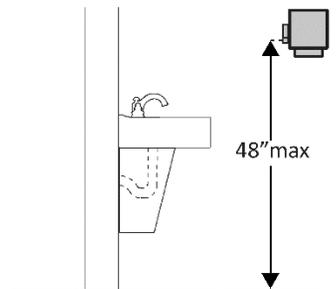
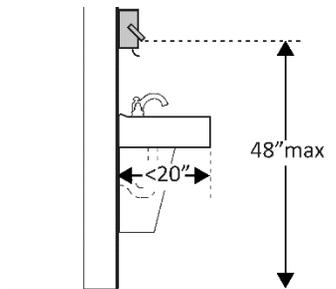
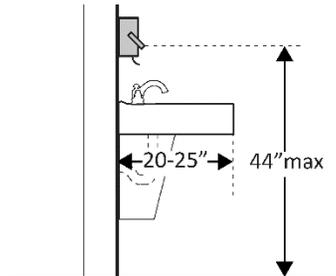


Photo #:

- Replace with or provide additional accessible dispensers

Budget Year: 2020

Cost: \$240

**Water Closets in Single-User Toilet Rooms and Compartments (Stalls)** The 2010 Standards refer to toilets as water closets.

**3.30** Is the centerline of the water closet no less than 16 inches and no greater than 18 inches from the side wall or partition?  
[604.2]

Yes  
Measurement:

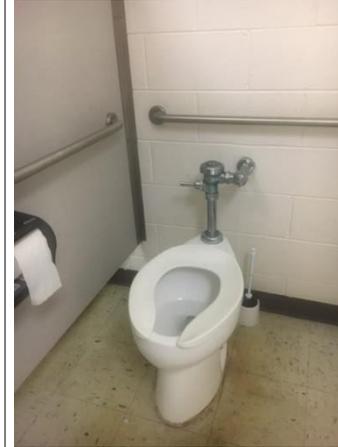



Photo #:

- 
- 

**3.31** Is clearance provided around the water closet measuring at least 60 inches from the side wall and at least 56 inches from the rear wall?\*

Yes  
Measurement:  
60"x60"


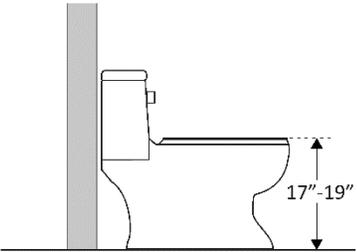
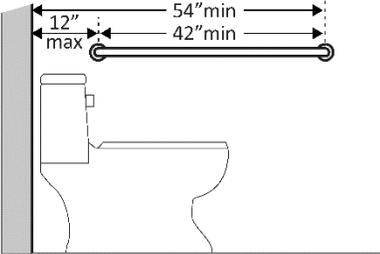
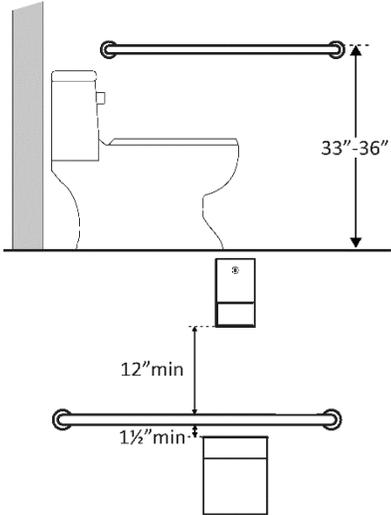
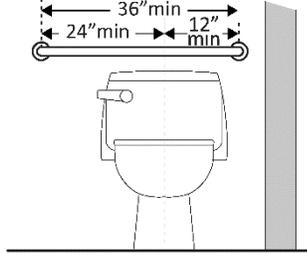
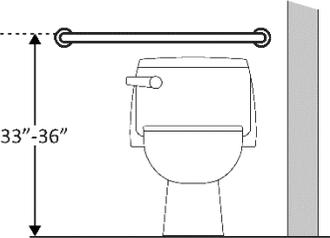
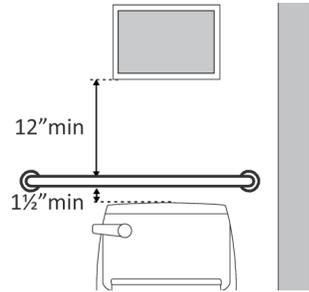




Photo #:



\* If constructed before 3/15/12, clearances around water closets in single user toilet rooms can be 48 inches wide by 66 inches long or 48 inches wide by 56 inches long (depending on the approach to the water closet, see 1991 Standards Figure 28) and the lavatory may overlap that clearance if the door to the room does not swing into the required clearances at fixtures



				<p>(such as lavatories, water closet and urinals) and the edge of the lavatory is at least 18 inches from the centerline of the water closet</p> <ul style="list-style-type: none"> <li>•</li> <li>•</li> <li>•</li> </ul>
<p><b>3.32</b> Is the height of the water closet no less than 17 inches and no greater than 19 inches above the floor measured to the top of the seat? [604.4]</p>	<p>Men/Women Yes  Measurement:</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>•</li> <li>•</li> <li>•</li> </ul>
<p><b>3.33</b> Is there a grab bar at least 42 inches long on the side wall?</p> <p>Is it located no more than 12 inches from the rear wall?</p>	<p>Yes Measurement: 42"</p> <p>Yes Measurement:</p>			<ul style="list-style-type: none"> <li>• Relocate grab bar</li> </ul> <p>Budget Year: 2021</p> <p>Cost: \$0</p>

<p>Does it extend at least 54 inches from the rear wall? [604.5.1]</p> <p>Is it mounted no less than 33 inches and no greater than 36 inches above the floor to the top of the gripping surface? [609.4]</p> <p>Is there at least 12 inches clearance between the grab bar and protruding objects above?*</p> <p>Is there at least 1½ inches clearance between the grab bar and projecting objects below?*</p> <p>Is the space between the wall and the grab bar 1 ½ inches? [609.3]</p>	<p>6 ½"</p> <p>No Measurement: 48"</p> <p>No Measurement: 36 ½"</p> <p>NA Measurement:</p> <p>Yes Measurement: 3"</p> <p>Yes Measurement: 2"</p>		 <p>Photo #:</p>	<p>* If constructed before 3/15/2012 grab bars do not need to be relocated; there are no space requirements above and below grab bars in the 1991 Standards</p>
<p><b>3.34</b> Is there a grab bar at least 36 inches long on the rear wall?</p> <p>Does it extend at least 12 inches from the centerline</p>	<p>Yes Measurement: 36"</p> <p>No Measurement:</p>			

<p>of the water closet on one side (side wall)?</p> <p>Does it extend at least 24 inches on the other (open) side? [604.5.2]</p> <p>Is it mounted no less than 33 inches and no greater than 36 inches above the floor to the top of the gripping surface? [609.4]</p> <p>Are there at least 12 inches clearance between the grab bar and protruding objects above?*</p> <p>Are there at least 1½ inches clearance between the grab bar and projecting objects below?*</p> <p>Is the space between the wall and the grab bar 1½ inches? [609.3]</p>	<p>6"</p> <p>No Measurement: No Measurement: 36 ½:</p> <p>NA Measurement:</p> <p>Yes Measurement:</p> <p>Yes Measurement:</p>	 	 <p>Photo #:</p>	<p>* If constructed before 3/15/2012 grab bars do not need to be relocated; there are no space requirements above and below grab bars in the 1991 Standards</p>
---	---	---	---	---
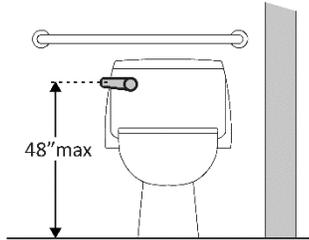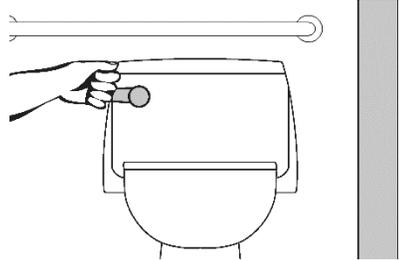
<p><b>3.35</b> If the flush control is hand operated, is the operable part located no higher than 48 inches above the floor? [604.6]</p>	<p>Yes Measurement:</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>•</li> </ul>
<p><b>3.36</b> If the flush control is hand operated, can it be operated with one hand and without tight grasping, pinching, or twisting of the wrist?  Is the force required to activate the flush control no greater than 5 pounds? [605.4]</p>	<p>Yes  Yes Measurement:</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> <li>•</li> <li>•</li> </ul>
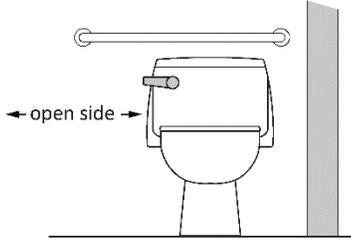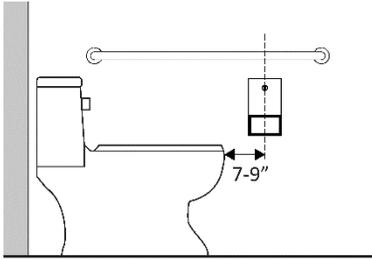
<p><b>3.37</b> Is the flush control on the open side of the water closet? [604.6]</p>	<p>Men No</p> <p>Women Yes</p>		 <p>Photo #: Men</p>	<ul style="list-style-type: none"> <li>• Replace control Men's toilet</li> </ul> <p>Budget Year: 2020</p> <p>Cost: \$100</p>
<p><b>3.38</b> Is the toilet paper dispenser located no less than 7 inches and no greater than 9 inches from the front of the water closet to the centerline of the dispenser?*</p> <p>[604.7]</p>	<p>Yes</p> <p>Measurement: 7"</p>		 <p>Photo #:</p>	<p>* If constructed before 3/15/2012 dispenser does not need to be relocated if it is within reach from the water closet seat; the 1991 Standards do not specify distance from the front of the water closet</p>
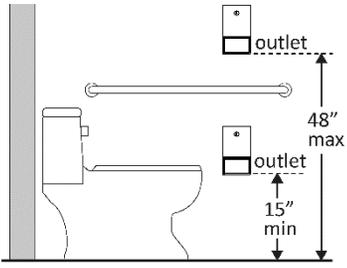
<p><b>3.39</b> Is the outlet of the dispenser:</p> <p>Located no less than 15 inches and no greater than 48 inches above the floor?</p> <p>Not located behind grab bars? [604.7]</p>	<p>Men/Women</p> <p>Yes</p> <p>Measurement:</p> <p>Yes</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>•</li> <li>•</li> </ul>
<p><b>3.40</b> Does the dispenser allow continuous paper flow? [604.7]</p>	<p>Men/Women</p> <p>Yes</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>•</li> <li>•</li> <li>•</li> </ul>

## Toilet Compartments (Stalls)

**3.41** Is the door opening width at least 32 inches clear, between the face of the door and the stop, when the door is open 90 degrees?  
[604.8.1.2]

Men/Women  
Yes

Measurement:

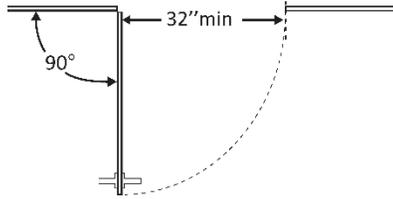


Photo #:

- 
- 
- 

**3.42** If there is a front approach to the pull side of the door, is there at least 18 inches of maneuvering clearance beyond the latch side plus 60 inches clear depth?  
[604.8.1.2]

Men/Women  
Yes

Measurement:

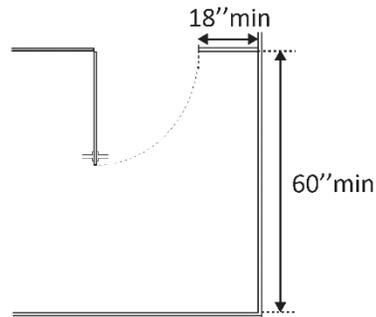
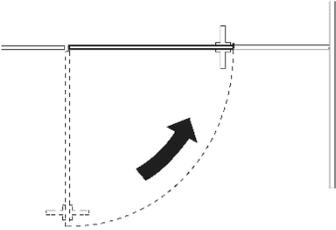


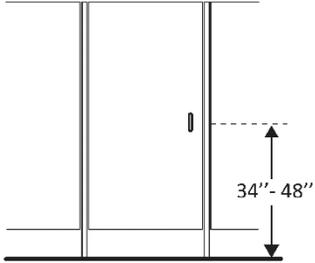





Photo #:

- 
- 
- 



Note: See 2010 Standards 604.8.1.2 Doors for maneuvering clearance requirements on the push side of the door and side approaches to the pull side of the door





<p><b>3.43</b> Is the door self-closing? [604.8.1.2]</p>	<p>Men/Women No</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> <li>• Add self closer</li> </ul> <p>Budget Year: 2020</p> <p>Cost: \$50</p>
<p><b>3.44</b> Are there door pulls on both sides of the door that are operable with one hand and do not require tight grasping pinching or twisting of the wrist?*[604.8.1.2]</p>	<p>Men/Women Yes</p>		 <p>Photo #:</p>	<p>* If constructed before 3/15/2012 door pulls do not need to be added; door pulls are not required in the 1991 Standards</p> <ul style="list-style-type: none"> <li>•</li> <li>•</li> <li>•</li> </ul>
<p><b>3.45</b> Is the lock operable with one hand and without tight grasping, pinching or twisting of the wrist? [309.4]</p>	<p>Men/Women Yes</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>•</li> <li>•</li> <li>•</li> </ul>




<p><b>3.46</b> Are the operable parts of the door hardware mounted no less than 34 inches and no greater than 48 inches above the floor? [404.2.7]</p>	<p>Men/Women Yes  Measurement: 36 ½"</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>•</li> <li>•</li> <li>•</li> </ul>
<p><b>3.47</b> Is the compartment at least 60 inches wide? [604.8.1.1]</p>	<p>Men/Women Yes  Measurement: 60"</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> <li>•</li> <li>•</li> <li>•</li> </ul>
<p><b>3.49</b> If the water closet is floor mounted, is the compartment at least 59 inches deep? [604.8.1.1]</p>	<p>Men/Women Yes  Measurement: 60"</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> <li>•</li> <li>•</li> <li>•</li> </ul>


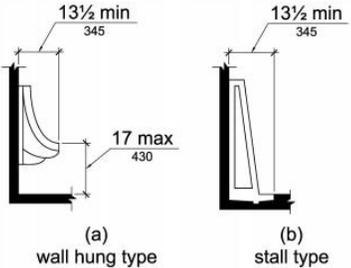
<p><b>3.51</b> Is the rim 17 inches maximum above the finished floor. Is the urinal 13 ½ inches deep minimum measured from the outer face of the urinal rim to the back of the fixture [605.2]</p>	<p>Yes Measurement:</p>	 <p>(a) wall hung type (b) stall type</p>	 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>• Adjust urinal height</li> <li>• Replace urinal</li> <li>•</li> </ul> <p>Budget Year: 2020 Cost: \$75</p>
--	-----------------------------	---	---	---

**Drinking Fountains**
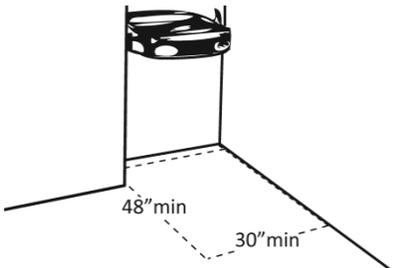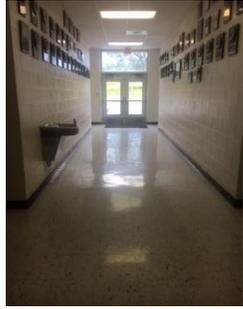
<p><b>4.1</b> Does at least one drinking fountain have a clear floor space at least 30 inches wide x at least 48 inches long centered in front of it for a forward approach?*[See 2010 ADA Standards for Accessible Design – 602.2]</p>	<p>Yes Measurement: Installed before 3/15/12</p>		 <p>Photo #:</p>	<p>*If installed before 3/15/2012, a parallel approach is permitted and the clear floor space is not required to be centered</p>
---	--	---	--	--
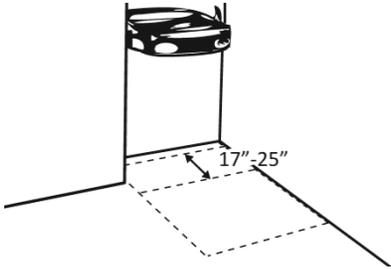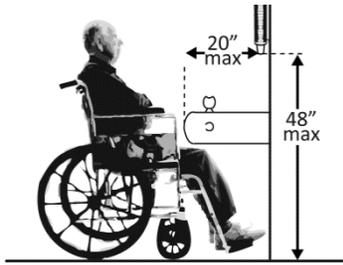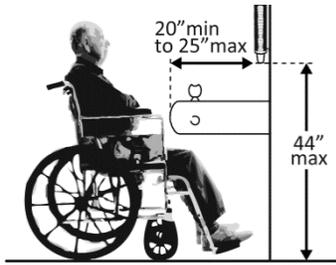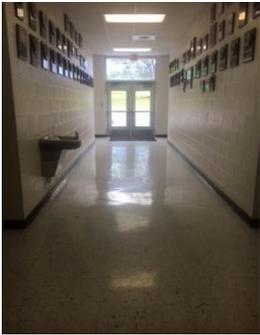
<p><b>4.2</b> If there is a forward approach, do no less than 17 inches and no greater than 25 inches of the clear floor space extend under the drinking fountain? [306.2.2, 306.2.3]</p> <p>Note: If the drinking fountain is primarily for children's use and the spout is no more than 30 inches above the floor and no more than 3 ½ inches from the edge of the unit, a parallel approach is permitted.</p>	<p>Yes</p> <p>Measurement:</p>		<p>Photo #:</p>	
<p><b>4.3</b> If the drinking fountain is no deeper than 20 inches, are the operable parts no higher than 48 inches above the floor? [308.2.2]</p>	<p>NA</p> <p>Measurement:</p>		<p>Photo #:</p>	
<p><b>4.4</b> If the drinking fountain is no less than 20 inches and no greater than 25 inches deep, are the operable parts no higher than 44 inches above the floor? [308.2.2]</p>	<p>Yes</p> <p>Measurement:</p>		 <p>Photo #:</p>	
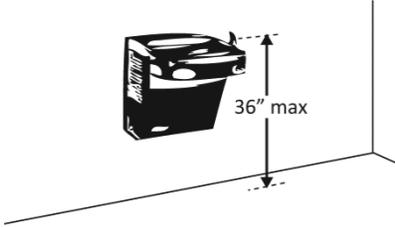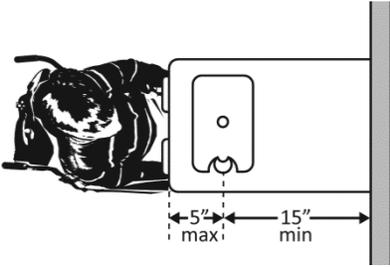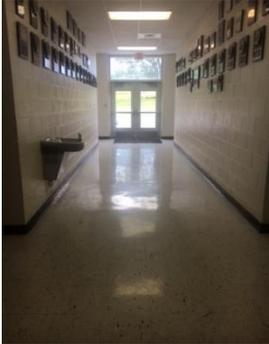
<p><b>4.5</b> Can the control be operated with one hand and without tight grasping, pinching or twisting of the wrist?</p> <p>Is the force required to activate the control no more than 5 pounds? [309.4]</p>	<p>Yes</p> <p>Yes</p> <p>Measurement:</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> <li>•</li> <li>•</li> <li>•</li> </ul>
<p><b>4.6</b> Is the spout outlet no higher than 36 inches above the floor? [602.4]</p>	<p>No</p> <p>Measurement:</p> <p>37"</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> <li>• Adjust drinking fountain</li> <li>• Replace drinking fountain</li> </ul> <p>Budget Year: 2029</p> <p>Cost: \$500</p>
<p><b>4.7</b> Is the spout:</p> <p>At least 15 inches from the rear of the drinking fountain?</p> <p>No more than 5 inches from the front of the drinking fountain? [602.5]</p>	<p>Yes</p> <p>Measurement:</p> <p>Yes</p> <p>Measurement:</p>		 <p>Photo #:</p>	
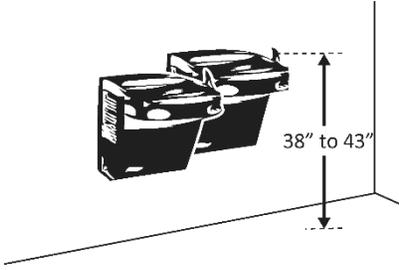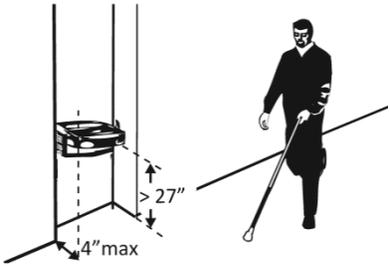
<p><b>4.8</b> If there is more than one drinking fountain, is there at least one for standing persons? [211.2]</p> <p>Is the spout outlet no lower than 38 inches and no higher than 43 inches above the floor? [602.7]</p>	<p>No</p> <p>NA</p> <p>Measurement:</p>		 <p>Photo #:</p>	<p>Budget Year: 2029</p> <p>Cost: \$500</p>
<p><b>4.9</b> If the leading (bottom) edge of the fountain is higher than 27 inches above the floor, does the front of the fountain protrude no more than 4 inches into the circulation path? [307.2]</p>	<p>Yes</p> <p>Measurement:</p> <p>31"</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> <li>• Adjust drinking fountain</li> <li>• Replace drinking fountain</li> <li>• Add tactile warning such a cane skirt</li> </ul> <p>Budget Year: 2020</p> <p>Cost: \$100</p>
<p><b>S1</b> Is there an accessible route to each type of sport activity?</p> <p>For exterior routes use the checklist for <i>Priority 1: Approach &amp; Entrance</i>.</p> <p>For interior routes use the checklist for <i>Priority 2: Access to Goods &amp; Services</i>.</p>	<p>Yes</p>		<p>Photo #:</p>	

