

**Sports Complex**

**1435 Hal Henard Road**

**Town Administrator Todd Smith**

**Assessment October 23, 2018**



## **LOCATION SUMMARY**

This facility includes two multi-purpose fields, restrooms, concession area, and a covered pavilion with picnic tables. Greeneville Parks & Recreation adult softball games are played at the complex. The local chapter of Special Olympics also utilizes the facility during the year for some of their sporting events.

### **Responsible for Sports Complex ADA Transition Plan Section**

Director Butch Patterson – 423-638-3143 / [bpatterson@greenevilletn.gov](mailto:bpatterson@greenevilletn.gov)

Office Manager / Program Supervisor Lisa Scott Fisher – 423-638-3143 / [lfisher@greenevilletn.gov](mailto:lfisher@greenevilletn.gov)

Maintenance Supervisor John Darnell – 423-823-0720 / [jdarnell@greenevilletn.gov](mailto:jdarnell@greenevilletn.gov)

---

## ADA Checklist for Existing Facilities

---

# Priority 1 – Approach & Entrance

Based on the 2010 ADA Standards for Accessible Design



**Project:** Greeneville ADA Assessment

---

**Building:** Greeneville Sports Complex

---

**Location:** Greene County Sports Complex

---

**Date:** Nov. 29, 2018

---

**Surveyors:** Dave Wright, Gail Stacy, Caroline Miller

---

**Contact Information:** 423-525-5093

---

---

---

**An accessible route from site arrival points and an accessible entrance should be provided for everyone.**

---

## Priority 1 – Approach & Entrance

## Comments

## Possible Solutions

**1.1** Is there at least one route from site arrival points (parking, passenger loading zones, public sidewalks and public transportation stops) that does not require the use of stairs? [See 2010 ADA Standards for Accessible Design – 206.2.1]

Yes

If yes, location of route:



Photo #:

**Parking** Accessible parking spaces should be identified by size, access aisle and signage.

**1.2** If parking is provided for the public, are an adequate number of accessible spaces provided? [208.2]

NA

Total #:

Accessible #:  
6 provided

### Total Spaces

### Accessible Spaces

1 - 25

1

26 - 50

2

51 - 75

3

76 - 100

4

100+ see 2010 Standards 208.2



Photo #:

- Reconfigure by repainting lines

\$200.00

2020

**1.3** Of the accessible spaces, is at least one a van accessible space?\*[208.2.4]



Yes



\*For every 6 or fraction of 6 parking spaces required by the table above, at least 1 should be a van accessible space.



Photo #:

\* If constructed before 3/15/2012, parking is compliant if at least 1 in every 8 accessible spaces is van accessible
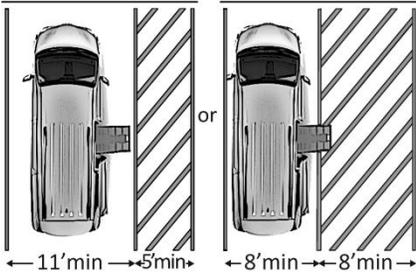
<p><b>1.4</b> Are accessible spaces at least 8 feet wide with an access aisle at least 5 feet wide? [502.2, 502.3]</p> <p>Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.</p>	<p>No</p> <p>Measurement: No aisles between spaces</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>Reconfigure by repainting lines</li> </ul> <p>\$200.00</p> <p>2020</p>
<p><b>1.5</b> Is the van accessible space: At least 11 feet wide with an access aisle at least 5 feet wide? Or At least 8 feet wide with an access aisle at least 8 feet wide? [502.2]</p>	<p>No</p> <p>Measurement: Space 10'-0" Aisle 5'-0"</p> <p>NA</p> <p>Measurement:</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> <li>Reconfigure to provide van-accessible space(s)</li> </ul> <p>\$100.00</p> <p>2020</p>
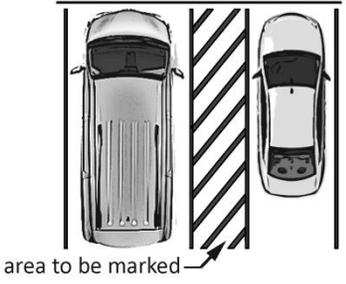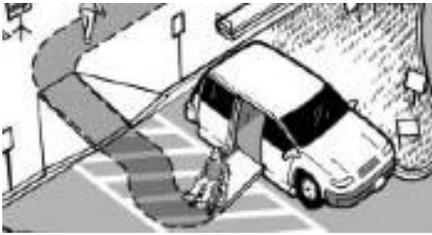
<p><b>1.7</b> Are the access aisles marked so as to discourage parking in them? [502.3.3]</p> <p>Note: The marking method and color may be addressed by state/local requirements.</p>	<p>Only one access aisle is provided</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>• Reconfigure to add access aisles</li> </ul> <p>\$100.00</p> <p>2020</p>
<p><b>1.8</b> Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]</p>	<p>Yes</p> <p>Measurement: 1:48</p>		<p>Photo #:</p>	
<p><b>1.9</b> Do the access aisles adjoin an accessible route? [502.3]</p>	<p>Yes</p>		 <p>Photo #:</p>	



**1.13** Is the route stable, firm and slip-resistant?  
[302.1]

No



- Repair uneven paving
- Fill small bumps and breaks with patches

\$200.00


2020

Photo #:

**1.14** Is the route at least 36 inches wide?  
[403.5.1]

Yes

Measurement:  
5'-0"  
4'-0" around  
concession/toilet  
building

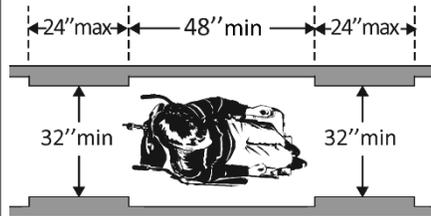

Note: The accessible route can narrow to 32 inches min. for a max. of 24 inches. These narrower portions of the route must be at least 48 inches from each other.



Photo #:

**1.17** Is the running slope no steeper than 1:20, i.e. for every inch of height change there are at least 20 inches of route run? [403.3]

Note: If the running slope is steeper than 1:20, treat as a ramp and add features such as edge protection and handrails.

Yes  
Measurement:

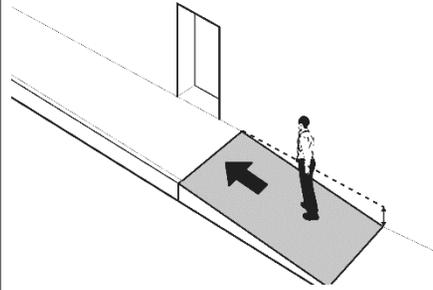


Photo #:

**1.18** Is the cross slope no steeper than 1:48? [403.3]

Yes  
Measurement:

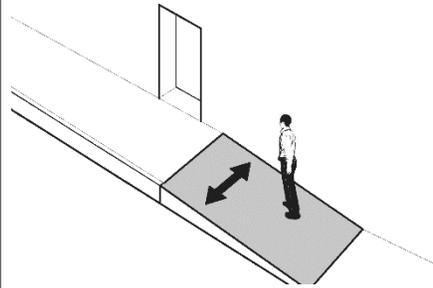


Photo #:

**Entrance**

**1.37** Is the main entrance accessible?

Yes

Photo #:

**Controls – light switches, security and intercom systems, emergency/alarm boxes, etc.**

**2.50** Is there a clear floor space at least 30 inches wide by at least 48 inches long for a forward or parallel approach? [305.3]

Yes

Measurement:

No

Measurement:  
53 inches

Are the operable parts no higher than 48 inches above the floor?\*[309.3, 308]

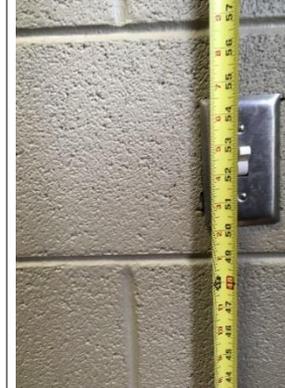
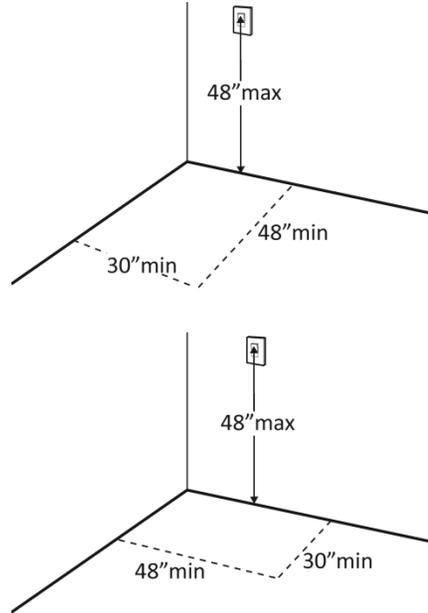


Photo #:

- Change height of control
- 
- 

\*If constructed before 3/15/2012 and a parallel approach is provided, controls can be 54 inches above the floor

**2.51** Can the control be operated with one hand and without tight grasping, pinching, or twisting of the wrist?  
[309.4]

Yes

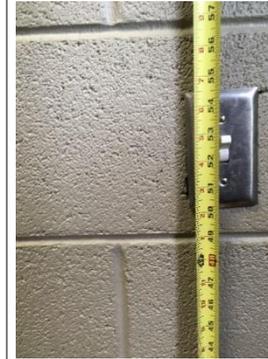



Photo #:

**Seating: Assembly Areas – theaters, auditoriums, stadiums, theater style classrooms, etc.**

**2.52** Are an adequate number of wheelchair spaces provided?  
[221.2.1]

No designated wheelchair spaces

Total #:

Wheelchair #:

# of Seats	Wheelchair Spaces
4 - 25	1
26 - 50	2
51 - 150	4
151 - 300	5

300+ see 2010 Standards 221.2.1.

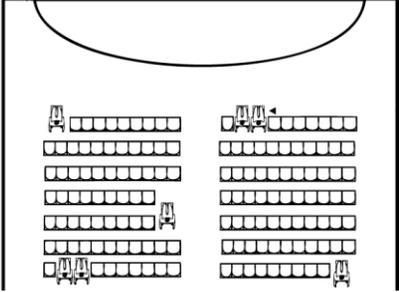


Photo #:

- Designate wheelchair spaces


\$50.00


2021

<p><b>2.53</b> Are wheelchair spaces dispersed to allow location choices and viewing angles equivalent to other seating, including specialty seating areas that provide distinct services and amenities? [221.2.3]</p>	<p>No</p>		<p>Photo #:</p>	
--	-----------	--	-----------------	--


**Seating: At dining surfaces (restaurants, cafeterias, bars, etc.) and non-employee work surfaces (libraries, conference rooms, etc.)**


<p><b>2.64</b> Are at least 5%, but no fewer than one, of seating and standing spaces accessible for people who use wheelchairs? [226.1]</p>	<p>Yes Total #: 4 Wheelchair #: 2</p>			<p>Photo #:</p>
--	---	--	--	-----------------
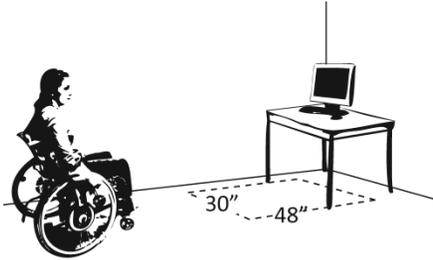
<p><b>2.65</b> Is there a route at least 36 inches wide to accessible seating? [403.5.1]</p>	<p>Yes Measurement:</p>		<p>Photo #:</p>	
<p><b>2.66</b> At the accessible space(s), is the top of the accessible surface no less than 28 inches and no greater than 34 inches above the floor? [902.3]</p> <p>Note: If for children, the top should be no less than 26 inches and no greater than 30 inches above the floor.</p>	<p>Yes Measurement:</p>		 <p>Photo #:</p>	
<p><b>2.67</b> Is there a clear floor space at least 30 inches wide by at least 48 inches long for a forward approach? [305.3]</p> <p>Does it extend no less than 17 inches and no greater than 25 inches under the surface?</p>	<p>Yes Measurement:</p> <p>Yes Measurement:</p> <p>Yes Measurement:</p>		 <p>Photo #:</p>	
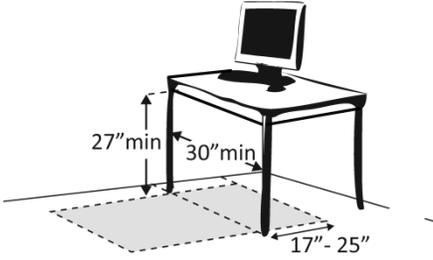
<p>Is there knee space at least 27 inches high and at least 30 inches wide? [306.2, 306.3]</p> <p>Note: If for children, the knee space may be 24 inches high.</p>			<p>Photo #:</p>	
--	--	--	-----------------	--

**Sales & Service Counters – banks, stores, dry cleaners, auto repair shops, fitness clubs, etc.**
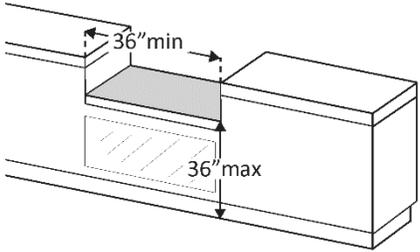
<p><b>2.76</b> Is there a portion of at least one of each type of counter that is:</p> <p>No higher than 36 inches above the floor?</p> <p>At least 36 inches long? [904.4.1]</p>	<p>No Measurement: 39 inches</p> <p>Yes Measurement:</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>• Lower section of counter</li> </ul> <p>\$400.00</p> <p>2022</p>
---	--	--	---	--
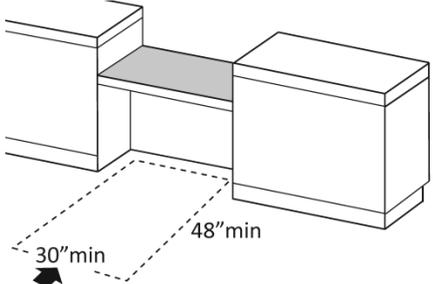
<p><b>2.78</b> Is there a clear floor space at least 30 inches wide by at least 48 inches long for a forward or parallel approach? [904.4]</p>	<p>Yes Parallel Measurement:</p>	 <p>Or</p>		
--	--	--	--	--

		<p>30"min 48"min</p>	Photo #:	
<p><b>2.79</b> For a parallel approach, is the clear floor space positioned with the 48 inches adjacent to the accessible length of counter? [904.4.1]</p>	<p>Yes</p> <p>Measurement:</p>	<p>48"min</p>	Photo #:	

Priority 3 – Toilet Rooms Women and Men toilets		Comments	Possible Solutions
<p><b>3.1</b> If toilet rooms are available to the public, is at least one toilet room accessible? (Either one for each sex, or one unisex.)</p> <p>Note: If toilet rooms are chiefly for children, e.g., in elementary schools and day care centers, use the children’s specifications in Toilets - 604.1, 604.8, 604.9,</p>	<p>Yes</p>		

609.4 and Lavatories and Sinks  
– 606.2.

Photo #:

### Accessible Route

3.4 Is there an accessible route to the accessible toilet room?  
[206.2.4]

Yes

Photo #:

### Signs at Toilet Rooms

3.5 Do text characters contrast with their backgrounds?  
[703.5]

Yes

Are text characters raised?  
[703.2]

Yes

Is there Braille?  
[703.3]


Yes

Is the sign mounted:  
On the wall on the latch side of the door?  
[703.4.2]

Yes

Note: Signs are permitted on the push side of doors with closers and without hold-open devices.

With clear floor space beyond

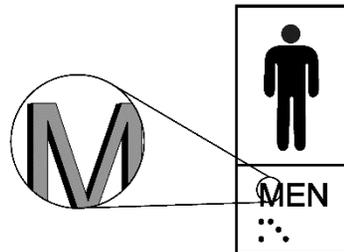

•Replace sign at Men's Toilet

\$100.00

2020

the arc of the door swing between the closed position and 45-degree open position, at least 18 x 18 inches centered on the tactile characters? \* [703.4.2]

So the baseline of the lowest character is at least 48 inches above the floor and the baseline of the highest character is no more than 60 inches above the floor? \* [703.4.1]

Note: If the sign is at double doors with one active leaf, the sign should be on the inactive leaf; if both leaves are active, the sign should be on the wall to the right of the right leaf.

No, but constructed before 2015

Measurement:

Yes

Measurement:

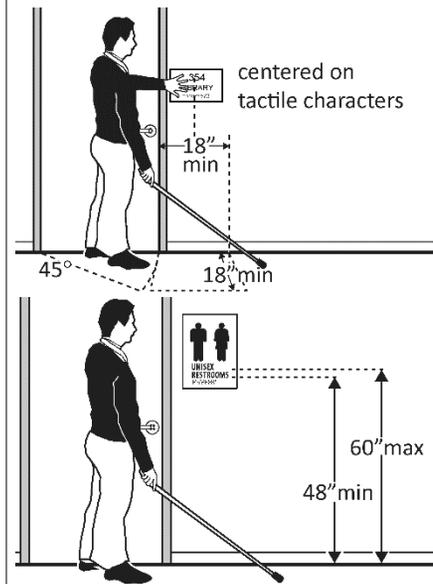
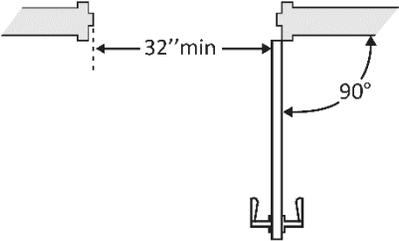



Photo #:

\*If constructed before 3/15/2012 and a person may approach within 3 inches of the sign without encountering protruding objects or standing within the door swing, relocation not required

\*If constructed before 3/15/2012 and mounted no higher than 60 inches to the centerline of the sign, relocation is not required

<p><b>3.6</b> Is the door opening width at least 32 inches clear, between the face of the door and the stop, when the door is open 90 degrees? [404.2.3]</p>	<p>Yes</p> <p>Measurement: 35 inches</p>		 <p>Photo #:</p>	
<p><b>3.7</b> If there is a front approach to the pull side of the door is there at least 18 inches of maneuvering clearance beyond the latch side plus 60 inches clear depth?  Note: See 2010 Standards 404.2.4 for maneuvering clearance requirements on the push side of the door and side approaches to the pull side of the door  On both sides of the door, is the floor surface of the maneuvering clearance level (no steeper than 1:48)? [404.2.4]</p>	<p>No</p> <p>Measurement: 14-1/2 inches</p> <p>Yes</p> <p>Measurement:</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>• Reconfigure walls</li> <li>• Add automatic door opener</li> </ul> <p>\$150.00</p> <p>2026</p>

**3.8** If the threshold is vertical is it no more than ¼ inch high?

Or

No more than ½ inch high with the top ¼ inch beveled no steeper than 1:2, if the threshold was installed on or after the 1991 ADA Standards went into effect (1/26/93)?

Or

No more than ¾ inch high with the top ½ inch beveled no steeper than 1:2, if the threshold was installed before the 1991 ADA Standards went into effect (1/26/93)? [404.2.5, 303.2]

Note: The first ¼ inch of the ½ or ¾ inch threshold may be vertical; the rest must be beveled.

NA -No threshold

Measurement:

NA

Measurement:

NA

Measurement:

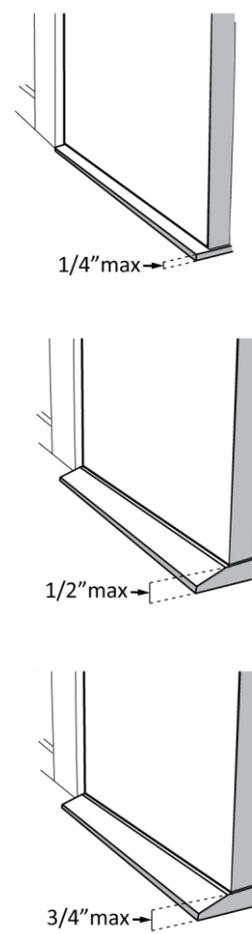
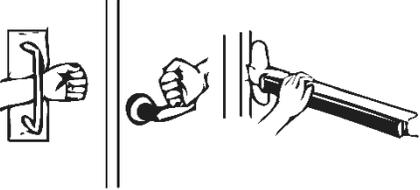
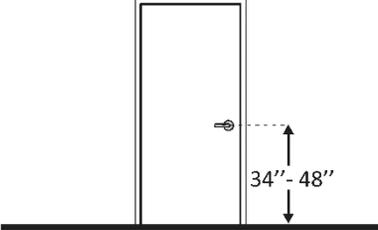




Photo #:

<p><b>3.9</b> Is the door equipped with hardware that is operable with one hand and does not require tight grasping, pinching or twisting of the wrist?</p> <p>Door handle?</p> <p>Lock (if provided)? [404.2.7]</p>	<p>Yes</p> <p>Yes</p> <p>No</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>• Replace lock</li> </ul> <p>\$50.00</p> <p>2020</p>
<p><b>3.10</b> Are the operable parts of the door hardware mounted no less than 34 inches and no greater than 48 inches above the floor? [404.2.7]</p>	<p>No</p> <p>Measurement: 56 inches</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>• Change hardware height</li> </ul> <p>\$1,000.00</p> <p>2020</p>
<p><b>3.11</b> Can the door be opened easily (5 pounds maximum force)? [404.2.9]</p> <p>Note: You can use a pressure gauge or fish scale to measure force. If you do not have one</p>	<p>Yes</p> <p>Measurement:</p>		<p>Photo #:</p>	




<p>you will need to judge whether the door is easy to open.</p>			<p>Photo #:</p>	
---	--	--	-----------------	--

**In the Toilet Room**

<p><b>3.16</b> Is there a clear path to at least one of each type of fixture, e.g. lavatory, hand dryer, etc., that is at least 36 inches wide? [403.5.1]</p>	<p>Yes  Measurement:</p>		<p>Photo #:</p>	
---	----------------------------------	--	-----------------	--
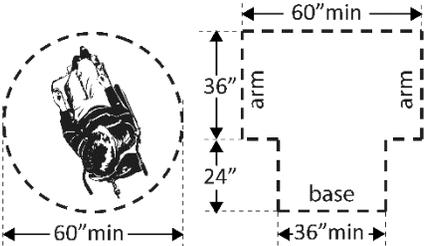
<p><b>3.17</b> Is there clear floor space available for a person in a wheelchair to turn around, i.e. a circle at least 60 inches in diameter or a T-shaped space within a 60-inch square? [603.2.1]</p>	<p>Yes  Measurement:</p>		<p>Photo #:</p>	
--	----------------------------------	---	-----------------	--

**Lavatories** The 2010 Standards refer to sinks in toilet rooms as lavatories.
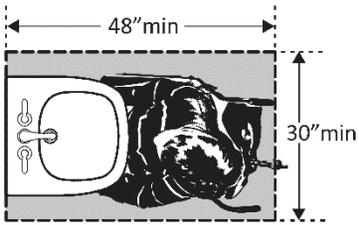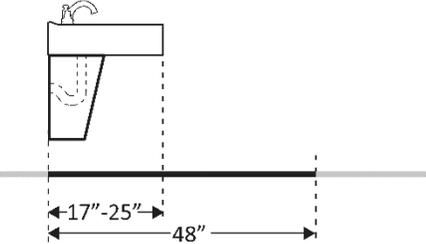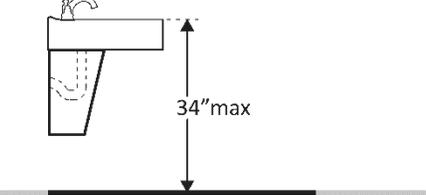
<p><b>3.21</b> Does at least one lavatory have a clear floor space for a forward approach at least 30 inches wide and 48 inches long? [606.2]</p>	<p>Yes Measurement:</p>	 <p>A top-down diagram of a lavatory. A dashed rectangle indicates a clear floor space that is 48 inches wide and 30 inches deep. The lavatory fixture, including the toilet and sink, is shown within this space.</p>	<p>Photo #:</p>	
<p><b>3.22</b> Do no less than 17 inches and no greater than 25 inches of the clear floor space extend under the lavatory so that a person using a wheelchair can get close enough to reach the faucet? [306.2]</p>	<p>Yes Measurement:</p>	 <p>A side-view diagram of a lavatory. A horizontal line represents the floor. A vertical dashed line shows the depth of the lavatory. A horizontal dimension line below the floor indicates that 17 to 25 inches of clear floor space must extend under the lavatory. A longer dimension line below the floor indicates a total clear floor space of 48 inches.</p>	<p>Photo #:</p>	
<p><b>3.23</b> Is the front of the lavatory or counter surface, whichever is higher, no more than 34 inches above the floor? [606.3]</p>	<p>Yes Measurement:</p>	 <p>A side-view diagram of a lavatory. A horizontal line represents the floor. A vertical dimension line shows the height from the floor to the top of the counter surface, labeled as 34 inches maximum.</p>	 <p>A photograph showing a person's hand holding a yellow tape measure vertically against the front edge of a white lavatory counter. The counter is set on a granite-colored vanity. The tape measure shows the height is approximately 34 inches.</p> <p>Photo #:</p>	

**3.24** Is there at least 27 inches clearance from the floor to the bottom of the lavatory that extends at least 8 inches under the lavatory for knee clearance?  
[306.3.3]

Yes  
Measurement:  
28 inches

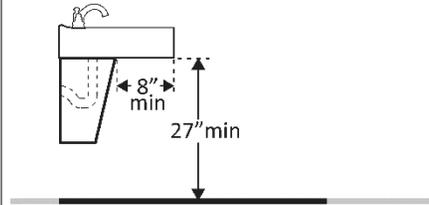


Photo #:

**3.25** Is there toe clearance at least 9 inches high?  
[306.3.3]

Yes  
Measurement:  
9 inches

Note: Space extending greater than 6 inches beyond the available toe clearance at 9 inches above the floor is not considered toe clearance.

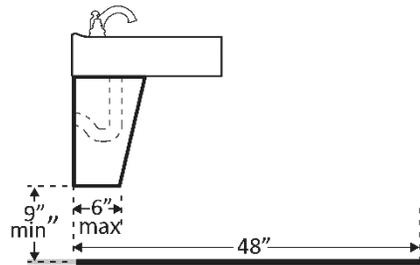


Photo #:

**3.26** Are pipes below the lavatory insulated or otherwise configured to protect against contact?  
[606.5]

Yes




Photo #:

**3.27** Can the faucet be operated without tight grasping, pinching, or twisting of the wrist?  
  
Is the force required to activate the faucet no greater than 5 pounds?  
[606.4]

Yes

Yes

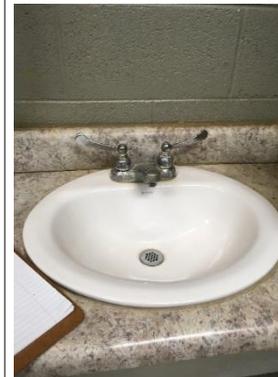



Photo #:

**Soap Dispensers and Hand Dryers**

**3.28** Are the operable parts of the soap dispenser within one of the following reach ranges:

Above lavatories or counters no less than 20 inches and no greater than 25 inches deep: no higher than 44 inches above the floor?  
[308.2.2]

Above lavatories less than 20 inches deep: no higher than 48 inches above the floor?

Not over an obstruction: no higher than 48 inches above the floor?  
[308.2]

Yes  
Measurement:  
43 inches

NA  
Measurement:

NA  
Measurement:

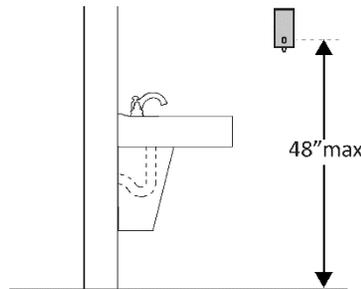
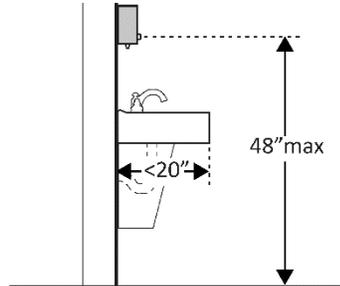
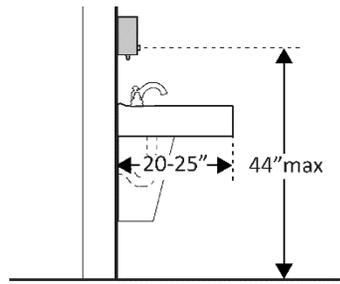


Photo #:

**3.29** Are the operable parts of the hand dryer or towel dispenser within one of the following reach ranges:

Above lavatories or counters no less than 20 inches and no greater than 25 inches deep: no higher than 44 inches above the floor?

Above lavatories less than 20 inches deep: no higher than 48 inches above the floor?

Not over an obstruction: no higher than 48 inches above the floor?  
[308.2]

Can the operable parts of the hand dryer or towel dispenser be operated without tight grasping, pinching or twisting of the wrist?

Is the force required to activate the hand dryer or towel dispenser no greater than 5 pounds?  
[309.4]

(Women)No  
Measurement:  
+/- 50 inches

NA  
Measurement:

(Men)No  
Measurement:

No

NA  
Measurement:

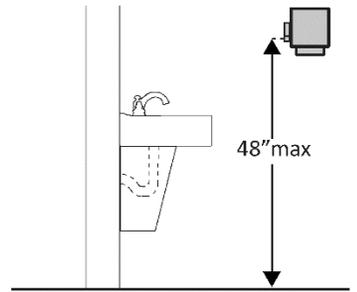
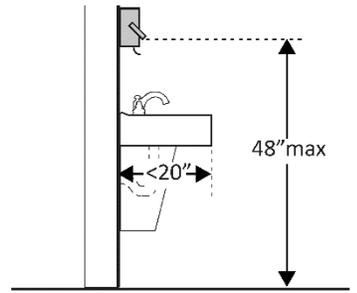
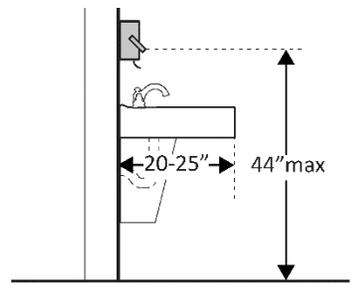


Photo #: Women



Photo #: Men

- Adjust dispensers
- Replace with or provide additional accessible dispensers

\$240.00

2022





<p><b>3.30</b> Is the centerline of the water closet no less than 16 inches and no greater than 18 inches from the side wall or partition? [604.2]</p>	<p>No</p> <p>Measurement: 21 inches</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>• Move toilet</li> </ul> <p>\$7,500</p> <p>2026</p>
<p><b>3.31</b> Is clearance provided around the water closet measuring at least 60 inches from the side wall and at least 56 inches from the rear wall?*</p> <p>[604.3.1]</p>	<p>Yes</p> <p>Measurement: 60" x 56"</p>		 	<p>* If constructed before 3/15/12, clearances around water closets in single user toilet rooms can be 48 inches wide by 66 inches long or 48 inches wide by 56 inches long (depending on the approach to the water closet, see 1991 Standards Figure 28) and the lavatory may overlap that clearance if the door to the room does not swing into the required clearances at fixtures (such as lavatories, water closet and urinals) and the edge of the lavatory is at least 18 inches from the centerline of the water closet</p>

			Photo #:	
<p><b>3.32</b> Is the height of the water closet no less than 17 inches and no greater than 19 inches above the floor measured to the top of the seat? [604.4]</p>	<p>Yes</p> <p>Measurement: 19 inches</p>			
<p><b>3.33</b> Is there a grab bar at least 42 inches long on the side wall?</p> <p>Is it located no more than 12 inches from the rear wall?</p> <p>Does it extend at least 54 inches from the rear wall? [604.5.1]</p> <p>Is it mounted no less than 33 inches and no greater than 36 inches from the floor?</p>	<p>No</p> <p>Measurement: 36 inches</p> <p>Yes</p> <p>Measurement: 48 inches</p> <p>Yes</p> <p>Measurement: 36 inches</p>			<p>• Install 42" grab bar</p> <p>• Relocate objects</p> <p>\$150.00</p> <p>2022</p>









<p>inches above the floor to the top of the gripping surface? [609.4]</p> <p>Is there at least 12 inches clearance between the grab bar and protruding objects above?*</p> <p>Is there at least 1½ inches clearance between the grab bar and projecting objects below?*</p> <p>Is the space between the wall and the grab bar 1 ½ inches? [609.3]</p>	<p>36 inches</p> <p>No Measurement: +/- 6 inches</p> <p>NA Measurement:</p> <p>Yes Measurement:</p>		  	<p>* If constructed before 3/15/2012 grab bars do not need to be relocated; there are no space requirements above and below grab bars in the 1991 Standards</p>
---	---	--	---	---

			Photo #:	
<p><b>3.34</b> Is there a grab bar at least 36 inches long on the rear wall?</p> <p>Does it extend at least 12 inches from the centerline of the water closet on one side (side wall)?</p> <p>Does it extend at least 24 inches on the other (open) side? [604.5.2]</p> <p>Is it mounted no less than 33 inches and no greater than 36 inches above the floor to the top of the gripping surface? [609.4]</p> <p>Are there at least 12 inches clearance between the grab bar and protruding objects above?*</p> <p>Are there at least 1½ inches clearance between the grab bar and projecting objects below?*</p> <p>Is the space between the wall and the grab bar 1½ inches? [609.3]</p>	<p>No Measurement: 24 inches</p> <p>Yes Measurement: 24 inches</p> <p>No Measurement: 24 inches</p> <p>Yes Measurement: 36 inches</p> <p>NA Measurement: 12" min</p> <p>Yes Measurement: 1½" min</p> <p>Yes Measurement: 1½" min</p>	  	 	<ul style="list-style-type: none"> <li>• Install 36 inch grab bar</li> </ul> <p>\$25.00</p> <p>2022</p> <p>* If constructed before 3/15/2012 grab bars do not need to be relocated; there are no space requirements above and below grab bars in the 1991 Standards</p>

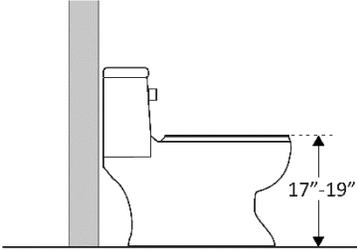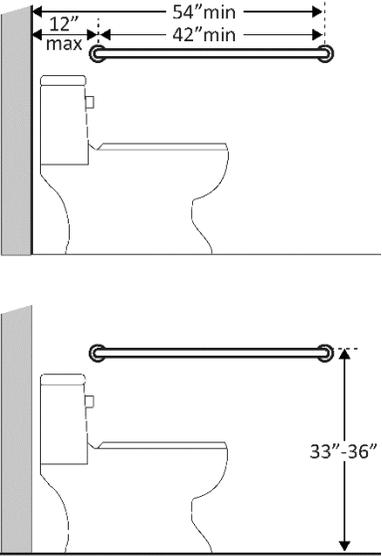

[605.4]	Measurement:		Photo #:	
<p><b>3.37</b> Is the flush control on the open side of the water closet? [604.6]</p>	<p>Yes</p>		 <p>Women</p>  <p>Men</p> <p>Photo #:</p>	

<p><b>3.38</b> Is the toilet paper dispenser located no less than 7 inches and no greater than 9 inches from the front of the water closet to the centerline of the dispenser?*</p> <p>[604.7]</p>	<p>No, but constructed before 3/15/2012</p> <p>Measurement:</p>		 <p>Photo #:</p>	<p>* If constructed before 3/15/2012 dispenser does not need to be relocated if it is within reach from the water closet seat; the 1991 Standards do not specify distance from the front of the water closet</p>
<p><b>3.39</b> Is the outlet of the dispenser:</p> <p>Located no less than 15 inches and no greater than 48 inches above the floor?</p> <p>Not located behind grab bars?</p> <p>[604.7]</p>	<p>Yes</p> <p>Measurement: 48 inches</p> <p>No</p>		 <p>Photo #:</p>	
<p><b>3.40</b> Does the dispenser allow continuous paper flow?</p> <p>[604.7]</p>	<p>Yes</p>		<p>Photo #:</p>	

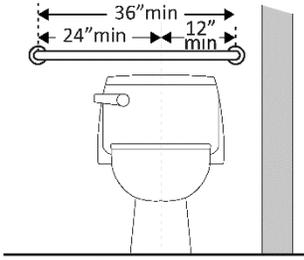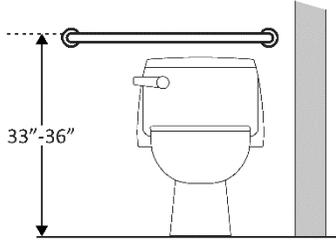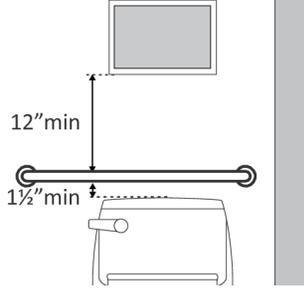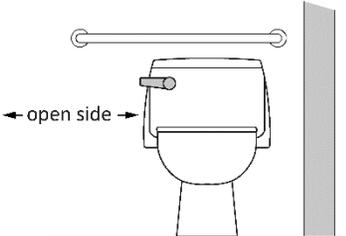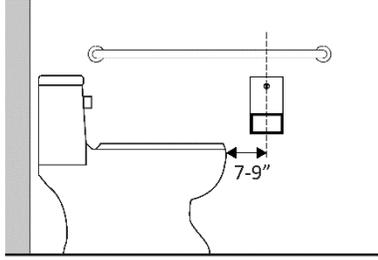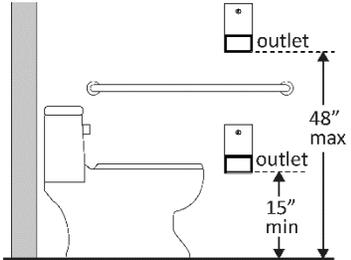**Toilet Compartments (Stalls)**

**3.41** Is the door opening width at least 32 inches clear, between the face of the door and the stop, when the door is open 90 degrees?  
[604.8.1.2]

Yes

Measurement:  
48 inches




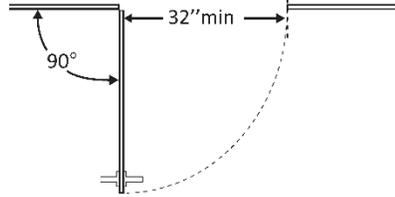


Photo #:

<p><b>3.42</b> If there is a front approach to the pull side of the door, is there at least 18 inches of maneuvering clearance beyond the latch side plus 60 inches clear depth? [604.8.1.2]</p> <p>Note: See 2010 Standards 604.8.1.2 Doors for maneuvering clearance requirements on the push side of the door and side approaches to the pull side of the door</p>	<p>(Men) - Yes/Yes (Women) - Yes/No</p> <p>Measurement: Women - 48 inches clear depth</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>Remove obstructions</li> </ul> <p>2026</p>
<p><b>3.43</b> Is the door self-closing? [604.8.1.2]</p>	<p>No</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> <li>Add closer</li> <li>Replace door</li> </ul> <p>\$60.00</p> <p>2026</p>
<p><b>3.44</b> Are there door pulls on both sides of the door that are operable with one hand and do not require tight grasping pinching or twisting of the wrist?*</p> <p>[604.8.1.2]</p>	<p>Yes</p>		 <p>Women</p>	<p>* If constructed before 3/15/2012 door pulls do not need to be added; door pulls are not required in the 1991 Standards</p>

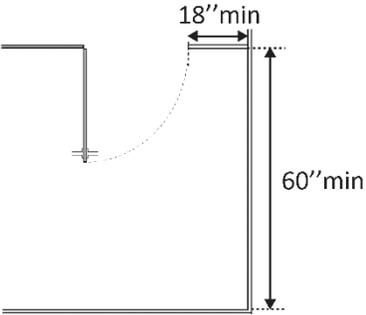
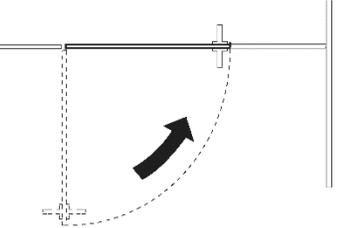




Women




Men

Photo #:
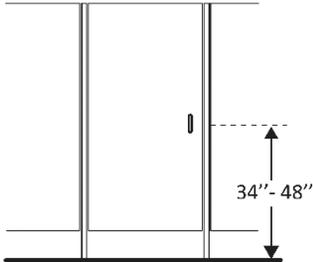
<p><b>3.45</b> Is the lock operable with one hand and without tight grasping, pinching or twisting of the wrist? [309.4]</p>	<p>No</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>• Replace lock</li> </ul> <p>\$120.00</p> <p>2023</p>
<p><b>3.46</b> Are the operable parts of the door hardware mounted no less than 34 inches and no greater than 48 inches above the floor? [404.2.7]</p>	<p>Yes</p> <p>Measurement: 40 inches</p>		 <p>Photo #:</p>	

<p><b>3.47</b> Is the compartment at least 60 inches wide? [604.8.1.1]</p>	<p>Yes</p> <p>Measurement:</p>	 <p>A schematic diagram of a toilet compartment. A vertical double-headed arrow on the right side indicates a minimum width of 60 inches.</p>	 <p>A photograph showing a close-up of a toilet compartment's interior wall and floor. A yellow measuring tape is stretched across the width of the compartment, showing it is at least 60 inches wide.</p> <p>Photo #:</p>	
<p><b>3.49</b> If the water closet is floor mounted, is the compartment at least 59 inches deep? [604.8.1.1]</p>	<p>(Men) Yes (Women) No</p> <p>Measurement: 56 inches</p>	 <p>A schematic diagram of a toilet compartment. A horizontal double-headed arrow at the bottom indicates a minimum depth of 59 inches.</p>	 <p>A photograph showing a close-up of a toilet compartment's interior wall and floor. A yellow measuring tape is stretched across the depth of the compartment, showing it is 56 inches deep.</p> <p>Photo #:</p>	<ul style="list-style-type: none"> <li>Alter compartment</li> </ul> <p>\$3,000</p> <p>2026</p>
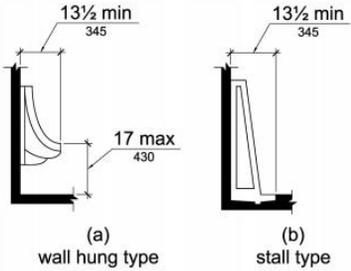
<p><b>3.51</b> Is the rim 17 inches maximum above the finished floor. Is the urinal 13 ½ inches deep minimum measured from the outer face of the urinal rim to the back of the fixture [605.2]</p>	<p>Yes</p> <p>Measurement: 17-1/4 inches</p>		 <p>Photo #:</p>	
--	--	--	---	--

Misc. Recreation			Comments	Possible Solutions
<b>Sports Activities</b> (2010 Standards – 206 & Ch. 4) Soccer fields, basketball courts, tennis courts, baseball fields, running tracks, skating rinks, etc.				
<p><b>S1</b> Is there an accessible route to each type of sport activity?</p> <p>For exterior routes use the checklist for <i>Priority 1: Approach &amp; Entrance</i>.</p> <p>For interior routes use the checklist for <i>Priority 2: Access to Goods &amp; Services</i>.</p>	<p>Yes</p>			



Photo #:

**Team or Player Seating (2010 Standards – 206, 221 & 802) Baseball, hockey, basketball, football, etc.**

<p><b>T1</b> At areas of sport activity, is there an accessible route to each side of team or player seating?</p> <p>For exterior routes use the checklist for <i>Priority 1: Approach &amp; Entrance</i>.</p> <p>For interior routes use the checklist for <i>Priority 2: Access to Goods &amp; Services</i>.</p>	<p>Yes</p>		<p>Photo #:</p>	
--	------------	--	-----------------	--

<p><b>T2</b> Is there at least one wheelchair space at team or player seating areas?</p>	<p>No</p> <p>Measurement:</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> <li>• Add wheelchair space</li> </ul> <p>\$100.00</p> <p>2020</p>
--	-------------------------------	--	-----------------	--

