

**Greeneville/Greene County Public Library  
Main Library  
Basement**

**210 N. Main Street, Greeneville Tennessee 37745**

**Erin Evans, Library Director**

**October 30, 2019**



## **LOCATION SUMMARY**

**The Greeneville/Greene County Public Library serves the citizens in the Town of Greeneville as well as Greene County. The library is located on North Main Street in front of the historic Big Spring. The two story brick building was originally built in 1975 as the public library. The library service area is located in the upstairs 8,126 square feet, which is at street level. The downstairs 1,870 square feet consists of a meeting room and kitchen that is available for use by both public and private organizations.**

**Erin Evans, Library Director, [eevans.ggcpl@gmail.com](mailto:eevans.ggcpl@gmail.com) 423-638-5034**

---

## ADA Checklist for Existing Facilities

---

# Priority 1 – Approach & Entrance

Based on the 2010 ADA Standards for Accessible Design



**Project:** ADA Assessment Greeneville TN

---

**Building:** Greeneville/Greene County Library Basement

---

**Location:** 210 N Main Street

---

**Date:** Oct 30, 2018

---

**Surveyors:** Gail Stacy, Caroline Miller

---

**Contact Information:** 525-5093

---

---

---

**An accessible route from site arrival points and an accessible entrance should be provided for everyone.**

---

## Priority 1 – Approach & Entrance

### Comments

### Possible Solutions

**1.1** Is there at least one route from site arrival points (parking, passenger loading zones, public sidewalks and public transportation stops) that does not require the use of stairs?  
[See 2010 ADA Standards for Accessible Design – 206.2.1]

Yes

If yes, location of route:



Photo

- redesign curb ramp

Level of Priority: 2  
Plan Budget Year: 2022  
Budget Estimate: \$2,000

**Parking** Accessible parking spaces should be identified by size, access aisle and signage.

**1.2** If parking is provided for the public, are an adequate number of accessible spaces provided? [208.2]

Yes		
Total #: 5		
Accessible #: 0		
	<b>Total Spaces</b>	<b>Accessible Spaces</b>
	1 - 25	1
	26 - 50	2
	51 - 75	3
	76 - 100	4
	100+ see 2010 Standards 208.2	

Photo #:

- Add accessible space by repainting lines so that one of the five spaces is reserved for disabled

Level of Priority: 2  
Plan Budget Year: 2023  
Budget Estimate: \$1,500

**Exterior Accessible Route**

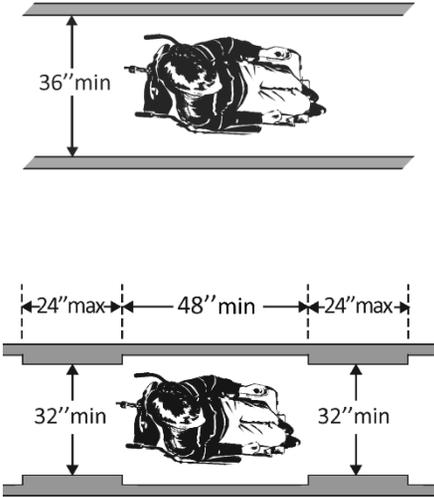
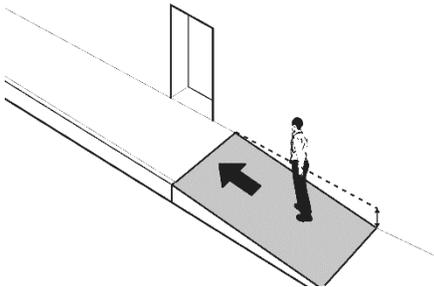
**1.13** Is the route stable, firm and slip-resistant? [302.1]

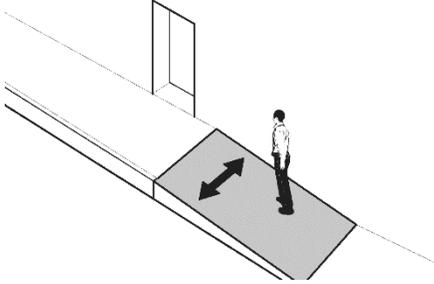
Yes, but curb ramp too steep

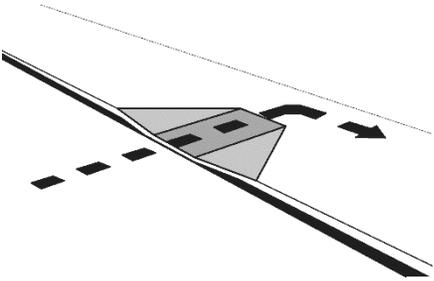


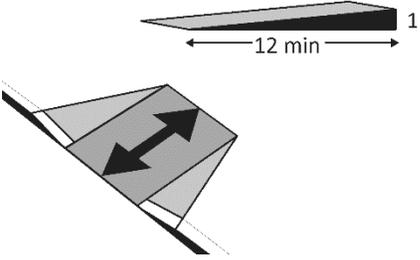
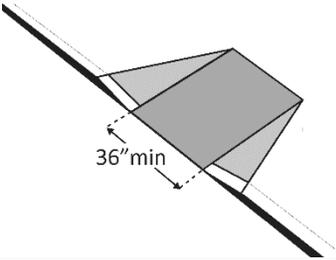
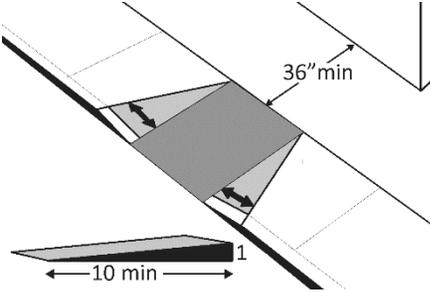
- redesign curb ramp
- Install curb ramp in another location

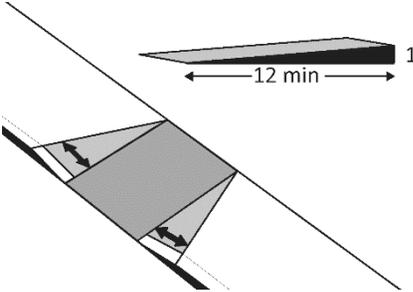
Level of Priority: 2  
Plan Budget Year: 2022  
Budget Estimate: \$2,000

			Photo #:	
<p><b>1.14</b> Is the route at least 36 inches wide? [403.5.1]</p> <p>Note: The accessible route can narrow to 32 inches min. for a max. of 24 inches. These narrower portions of the route must be at least 48 inches from each other.</p>	<p>Yes</p> <p>Measurement: 56 inches</p>		<p>Photo</p> 	<p>No changes required.</p>
<p><b>1.17</b> Is the running slope no steeper than 1:20, i.e. for every inch of height change there are at least 20 inches of route run? [403.3]</p> <p>Note: If the running slope is steeper than 1:20, treat as a ramp and add features such as edge protection and handrails.</p>	<p>Yes</p> <p>Measurement:</p>		<p>Photo</p> 	<p>No changes required.</p>

<p><b>1.18</b> Is the cross slope no steeper than 1:48? [403.3]</p>	<p>Yes Measurement:</p>		<p>Photo</p> 	<p>No changes required.</p>
---	-----------------------------	--	--	-----------------------------

Curb Ramps				
<p><b>1.19</b> If the accessible route crosses a curb, is there a curb ramp? [402.2]</p>	<p>Yes</p>		<p>Photo</p> 	<p>No changes required.</p>

<p><b>1.20</b></p> <p>Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]</p>	<p>No</p> <p>Measurement:</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>• redesign curb ramp</li> <li>• Install curb ramp in another location</li> </ul> <p>Level of Priority: 2 Plan Budget Year: 2022 Budget Estimate: \$2,000</p>
<p><b>1.22</b></p> <p>Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p>Yes</p> <p>Measurement:</p>		<p>Photo #:</p>	<p>No changes required.</p>
<p><b>1.23</b></p> <p>At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb</p>	<p>No</p> <p>Measurement:</p> <p>No</p> <p>Measurement:</p>		 <p>Photo #:</p>	<ul style="list-style-type: none"> <li>• redesign curb ramp</li> <li>• Install curb ramp in another location</li> </ul> <p>Level of Priority: 2 Plan Budget Year: 2022 Budget Estimate: \$2,000</p>

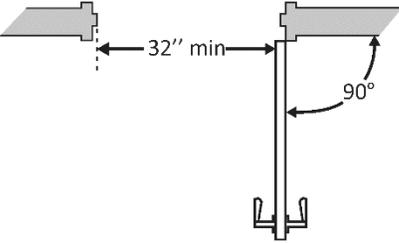
<p>ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>				
<p><b>1.24</b></p> <p>If the landing at the top is less than 36 inches long, are there curb ramp flares?</p> <p>Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run?</p>	<p>No</p> <p>No</p> <p>Measurement:</p>		<p>Photo #:</p>	<ul style="list-style-type: none"> <li>• redesign curb ramp</li> <li>• Install curb ramp in another location</li> </ul> <p>Level of Priority: 2 Plan Budget Year: 2022 Budget Estimate: \$2,000</p>

[406.4]				
---------	--	--	--	--

**Entrance**

<b>1.37</b>	Is the main entrance accessible?	No		Photo #:	Reconfigure accessible route from an accessible parking area  Level of Priority: 2 Plan Budget Year: 2022 Budget Estimate: \$2,000
-------------	----------------------------------	----	--	----------	--

<b>1.39</b>	Do all inaccessible entrances have signs indicating the location of the nearest accessible entrance? [216.6]	No			<ul style="list-style-type: none"> <li>• Install signs</li> <li>• Install signs on route before people get to inaccessible entrances so that people do not have to turn around and retrace route</li> </ul> Level of Priority: 2 Plan Budget Year: 2022 Budget Estimate: \$1,000
-------------	---	----	---	--	---

<p><b>1.40</b></p> <p>If not all entrances are accessible, is there a sign at the accessible entrance with the International Symbol of Accessibility? [216.6]</p>	<p>No</p>		<p>Photo</p> 	<ul style="list-style-type: none"> <li>• Install sign</li> </ul> <p>Level of Priority: 2 Plan Budget Year: 2022 Budget Estimate: \$100</p>
<p><b>1.41</b></p> <p>Is the clear opening width of the accessible entrance door at least 32 inches, between the face of the door and the stop, when the door is open 90 degrees? [404.2.3]</p>	<p>No</p> <p>Measurement: Pair of 30 inch doors</p>		<p>Photo</p> 	<ul style="list-style-type: none"> <li>• Replace double doors with single accessible door</li> </ul> <p>Level of Priority: 2 Plan Budget Year: 2022 Budget Estimate: \$2,000</p>

1.42

If there is a front approach to the pull side of the door, is there at least 18 inches of maneuvering clearance beyond the latch side plus at least 60 inches clear depth?

Note: See 2010 Standards 404.2.4 for maneuvering clearance requirements on the push side of the door and side approaches to the pull side of the door


On both sides of the door, is the ground or floor surface of the

Yes

Measurement:

No

Measurement:



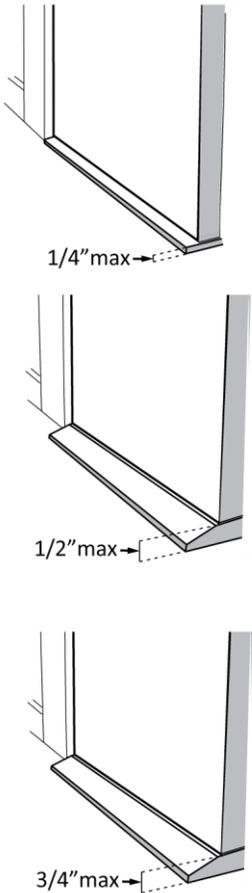
Photo

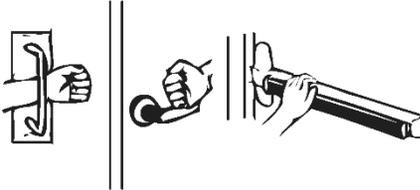
- Replace pair of doors with single accessible door
- Redesign exterior walk for level maneuvering surface

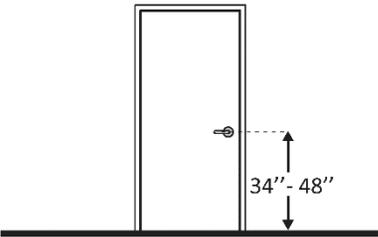
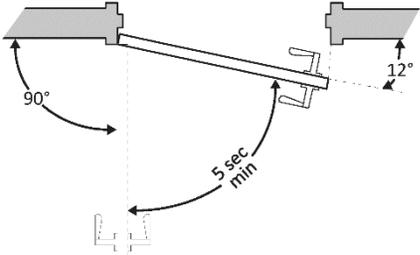
Level of Priority: 2

Plan Budget Year: 2022

Budget Estimate: \$2,000

<p>maneuvering clearance level (no steeper than 1:48)? [404.2.4]</p>				
<p><b>1.43</b></p> <p>If the threshold is vertical is it no more than ¼ inch high?</p> <p>Or</p> <p>No more than ½ inch high with the top ¼ inch beveled no steeper than 1:2, if the threshold was installed on or after the 1991 ADA Standards went into effect (1/26/93)?</p> <p>Or</p> <p>No more than ¾ inch high with the top</p>	<p>NA</p> <p>Measurement:</p> <p>Yes</p> <p>Measurement:</p> <p>NA</p> <p>Measurement:</p>	 <p>1/4" max</p> <p>1/2" max</p> <p>3/4" max</p>	<p>Photo</p> 	<ul style="list-style-type: none"> <li>• Replace threshold</li> </ul> <p>Level of Priority: 2</p> <p>Plan Budget Year: 2022</p> <p>Budget Estimate: \$1,000</p>

	<p>½ inch beveled no steeper than 1:2, if the threshold was installed before the 1991 ADA Standards went into effect (1/26/93)? [404.2.5, 303.2]</p> <p>Note: The first ¼ inch of the ½ or ¾ inch threshold may be vertical; the rest must be beveled.</p>			
<p><b>1.44</b></p>	<p>Is the door equipped with hardware that is operable with one hand and does not require tight grasping, pinching or twisting of</p>	<p>No</p> <p>No</p> <p>No</p> 		<p>Refer to 1.42</p>

<p>the wrist?</p> <p>Door handle?</p> <p>Lock (if provided)? [404.2.7]</p>			 <p>Photo #:</p>	
<p><b>1.45</b></p> <p>Are the operable parts of the door hardware no less than 34 inches and no greater than 48 inches above the floor or ground surface? [404.2.7]</p>	<p>Yes</p> <p>Measurement:</p>		<p>Photo #:</p>	
<p><b>1.46</b></p> <p>If the door has a closer, does it take at least 5 seconds to close from an open position of 90 degrees to a position of 12 degrees from the</p>	<p>No</p> <p>Measurement:</p>		 <p>Photo #:</p>	<p>Refer to 1.42</p>

	latch? [404.2.8]				
1.48	If provided at the building entrance, are carpets or mats no higher than ½ inch thick? [302.2]	Yes Measurement:			Photo #:
1.49	Are edges of carpets or mats securely attached to minimize tripping hazards? [302.2]	Yes			Photo #:

**2.1** Does the accessible entrance provide direct access to the main floor, lobby and elevator?  
[See 2010 ADA Standards for Accessible Design – 206.4]

Yes



Photo 1.

### Interior Accessible Route

**2.2** Are all public spaces on at least one accessible route?  
[206.2.4]

Yes



No changes required.

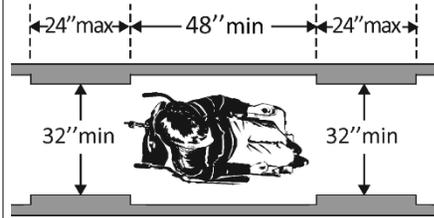
				
<p><b>2.3</b> Is the route stable, firm and slip-resistant? [40.2, 302.1]</p>	<p>Yes</p>			<p>No changes required.</p>
<p><b>2.4</b> Is the route at least 36 inches wide? [403.5.1]</p> <p>Note: The accessible route can narrow to 32 inches min. for a max. of 24 inches. These narrower portions of the route must be at least 48 inches from</p>	<p>Yes</p> <p>Measurement: 5'-0"</p>			<p>No changes required.</p>

Photo #:

Photo #:

Photo #:

each other.



**2.8** Do all objects on circulation paths through public areas, e.g. fire extinguishers, drinking fountains, signs, etc., protrude no more than 4 inches into the path?

Or

If an object protrudes more than 4 inches, is the bottom leading edge at 27 inches or lower above the floor? [307.2]

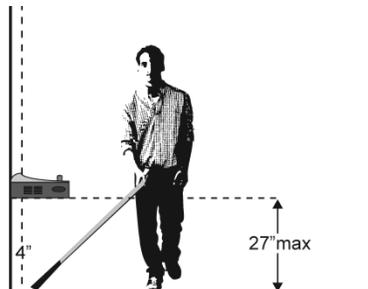
Or

Is the bottom leading edge at 80 inches or higher above the floor? [307.4]

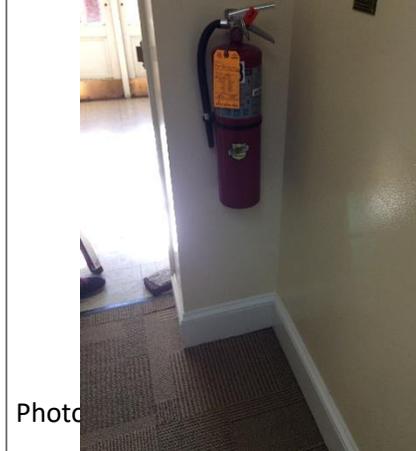
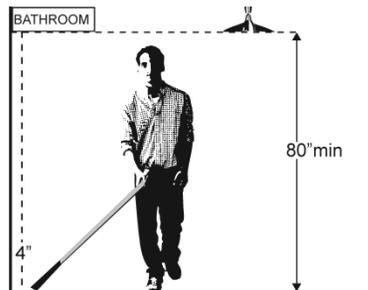
Yes  
Measurement:



Yes  
Measurement:



NA  
Measurement:



Photo

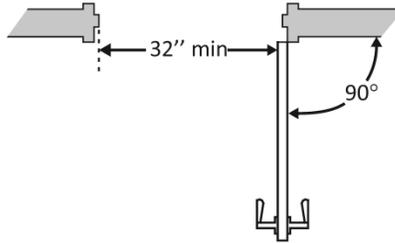
No changes required.

**Interior Doors – to classrooms, medical exam rooms, conference rooms, etc.**

**2.40** Is the door opening width at least 32 inches clear, between the face of the door and the stop, when the door is open 90 degrees?  
[404.2.3]

No

Measurement:  
pair of 30 inch doors



Pho

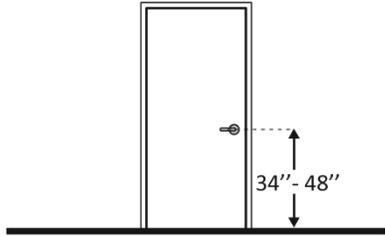

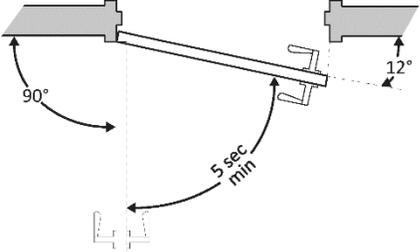
• Replace interior double doors with single accessible door

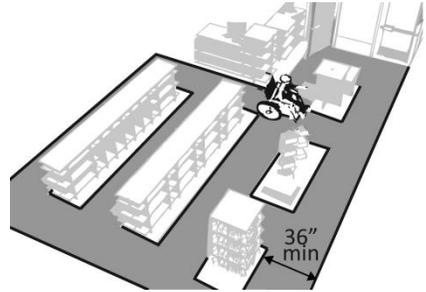
Level of Priority: 2

Plan Budget Year: 2022

Budget Estimate: \$2,000



<p><b>2.44</b> Are the operable parts of the hardware no less than 34 inches and no greater than 48 inches above the floor? [404.2.7]</p>	<p>Yes</p> <p>Measurement: 40 inches</p>	 <p>A diagram showing a door with a handle. A vertical double-headed arrow indicates the height from the floor to the handle, labeled "34'' - 48''".</p>	<p>Photo </p>	<p>Refer to 2.40</p>
<p><b>2.45</b> Can the door be opened easily (5 pounds maximum force)? [404.2.9]</p> <p>Note: You can use a pressure gauge or fish scale to measure force. If you do not have one you will need to judge whether the door is easy to open.</p>	<p>Yes</p> <p>Measurement:</p>	 <p>A diagram showing a person from behind, pushing a door open. An arrow labeled "5 lbf" points from the person's hand to the door handle.</p>	<p>Photo #:</p>	<p>Refer to 2.40</p>
<p><b>2.46</b> If the door has a closer, does it take at least 5 seconds to close from an open position of 90 degrees to a position of 12 degrees from the latch? [404.2.8.1]</p>	<p>No</p> <p>Measurement:</p>	 <p>A diagram of a door closer mechanism. It shows a door at a 90-degree angle from the latch and a 12-degree angle from the latch. A curved arrow indicates the closing path, labeled "5 sec min".</p>	<p>Photo </p>	<p>Refer to 2.40</p>

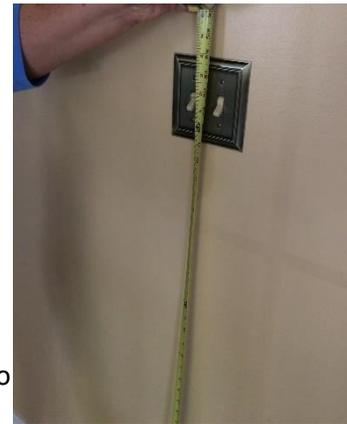
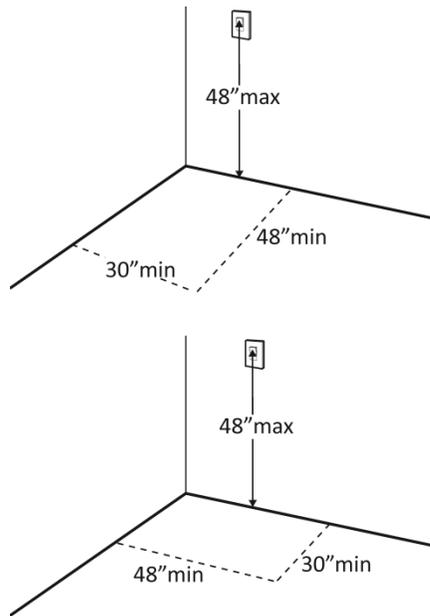
<p><b>2.47</b> Are aisles and pathways to goods and services, and to one of each type of sales and service counters, at least 36 inches wide? [403.5.1]</p>	<p>Yes Measurement:</p>		<p>Phot</p> 	
<p><b>2.48</b> Are floor surfaces stable, firm and slip resistant? [302.1]</p>	<p>Yes</p>		<p>Phot</p> 	<p>No changes required.</p>
<p><b>2.49</b> If there is carpet:  Is it no higher than 1/2 inch?  Is it securely attached along the edges? [302.2]</p>	<p>Yes Measurement:  Yes</p>		<p>Phot</p> 	<p>No changes required.</p>

**Controls – light switches, security and intercom systems, emergency/alarm boxes, etc.**

**2.50** Is there a clear floor space at least 30 inches wide by at least 48 inches long for a forward or parallel approach?  
[305.3]

Are the operable parts no higher than 48 inches above the floor?\*

Yes  
Measurement:  
  
No  
Measurement:  
49 inches




Photo

\*If constructed before 3/15/2012 and a parallel approach is provided, controls can be 54 inches above the floor

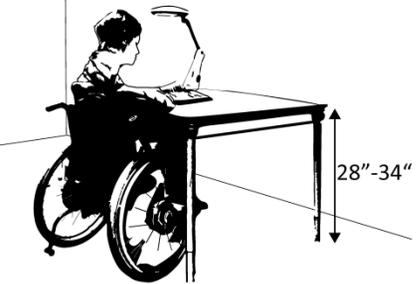
**2.51** Can the control be operated with one hand and without tight grasping, pinching, or twisting of the wrist?  
[309.4]

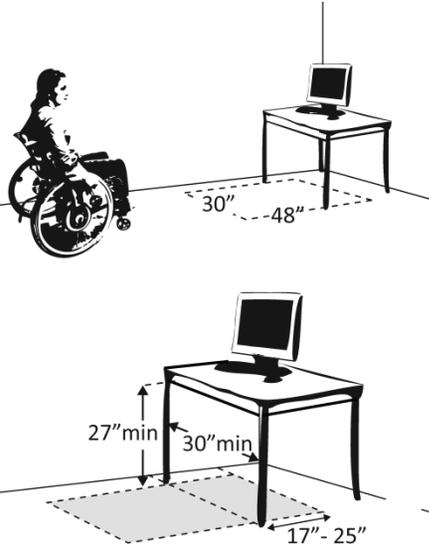
Yes



Photo

**Seating: At dining surfaces (restaurants, cafeterias, bars, etc.) and non-employee work surfaces (libraries, conference rooms, etc.)**

<p><b>2.64</b> Are at least 5%, but no fewer than one, of seating and standing spaces accessible for people who use wheelchairs? [226.1]</p>	<p>Yes Total #: 24 Wheelchair #: 8</p>		 <p>Phot</p>	
<p><b>2.65</b> Is there a route at least 36 inches wide to accessible seating? [403.5.1]</p>	<p>Yes Measurement:</p>	 <p>36" min</p>	 <p>Phot</p>	
<p><b>2.66</b> At the accessible space(s), is the top of the accessible surface no less than 28 inches and no greater than 34 inches above the floor? [902.3]</p> <p>Note: If for children, the top should be no less than 26 inches and no greater than 30 inches above the floor.</p>	<p>Yes Measurement: 30 inches</p>	 <p>28"-34"</p>	 <p>Phot</p>	

<p><b>2.67</b> Is there a clear floor space at least 30 inches wide by at least 48 inches long for a forward approach? [305.3]</p> <p>Does it extend no less than 17 inches and no greater than 25 inches under the surface?</p> <p>Is there knee space at least 27 inches high and at least 30 inches wide? [306.2, 306.3]</p> <p>Note: If for children, the knee space may be 24 inches high.</p>	<p>Yes Measurement:</p> <p>Yes Measurement:</p> <p>Yes Measurement:</p>		 <p>Phot</p>	
---	---	--	---	--

### Priority 3 – Toilet Rooms

		Comments	Possible Solutions
<p><b>3.1</b> If toilet rooms are available to the public, is at least one toilet room accessible? (Either one for each sex, or one unisex.)</p> <p>Note: If toilet rooms are chiefly for children, e.g., in elementary schools</p>	<p>No</p>		<ul style="list-style-type: none"> <li>Reconfigure toilet rooms</li> </ul> <p>Level of Priority: 3 Plan Budget Year: 2025 Budget Estimate: \$25,000</p>

and day care centers,  
use the children's  
specifications in Toilets -  
604.1, 604.8, 604.9,  
609.4 and Lavatories  
and Sinks – 606.2.



Pho

