

**Greeneville Town Hall
Main Floor**

**200 N. College Street
Greeneville, TN 37745**

City Administrator Todd Smith

December 1, 2019



LOCATION SUMMARY

The Greeneville Town Hall was constructed in 1967. It houses all of the administrative functions of the town. Furthermore, the location serves customers in the Finance office, Building department, and Human Resources. The Greeneville Police department also works out of town hall as well. Oversight of Town Hall rests with the City Administrator, currently Todd Smith (tsmith@greenevilletn.gov).

ADA Checklist for Existing Facilities

Priority 1 – Approach & Entrance

Based on the 2010 ADA Standards for Accessible Design



Project: ADA Assessment Greeneville TN

Building: Town Hall Main Floor

Location: 200 N. College Street

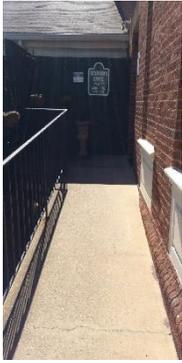
Date: Oct 23, 2018

Surveyors: Dave Wright, Gail Stacy, Caroline Miller

Contact Information: 423-525-5093


An accessible route from site arrival points and an accessible entrance should be provided for everyone.

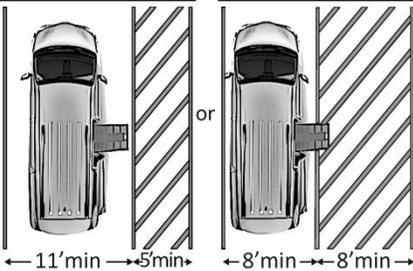
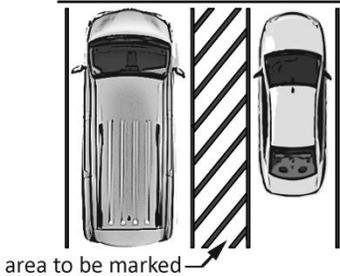
| Priority 1 – Approach & Entrance | Comments | Possible Solutions |
|----------------------------------|----------|--------------------|
|----------------------------------|----------|--------------------|

| | | | |
|---|--|---|---|
| <p>1.1 Is there at least one route from site arrival points (parking, passenger loading zones, public sidewalks and public transportation stops) that does not require the use of stairs? [See 2010 ADA Standards for Accessible Design – 206.2.1]</p> | <p>No, but ramp in place</p> <p>If yes, location of route:</p> |  | <p>Level of Priority: 1 Plan Budget Year: 2022 Budget Estimate: Accessible route from parking area \$5,000.</p> |
| | | Photo #: | |

| | | | |
|--|--|--|--|
| Parking Accessible parking spaces should be identified by size, access aisle and signage. | | | |
|--|--|--|--|

| <p>1.2 If parking is provided for the public, are an adequate number of accessible spaces provided? [208.2]</p> | <p>No</p> <p>Total #: 70</p> <p>Accessible #: 2</p> | <table border="1" style="width:100%; border-collapse: collapse; text-align: center;"> <thead> <tr> <th style="padding: 5px;">Total Spaces</th> <th style="padding: 5px;">Accessible Spaces</th> </tr> </thead> <tbody> <tr> <td style="padding: 5px;">1 - 25</td> <td style="padding: 5px;">1</td> </tr> <tr> <td style="padding: 5px;">26 - 50</td> <td style="padding: 5px;">2</td> </tr> <tr> <td style="padding: 5px;">51 - 75</td> <td style="padding: 5px;">3</td> </tr> <tr> <td style="padding: 5px;">76 - 100</td> <td style="padding: 5px;">4</td> </tr> <tr> <td colspan="2" style="padding: 5px;">100+ see 2010 Standards 208.2</td> </tr> </tbody> </table> | Total Spaces | Accessible Spaces | 1 - 25 | 1 | 26 - 50 | 2 | 51 - 75 | 3 | 76 - 100 | 4 | 100+ see 2010 Standards 208.2 | |  | <ul style="list-style-type: none"> • Reconfigure by repainting lines <p>Level of Priority: 1 Plan Budget Year: 2021 Budget Estimate: \$5,000</p> |
|--|---|--|--------------|-------------------|--------|---|---------|---|---------|---|----------|---|-------------------------------|--|--|---|
| Total Spaces | Accessible Spaces | | | | | | | | | | | | | | | |
| 1 - 25 | 1 | | | | | | | | | | | | | | | |
| 26 - 50 | 2 | | | | | | | | | | | | | | | |
| 51 - 75 | 3 | | | | | | | | | | | | | | | |
| 76 - 100 | 4 | | | | | | | | | | | | | | | |
| 100+ see 2010 Standards 208.2 | | | | | | | | | | | | | | | | |
| | | Photo #: | | | | | | | | | | | | | | |

| | | | | |
|---|--|---|--|---|
| <p>1.3 Of the accessible spaces, is at least one a van accessible space?*</p> <p>[208.2.4]</p> | <p>No</p> | <p>*For every 6 or fraction of 6 parking spaces required by the table above, at least 1 should be a van accessible space.</p> |  <p>Photo #:</p> | <p>* If constructed before 3/15/2012, parking is compliant if at least 1 in every 8 accessible spaces is van accessible</p> <ul style="list-style-type: none"> • Reconfigure by repainting lines <p>Level of Priority: 1 Plan Budget Year: 2021 Budget Estimate: \$1,500</p> |
| <p>1.4 Are accessible spaces at least 8 feet wide with an access aisle at least 5 feet wide?</p> <p>[502.2, 502.3]</p> <p>Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.</p> | <p>Yes</p> <p>Measurement: Space #1: 8'-0" Aisle #1: 5'-0" Space #2: 9'-0" Aisle #2: 6'-6"</p> |  |  <p>Photo #:</p> | <p>Accessible spaces are correct size. Size shall be maintained when new accessible spaces are added.</p> |

| | | | | |
|---|--|---|--|---|
| <p>1.5 Is the van accessible space:</p> <p>At least 11 feet wide with an access aisle at least 5 feet wide? Or At least 8 feet wide with an access aisle at least 8 feet wide? [502.2]</p> | <p>No</p> <p>Measurement:</p> <p>No</p> <p>Measurement:</p> |  |  <p>Photo #:</p> | <ul style="list-style-type: none"> • Reconfigure to provide van-accessible space(s) • Level of Priority: 1 Plan Budget Year: 2021 Budget Estimate: \$1,500 |
| <p>1.7 Are the access aisles marked so as to discourage parking in them? [502.3.3]</p> <p>Note: The marking method and color may be addressed by state/local requirements.</p> | <p>Yes</p> |  |  <p>Photo #:</p> | <p>Accessible spaces are correct size. Size shall be maintained when new accessible spaces are added.</p> |
| <p>1.8 Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]</p> | <p>No</p> <p>Measurement: 2:48 slope .5:48 cross slope</p> | | <p>Photo #:</p> | <ul style="list-style-type: none"> • Regrade surface • Level of Priority: 1 Plan Budget Year: 2021 Budget Estimate: \$1000 Access aisles may be leveled to a slope less than 1:48. |

1.9 Do the access aisles adjoin an accessible route?
[502.3]

Yes



Photo #:

- Create an accessible route
 - Relocate accessible space
 - Level of Priority: 1
- Plan Budget Year:2022
Budget Estimate: Accessible route from parking area \$5,000.

1.10 Are accessible spaces identified with a sign that includes the International Symbol of Accessibility?

No, only one sign installed

Is the bottom of the sign at least 60 inches above the ground?
[502.6]

No

Measurement:
61 inches

Note: The International Symbol of Accessibility is not required on the ground.

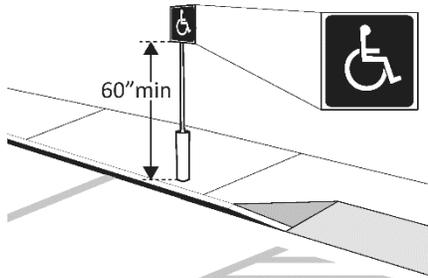
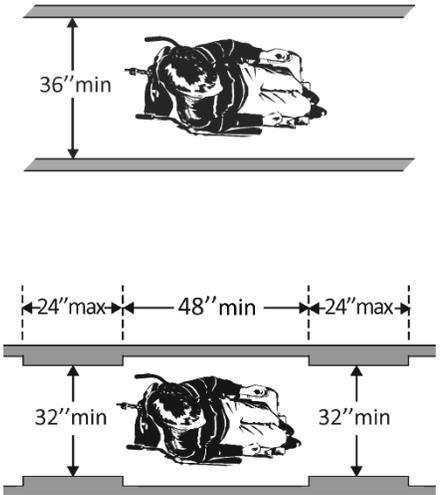


Photo #:

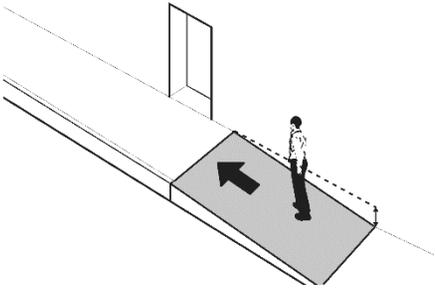
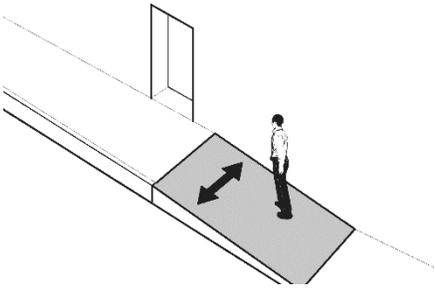
- Install signs
 - Level of Priority: 1
 - Plan Budget Year: 2021
- Budget Estimate: \$800

| | | | | |
|---|------------|--|-----------------|---|
| <p>1.11 Are there signs reading “van accessible” at van accessible spaces? [502.6]</p> | <p>No</p> |  <p>The diagram shows a parking space with a white-painted curb. A signpost stands at the edge of the space, holding a sign with a wheelchair symbol and the text 'VAN ACCESSIBLE'.</p> | <p>Photo #:</p> | <ul style="list-style-type: none"> • Install signs • Level of Priority: 1 • Plan Budget Year: 2021 <p>Budget Estimate: \$800</p> |
| <p>1.12 Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]</p> <p>Note: If parking serves multiple entrances, accessible parking should be dispersed.</p> | <p>Yes</p> |  <p>The photo shows a parking space on asphalt with white painted lines. A blue-painted curb is visible on the left side. The space is adjacent to a brick wall and a concrete walkway.</p> | <p>Photo #:</p> | <p>Location of accessible parking spaces is located on the closest accessible route and shall be maintained during reconfiguration.</p> |

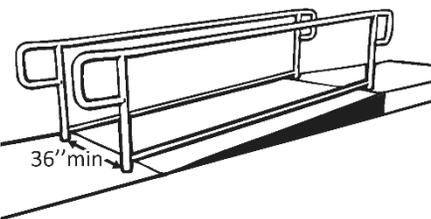
Exterior Accessible Route

| | | | | |
|---|--|---|---|---|
| <p>1.13 Is the route stable, firm and slip-resistant? [302.1]</p> | <p>No</p> | |  <p>Photo #:</p> | <ul style="list-style-type: none"> • Level of Priority: 1 • Plan Budget Year: 2021 <p>Budget Estimate: \$800</p> <ul style="list-style-type: none"> • Fill small bumps and breaks with patches |
| <p>1.14 Is the route at least 36 inches wide? [403.5.1]</p> <p>Note: The accessible route can narrow to 32 inches min. for a max. of 24 inches. These narrower portions of the route must be at least 48 inches from each other.</p> | <p>Yes</p> <p>Measurement: 44 inches</p> |  | | <p>Level of Priority: 1</p> <p>Correct ramp width shall be maintained during any reconfiguration.</p> |

| | | | | |
|--|--|--|---|--|
| | | |  | |
|--|--|--|---|--|

| | | | | |
|---|---|---|---|--|
| <p>1.17 Is the running slope no steeper than 1:20, i.e. for every inch of height change there are at least 20 inches of route run? [403.3]</p> <p>Note: If the running slope is steeper than 1:20, treat as a ramp and add features such as edge protection and handrails.</p> | <p>No</p> <p>Measurement: 1:12</p> |  |  <p>Photo #:</p> | <ul style="list-style-type: none"> • Level of Priority: 1 • Plan Budget Year: 2021 <p>Budget Estimate: \$800</p> <p>Add handrail to both sides of the ramp and add edge protection where needed.</p> |
| <p>1.18 Is the cross slope no steeper than 1:48? [403.3]</p> | <p>Yes</p> <p>Measurement: 1:48</p> |  | <p>Photo #:</p> | <p>Cross slope shall be maintained during any reconfiguration.</p> |

Ramps If any portion of the accessible route is steeper than 1:20, it should be treated as a ramp.

| | | | | |
|---|--|--|---|--|
| <p>1.25 If there is a ramp is it at least 36 inches wide? [405.5]</p> <p>Note: If there are handrails, measure between the handrails.</p> | <p>Yes</p> <p>Measurement: 44 INCHES</p> |  |  <p>Photo #:</p> | <ul style="list-style-type: none"> • Level of Priority: 1 • Plan Budget Year: 2021 <p>Budget Estimate: \$800</p> <p>Add handrail to both sides of the ramp and add edge protection where needed.</p> |
| <p>1.26 Is the surface stable, firm and slip resistant? [405.4]</p> | <p>Yes</p> | | <p>Photo #:</p> | <p>Slip resistance and stable, firm surface shall be maintained during any reconfiguration.</p> |
| <p>1.27 For each section of the ramp, is the running slope no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of ramp run? [405.2]</p> <p>Note: Rises no greater than 3 inches with a slope no steeper than 1:8 and rises no greater than 6 inches with a slope no steeper than 1:10 are permitted when such slopes are necessary due to space limitations.</p> | <p>Yes</p> <p>Measurement: 1:12</p> |  | <p>Photo #:</p> | <p>Ramp slope shall be maintained during any reconfiguration.</p> |

1.28 Is there a level landing that is at least 60 inches long and at least as wide as the ramp:

At the top of the ramp?

No

Measurement:

At the bottom of the ramp?
[405.7.2, 405.7.3]

No

Measurement:

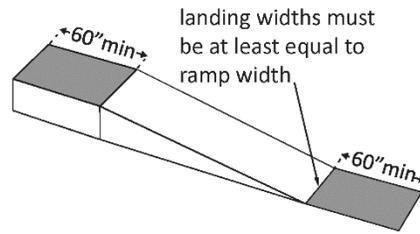
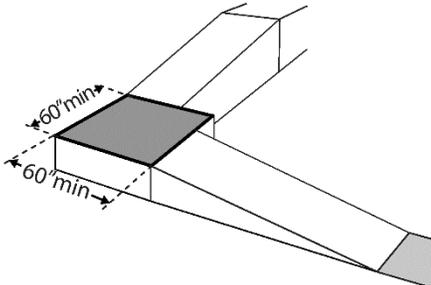
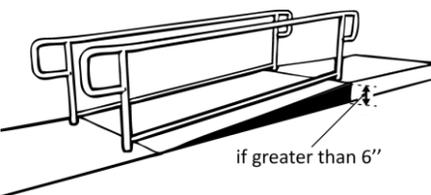
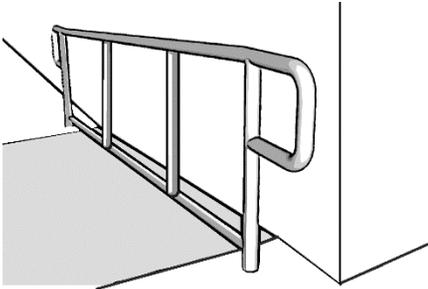
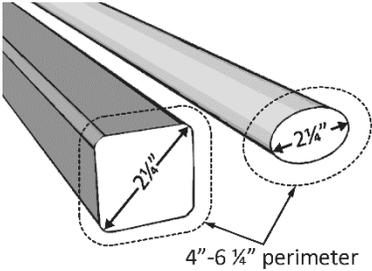
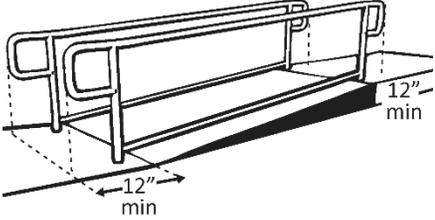
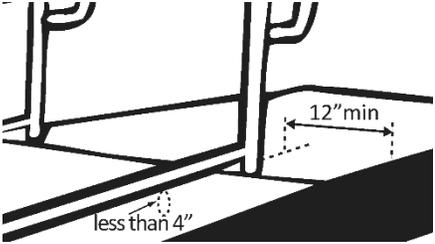


Photo #:

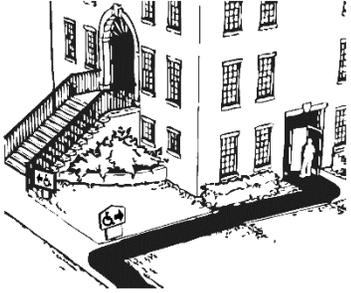
- Remove objects
 - Priority Level: 1
 - Plan Budget Year: 2021
Budget Estimate: 1,000
- Remove objects that intrude on 60" X 60" landing. Level out areas with patch and fillers to achieve required landing size.

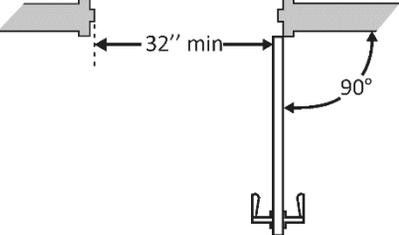

| | | | | |
|--|--|--|---|---|
| <p>1.29 Is there a level landing where the ramp changes direction that is at least 60 x 60 inches? [405.7.4]</p> | <p>No, T turn is achievable Measurement: 58 inches x</p> |  <p>A technical diagram showing a ramp turning 90 degrees. A shaded square landing area is shown at the junction, with dashed lines and arrows indicating a minimum dimension of 60 inches in both directions.</p> |  <p>A photograph showing a concrete landing area at the end of a ramp. A metal railing is installed on the right side. The landing area is approximately 60 inches wide. A person's shadow is visible on the concrete.</p> <p>Photo #:</p> | <ul style="list-style-type: none"> • Remove objects • Priority Level: 1 • Plan Budget Year: 2021 <p>Budget Estimate: 1,000</p> <p>Remove objects that intrude on 60" X 60" landing. Level out areas with patch and fillers to achieve required landing size.</p> |
| <p>1.30 If the ramp has a rise higher than 6 inches, are there handrails on both sides? [405.8]</p> <p>Note: Curb ramps are not required to have handrails.</p> | <p>No Measurement:</p> |  <p>A technical diagram of a ramp with handrails on both sides. A small figure is shown at the bottom of the ramp, with a line pointing to the ramp surface and the text "if greater than 6''".</p> |  <p>A photograph of a ramp leading to a dark doorway. A handrail is visible on the left side of the ramp. The ramp is concrete and the wall on the right is brick.</p> <p>Photo #:</p> | <ul style="list-style-type: none"> • Level of Priority: 1 • Plan Budget Year: 2021 <p>Budget Estimate: \$800</p> <p>Add handrail to both sides of the ramp and add edge protection where needed.</p> |

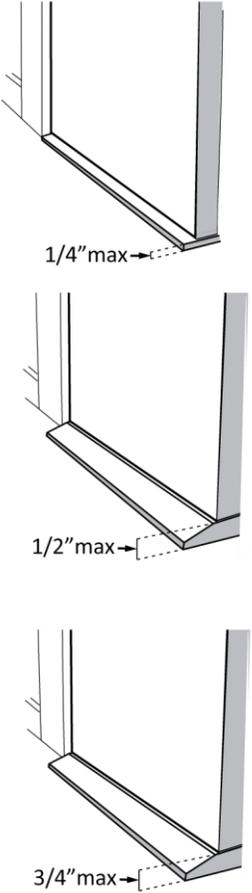
| | | | | |
|---|---|---|--|--|
| <p>1.32 Is the handrail gripping surface continuous and not obstructed along the top or sides? [505.3]</p> <p>If there are obstructions, is the bottom of the gripping surface obstructed no greater than 20%? [505.6]</p> | <p>No</p> <p>No, continuous pickets</p> <p>Measurement:</p> |  |  <p>Photo #:</p> | <ul style="list-style-type: none"> • Level of Priority: 1 • Plan Budget Year: 2021 Budget Estimate: \$800 <p>Reconfigure or replace handrails</p> <ul style="list-style-type: none"> • Add handrails |
| <p>1.34 If the handrail gripping surface is non-circular:</p> <p>Is the perimeter no less than 4 inches and no greater than 6¼ inches?</p> <p>Is the cross section no greater than 2¼ inches? [505.7.2]</p> | <p>NA</p> <p>Measurement:</p> <p>No</p> <p>Measurement:</p> <p>NA</p> <p>Measurement:</p> |  |  <p>Photo #:</p> | <ul style="list-style-type: none"> • Level of Priority: 1 • Plan Budget Year: 2021 Budget Estimate: \$800 <ul style="list-style-type: none"> • Replace handrails • Add handrails |

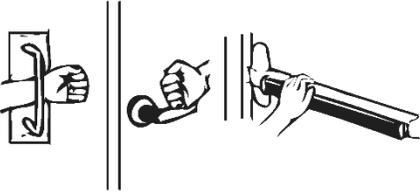
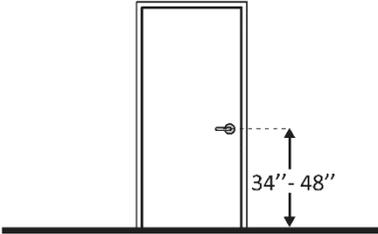
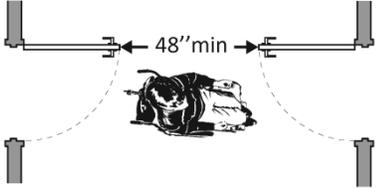
| | | | | |
|--|--|---|---|---|
| <p>1.35 Does the handrail:</p> <p>Extend at least 12 inches horizontally beyond the top and bottom of the ramp?</p> <p>Return to a wall, guard, or landing surface? [505.10.1]</p> <p>Note: If a 12 inch extension would be a hazard (in circulation path) it is not required.</p> | <p>No</p> <p>Measurement:</p> <p>No</p> |  <p>A technical diagram of a handrail. It shows a side view of a handrail with a top rail and a bottom rail. At each end, the handrail extends horizontally beyond the vertical posts. Dimension lines indicate that these extensions are at least 12 inches long. The text '12" min' is written next to the dimension lines.</p> |  <p>A photograph showing a black metal handrail on a concrete ramp. The ramp is adjacent to a brick wall and a green metal gate. The handrail is mounted on the wall and extends horizontally at both ends. A white 'X' is painted on the asphalt surface at the bottom of the ramp.</p> <p>Photo #:</p> | <ul style="list-style-type: none"> • Level of Priority: 1 • Plan Budget Year: 2021 • Budget Estimate: \$800 • Alter handrails |
| <p>1.36 To prevent wheelchair casters and crutch tips from falling off:</p> <p>Does the surface of the ramp extend at least 12 inches beyond the inside face of the handrail?</p> <p>Or</p> <p>Is there a curb or barrier that prevents the passage of a 4-inch diameter sphere? [405.9.1, 405.9.2]</p> | <p>No</p> <p>Measurement:</p> <p>Yes</p> <p>Measurement:</p> |  <p>A technical diagram of a ramp with a handrail. The ramp surface extends beyond the handrail. A dimension line indicates this extension is at least 12 inches long. A curb is shown at the edge of the ramp, with a dimension line indicating its height is less than 4 inches. The text '12" min' and 'less than 4"' are written next to the respective dimension lines.</p> |  <p>A photograph of an indoor ramp. The ramp is made of light-colored concrete. A black metal handrail runs along the left side. A brick wall is on the right side. A sign on the wall reads 'RESIDENT OFFICE'. A curb is visible at the edge of the ramp.</p> <p>Photo #:</p> | <ul style="list-style-type: none"> • Level of Priority: 1 • Plan Budget Year: 2021 • Budget Estimate: \$800 • Alter handrails |

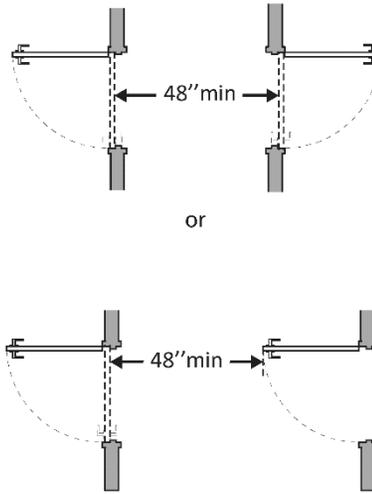
Entrance

| | | | | |
|--|-----------------------|--|---|--|
| <p>1.37 Is the main entrance accessible?</p> | <p>No</p> | |  <p>Photo #:</p> | <ul style="list-style-type: none"> • Provide alternative accessible entrance <p>Plan Budget Year:2021 Budget Estimate: \$5,000 Alter accessible parking area and route with ramp modifications to meet required standards for an accessible route other than the main entrance.</p> |
| <p>1.38 If the main entrance is not accessible, is there an alternative accessible entrance?</p> <p>Can the alternative accessible entrance be used independently and during the same hours as the main entrance?</p> | <p>Yes</p> <p>Yes</p> |  | <p>Photo #:</p> | <p>Maintain alternative entrance with modifications to meet accessible standards.</p> |
| <p>1.39 Do all inaccessible entrances have signs indicating the location of the nearest accessible entrance? [216.6]</p> | <p>No</p> |  | <p>Photo #:</p> | <ul style="list-style-type: none"> • Install signs • Level of Priority: 1 • Plan Budget Year: 2021 Budget Estimate: \$800 • Install signs • Install signs on the route before people get to inaccessible entrances so that people do not have to turn around and retrace route |

| | | | | |
|---|---|--|---|--|
| <p>1.40 If not all entrances are accessible, is there a sign at the accessible entrance with the International Symbol of Accessibility? [216.6]</p> | <p>No</p> |  | <p>Photo #:</p> | <ul style="list-style-type: none"> • Install signs • Level of Priority: 1 • Plan Budget Year: 2021 <p>Budget Estimate: \$800</p> <ul style="list-style-type: none"> • Install sign |
| <p>1.41 Is the clear opening width of the accessible entrance door at least 32 inches, between the face of the door and the stop, when the door is open 90 degrees? [404.2.3]</p> | <p>Yes</p> <p>Measurement:</p> |  |  <p>Photo #:</p> | <p>Maintain opening width when alterations are made to the accessible route.</p> |
| <p>1.42 If there is a front approach to the pull side of the door, is there at least 18 inches of maneuvering clearance beyond the latch side plus at least 60 inches clear depth? Note: See 2010 Standards 404.2.4 for maneuvering clearance requirements on the push side of the door</p> | <p>No, but automatic door opener has been installed</p> <p>Measurement:</p> |  |  | <p>Automatic door opener shall remain in operation after modifications to the accessible route are completed.</p> |

| | | | | |
|---|--|---|-----------------|-----------------------------|
| <p>and side approaches to the pull side of the door</p> <p>On both sides of the door, is the ground or floor surface of the maneuvering clearance level (no steeper than 1:48)? [404.2.4]</p> | <p>Yes</p> <p>Measurement:</p> | | <p>Photo #:</p> | |
| <p>1.43 If the threshold is vertical is it no more than ¼ inch high?</p> <p>Or</p> <p>No more than ½ inch high with the top ¼ inch beveled no steeper than 1:2, if the threshold was installed on or after the 1991 ADA Standards went into effect (1/26/93)?</p> <p>Or</p> <p>No more than ¾ inch high with the top ½ inch beveled no steeper than 1:2, if the threshold was installed before the 1991 ADA Standards went into effect (1/26/93)? [404.2.5, 303.2]</p> <p>Note: The first ¼ inch of the ½ or ¾ inch threshold may be vertical; the rest must be beveled.</p> | <p>NA</p> <p>Measurement:</p> <p>Yes</p> <p>Measurement:</p> <p>NA</p> <p>Measurement:</p> |  <p>1/4" max</p> <p>1/2" max</p> <p>3/4" max</p> | <p>Photo #:</p> | <p>No changes required.</p> |

| | | | | |
|---|---|--|--|----------------------------|
| <p>1.44 Is the door equipped with hardware that is operable with one hand and does not require tight grasping, pinching or twisting of the wrist?</p> <p>Door handle?</p> <p>Lock (if provided)? [404.2.7]</p> | <p>NA - automatic door opener</p> <p>NA</p> <p>NA</p> |  |  <p>Photo #:</p> | <p>No change required.</p> |
| <p>1.45 Are the operable parts of the door hardware no less than 34 inches and no greater than 48 inches above the floor or ground surface? [404.2.7]</p> | <p>NA</p> <p>Measurement:</p> |  | <p>Photo #:</p> | <p>No change required.</p> |
| <p>1.47 If there are two doors in a series, e.g. vestibule, is the distance between the doors at least 48 inches plus the width of the doors when swinging into the space? [404.2.6]</p> | <p>Yes</p> <p>Measurement: 9'-0"</p> |  <p>or</p> |  <p>Photo #:</p> | <p>No change required.</p> |



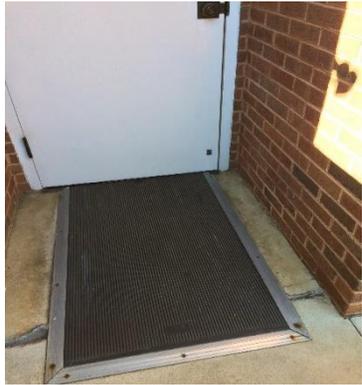
1.48 If provided at the building entrance, are carpets or mats no higher than ½ inch thick? [302.2]

Yes
Measurement:



Photo #:

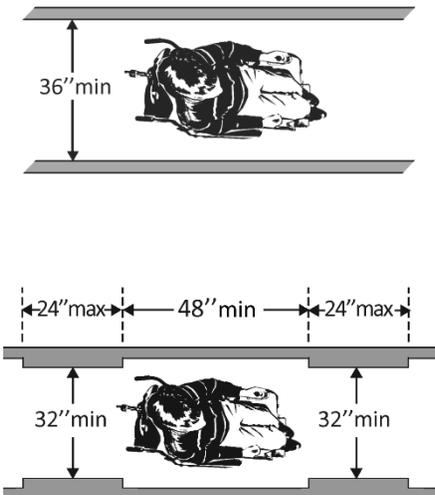
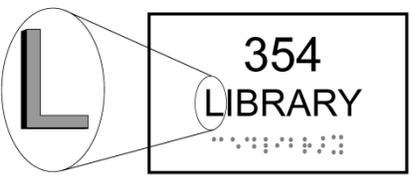
No change required.

| | | | | |
|---|------------|--|---|----------------------------|
| <p>1.49 Are edges of carpets or mats securely attached to minimize tripping hazards? [302.2]</p> | <p>Yes</p> | |  <p>Photo #:</p> | <p>No change required.</p> |
|---|------------|--|---|----------------------------|

| <p>Priority 2 – Access to Goods & Services</p> | | | <p>Comments</p> | <p>Possible Solutions</p> |
|--|------------|--|------------------------|----------------------------------|
| <p>2.1 Does the accessible entrance provide direct access to the main floor, lobby and elevator? [See 2010 ADA Standards for Accessible Design – 206.4]</p> | <p>Yes</p> | | <p>Photo #:</p> | <p>No change required.</p> |

Interior Accessible Route

| | | | | |
|---|------------|--|---|----------------------------|
| <p>2.2 Are all public spaces on at least one accessible route? [206.2.4]</p> | <p>Yes</p> | |  <p>Photo #:</p> | <p>No change required.</p> |
| <p>2.3 Is the route stable, firm and slip-resistant? [40.2, 302.1]</p> | <p>Yes</p> | |  <p>Photo #:</p> | <p>No change required.</p> |

| | | | | |
|--|--|---|--|---|
| <p>2.4 Is the route at least 36 inches wide? [403.5.1]</p> <p>Note: The accessible route can narrow to 32 inches min. for a max. of 24 inches. These narrower portions of the route must be at least 48 inches from each other.</p> | <p>Yes</p> <p>Measurement: 6'-0"</p> |  |  <p>Photo #:</p> | <p>No changes required.</p> |
| <p>2.38 If there are signs designating permanent rooms and spaces not likely to change over time, e.g. room numbers and letters, room names, and exit signs: [216.2]</p> <p>Do text characters contrast with their backgrounds? [703.5]</p> <p>Are text characters raised? [703.2]</p> <p>Is there Braille? [703.3]</p> <p>Is the sign mounted:</p> | <p>Yes</p> <p>No</p> <p>No</p> |  |  <p>Photo #:</p> | <ul style="list-style-type: none"> • Install signs • Level of Priority: 2 • Plan Budget Year: 2022 <p>Budget Estimate: \$800</p> <ul style="list-style-type: none"> • Install tactile sign • Relocate sign |

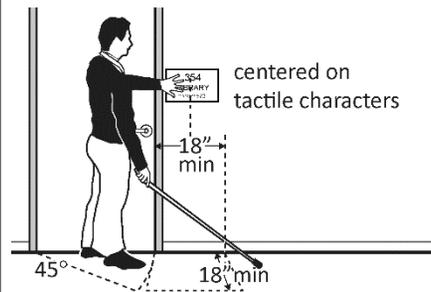
On the wall on the latch side of the door?
[703.4.2]

Note: Signs are permitted on the push side of doors with closers and without hold-open devices. With clear floor space beyond the arc of the door swing between the closed position and 45-degree open position, at least 18 x 18 inches centered on the tactile characters? *
[703.4.2]

So, the baseline of the lowest character is at least 48 inches above the floor and the baseline of the highest character is no more than 60 inches above the floor? *
[703.4.1]

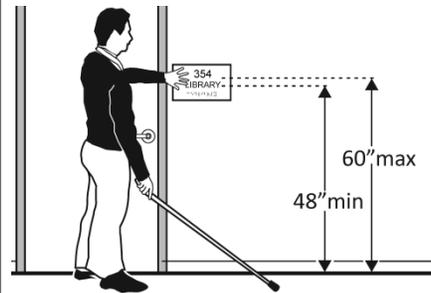
Note: If the sign is at double doors with one active leaf, the sign should be on the inactive leaf; if both leaves are active, the sign should be on the wall to the right of the right leaf.

No



No

Measurement:



No

Measurement:

*If constructed before 3/15/2012 and a person may approach within 3 inches of the sign without encountering protruding objects or standing within the door swing, relocation not required

*If constructed before 3/15/2012 and mounted no higher than 60 inches to the centerline of the sign, relocation not required

2.39

If there are signs that provide direction to or information about interior spaces:

Do text characters contrast with their backgrounds? [703.5.1]

Is the sign mounted so that characters are at least 40 inches above the floor? [703.5.6]

Note: Raised characters and Braille are not required.

Yes

No

Measurement:

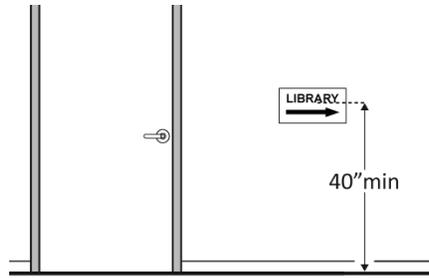


Photo #:

- Install signs
- Level of Priority: 2
- Plan Budget Year: 2022

Budget Estimate: \$800

- Install signs with contrasting characters
- Change sign height

Interior Doors – to offices, conference rooms, etc.

2.40

Is the door opening width at least 32 inches clear, between the face of the door and the stop, when the door is open 90 degrees? [404.2.3]

Varies – Most office doors are 36 inches

Measurement:

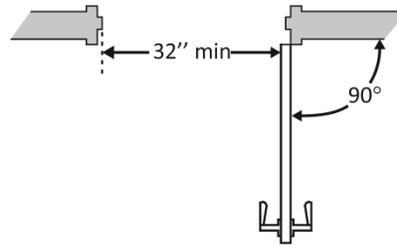
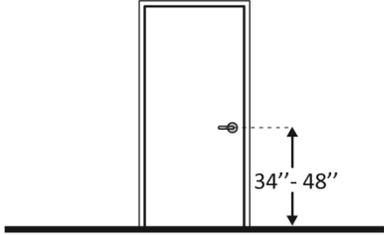

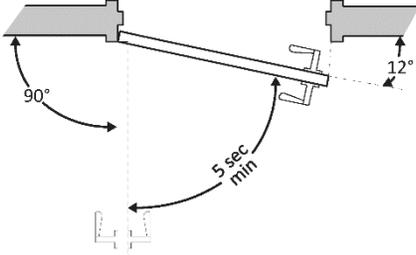


Photo #:

- Install hinges & alter doorways.
- Level of Priority: 2
- Plan Budget Year: 2023

Budget Estimate: \$800

- Install offset hinges where required
- Alter the doorway where required

| | | | | |
|--|---|---|-----------------|---|
| <p>2.44 Are the operable parts of the hardware no less than 34 inches and no greater than 48 inches above the floor? [404.2.7]</p> | <p>Yes</p> <p>Measurement: 36 inches</p> |  | <p>Photo #:</p> | <p>No Change Required.</p> |
| <p>2.45 Can the door be opened easily (5 pounds maximum force)? [404.2.9]</p> <p>Note: You can use a pressure gauge or fish scale to measure force. If you do not have one you will need to judge whether the door is easy to open.</p> | <p>No at doors with closers Yes, at doors without closers</p> <p>Measurement:</p> |  | <p>Photo #:</p> | <ul style="list-style-type: none"> • Adjust or replace closers • Level of Priority: 2 • Plan Budget Year: 2023 <p>Budget Estimate: \$1,000</p> |
| <p>2.46 If the door has a closer, does it take at least 5 seconds to close from an open position of 90 degrees to a position of 12 degrees from the latch? [404.2.8.1]</p> | <p>No</p> <p>Measurement:</p> |  | <p>Photo #:</p> | <ul style="list-style-type: none"> • Adjust closer • Level of Priority: 2 • Plan Budget Year: 2023 <p>Budget Estimate: \$100</p> |

Priority 3 – Toilet Rooms

Comments

Possible Solutions

| | | | | |
|---|------------|--|---|---|
| <p>3.1 If toilet rooms are available to the public, is at least one toilet room accessible? (Either one for each sex, or one unisex.)</p> <p>Note: If toilet rooms are chiefly for children, e.g., in elementary schools and day care centers, use the children’s specifications in Toilets - 604.1, 604.8, 604.9, 609.4 and Lavatories and Sinks – 606.2.</p> | <p>Yes</p> | | <p>Photo #:</p> | <p>No Change Required.</p> |
| <p>3.2 Are there signs at inaccessible toilet rooms that give directions to accessible toilet rooms? [See 2010 ADA Standards for Accessible Design – 216.8]</p> | <p>No</p> |  |  <p>Photo #:</p> | <ul style="list-style-type: none"> • Install signs • Level of Priority: 3 • Plan Budget Year: 2023 <p>Budget Estimate: \$800</p> |
| <p>3.3 If not, all toilet rooms are accessible, is there a sign at the accessible toilet room with the International Symbol of Accessibility? [216.8]</p> | <p>Yes</p> |  |  <p>Photo #:</p> | <p>No Change Required.</p> |

Accessible Route

3.4 Is there an accessible route to the accessible toilet room? [206.2.4]

Yes

Photo #:

No Change Required.

Signs at Toilet Rooms

3.5 Do text characters contrast with their backgrounds? [703.5]

Yes

Are text characters raised? [703.2]

Yes

Is there Braille? [703.3]

No

Is the sign mounted:
On the wall on the latch side of the door? [703.4.2]

No

Note: Signs are permitted on the push side of doors with closers and without hold-open devices.

With clear floor space beyond the arc of the door swing between the closed position and 45-degree open position, at least 18 x 18 inches centered on the tactile characters? * [703.4.2]

NA

Measurement:

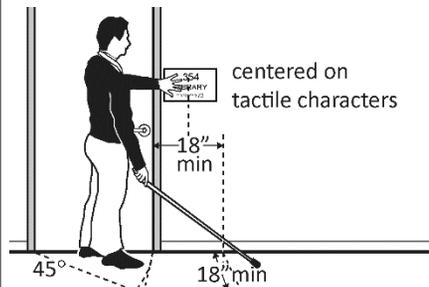
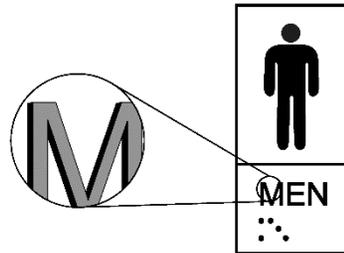


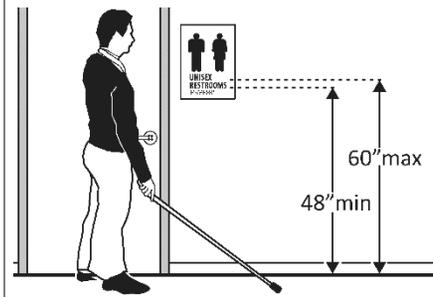
Photo #:

- Install tactile sign
 - Relocate sign
 - Level of Priority: 3
 - Plan Budget Year: 2023
- Budget Estimate: \$1,000

Is the baseline of the lowest character is at least 48 inches above the floor and the baseline of the highest character is no more than 60 inches above the floor? * [703.4.1]

Note: If the sign is at double doors with one active leaf, the sign should be on the inactive leaf; if both leaves are active, the sign should be on the wall to the right of the right leaf.

NA
Measurement:



*If constructed before 3/15/2012 and a person may approach within 3 inches of the sign without encountering protruding objects or standing within the door swing, relocation not required

*If constructed before 3/15/2012 and mounted no higher than 60 inches to the centerline of the sign, relocation is not required

Entrance

3.6 Is the door opening width at least 32 inches clear, between the face of the door and the stop, when the door is open 90 degrees? [404.2.3]

No
Measurement:
30 inches

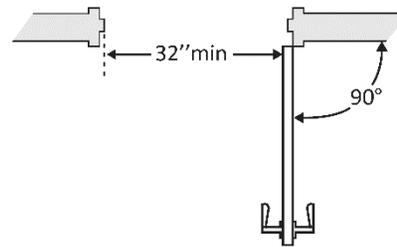


Photo #:


- Install offset hinges
 - Alter the doorway
 - Level of Priority: 3
 - Plan Budget Year: 2023
- Budget Estimate: \$1,000

3.7 If there is a front approach to the pull side of the door is there at least 18 inches of maneuvering clearance beyond the latch side plus 60 inches, clear depth?

Note: See 2010 Standards 404.2.4 for maneuvering clearance requirements on the push side of the door and side approaches to the pull side of the door

On both sides of the door, is the floor surface of the maneuvering clearance level (no steeper than 1:48)? [404.2.4]

No
Measurement:



Yes
Measurement:




Photo #:

- Reverse door swing
 - Reconfigure walls
 - Add automatic door opener
- Level of Priority: 3
• Plan Budget Year: 2024
- Budget Estimate: \$2,000

3.8 If the threshold is vertical is it no more than ¼ inch high?
Or
No more than ½ inch high with the top ¼ inch beveled no steeper than 1:2, if the threshold was installed on or after the 1991 ADA Standards went into effect (1/26/93)?
Or
No more than ¾ inch high with the top ½ inch beveled no steeper than 1:2, if the threshold was installed before

No threshold
Measurement:
NA
Measurement:


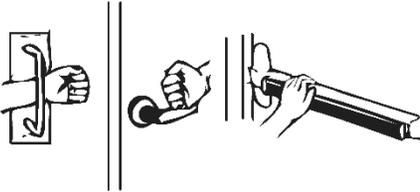
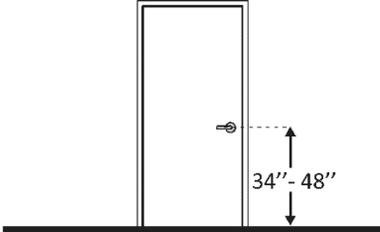



NA
Measurement:



Photo #:

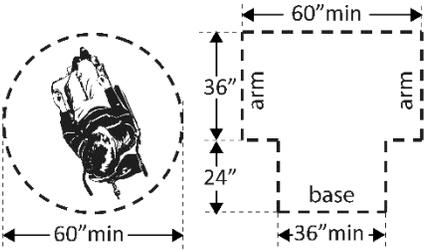

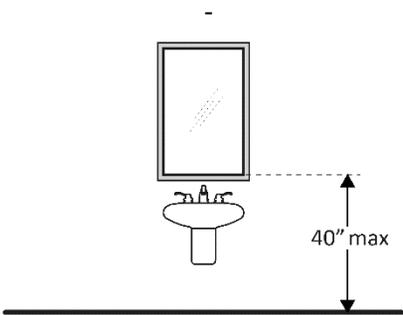
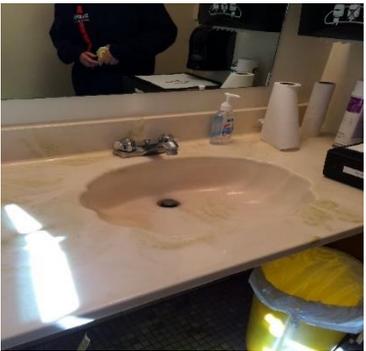
No change required.

| | | | | |
|---|--|---|---|--|
| <p>the 1991 ADA Standards went into effect (1/26/93)? [404.2.5, 303.2]</p> <p>Note: The first ¼ inch of the ½ or ¾ inch threshold may be vertical; the rest must be beveled.</p> | |  | | |
| <p>3.9 Is the door equipped with hardware that is operable with one hand and does not require tight grasping, pinching or twisting of the wrist?</p> <p>Door handle? Lock (if provided)? [404.2.7]</p> | <p>No</p> <p>NA</p> <p>NA</p> |  |  <p>Photo #:</p> | <ul style="list-style-type: none"> • Replace inaccessible knob with lever, loop or push hardware • Add automatic door opener • Level of Priority: 3 • Plan Budget Year: 2023 <p>Budget Estimate: \$1,000</p> |
| <p>3.10 Are the operable parts of the door hardware mounting no less than 34 inches and no greater than 48 inches above the floor? [404.2.7]</p> | <p>Yes</p> <p>Measurement: 36 inches</p> |  | <p>Photo #:</p> | <p>No Change Required.</p> |

| | | | | |
|--|--------------------------------|--|-----------------|----------------------------|
| <p>3.11 Can the door be opened easily (5 pounds maximum force)? [404.2.9]</p> <p>Note: You can use a pressure gauge or fish scale to measure force. If you do not have one you will need to judge whether the door is easy to open.</p> | <p>Yes</p> <p>Measurement:</p> |  | <p>Photo #:</p> | <p>No Change Required.</p> |
|--|--------------------------------|--|-----------------|----------------------------|

| Priority 3 – Toilet Rooms | Comments | Possible Solutions |
|---------------------------|----------|--------------------|
|---------------------------|----------|--------------------|

| In the Toilet Room | | | | |
|---|--------------------------------|---|--|---|
| <p>3.16 Is there a clear path to at least one of each type of fixture, e.g. lavatory, hand dryer, etc., that is at least 36 inches wide? [403.5.1]</p> | <p>Yes</p> <p>Measurement:</p> |  |  <p>Photo #:</p> | <ul style="list-style-type: none"> Remove obstructions |

| | | | | |
|--|--|--|--|---|
| <p>3.17 Is there clear floor space available for a person in a wheelchair to turn around, i.e. a circle at least 60 inches in diameter or a T-shaped space within a 60-inch square? [603.2.1]</p> | <p>Yes Measurement:</p> |  |  | <ul style="list-style-type: none"> • Move or remove fixtures or objects such as trash cans • Level of Priority: 3 • Plan Budget Year: 2023 <p>Budget Estimate: \$500</p> |
| <p>3.18 In a single user toilet room if the door swings in and over a clear floor space at an accessible fixture, is there a clear floor space at least 30 x 48 inches beyond the swing of the door? [603.2.3 Exception 2]</p> | <p>Yes Measurement:</p> |  |  | <p>No Change Required.</p> |
| <p>3.19 If the mirror is over a lavatory or countertop, is the bottom edge of the reflecting surface no higher than 40 inches above the floor? Or If the mirror is not over the lavatory or countertop, is the bottom edge of the reflecting surface no higher than 35 inches above the floor? * [603.3]</p> | <p>Yes Measurement: NA Measurement:</p> |  |  | <p>* If installed before 3/15/2012 and the bottom edge of the reflecting surface is no higher than 40 inches above the floor, lowering the mirror to 35 inches is not required</p> |

Lavatories The 2010 Standards refer to sinks in toilet rooms as lavatories.

3.21 Does at least one lavatory have a clear floor space for a forward approach at least 30 inches wide and 48 inches long? [606.2]

Yes, lavatory encroaches on the toilet clear space

Measurement:

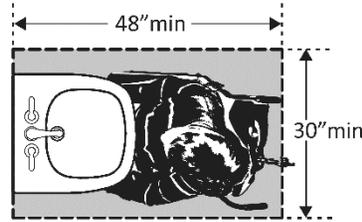


Photo #:

- Replace lavatory
 - Level of Priority: 3
 - Plan Budget Year: 2023
- Budget Estimate: \$500

3.22 Do no less than 17 inches and no greater than 25 inches of the clear floor space extend under the lavatory so that a person using a wheelchair can get close enough to reach the faucet? [306.2]

Yes, lavatory encroaches on the toilet clear space

Measurement:

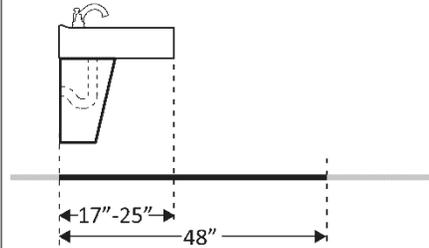


Photo #:

- Replace lavatory
 - Level of Priority: 3
 - Plan Budget Year: 2023
- Budget Estimate: \$500

3.23 Is the front of the lavatory or counter surface, whichever is higher, no more than 34 inches above the floor? [606.3]

Yes, lavatory encroaches on the toilet clear space

Measurement:

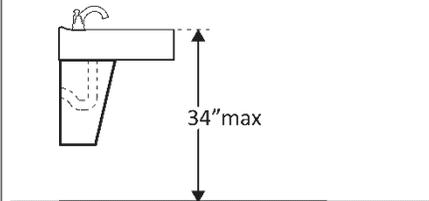
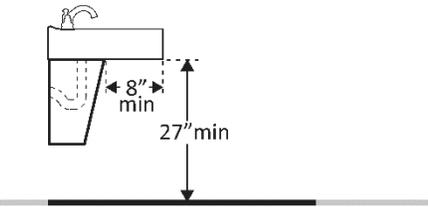
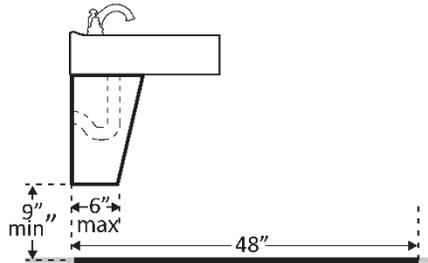
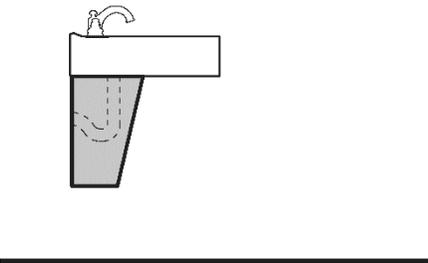



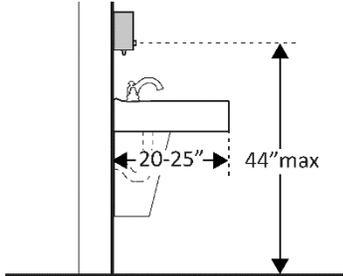
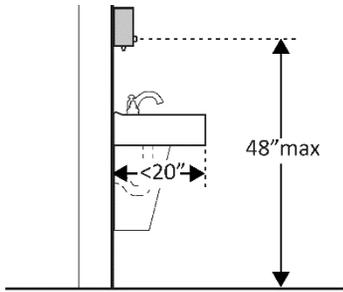
Photo #:

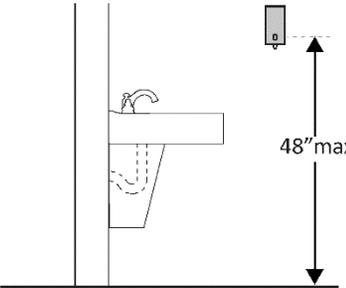
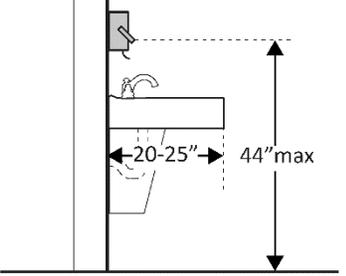
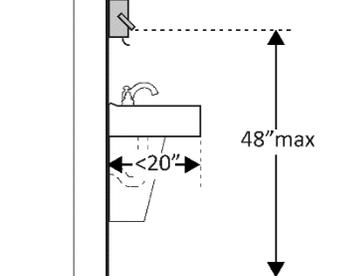
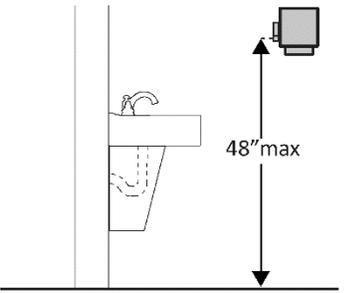
- Replace lavatory
 - Level of Priority: 3
 - Plan Budget Year: 2023
- Budget Estimate: \$500

| | | | | |
|--|---|---|--|--|
| <p>3.24 Is there at least 27 inches clearance from the floor to the bottom of the lavatory that extends at least 8 inches under the lavatory for knee clearance? [306.3.3]</p> | <p>Yes, lavatory encroaches on the toilet clear space</p> <p>Measurement:</p> |  | <p>Photo #:</p> | <ul style="list-style-type: none"> • Replace lavatory • Level of Priority: 3 • Plan Budget Year: 2023 <p>Budget Estimate: \$500</p> |
| <p>3.25 Is there toe clearance at least 9 inches high? [306.3.3]</p> <p>Note: Space extending greater than 6 inches beyond the available toe clearance at 9 inches above the floor is not considered toe clearance.</p> | <p>Yes, lavatory encroaches on the toilet clear space</p> |  | <p>Photo #:</p> | <ul style="list-style-type: none"> • Replace lavatory • Level of Priority: 3 • Plan Budget Year: 2023 <p>Budget Estimate: \$500</p> |
| <p>3.26 Are pipes below the lavatory insulated or otherwise configured to protect against contact? [606.5]</p> | <p>No</p> |  |  <p>Photo #:</p> | <ul style="list-style-type: none"> • Replace lavatory <p>Level of Priority: 3</p> <ul style="list-style-type: none"> • Plan Budget Year: 2023 <p>Add insulation protection to piping for the new lavatory.</p> <p>Budget Estimate: \$500</p> |

| | | | | |
|---|---------------------|--|---|---|
| <p>3.27 Can the faucet be operated without tight grasping, pinching, or twisting of the wrist?</p> <p>Is the force required to activate the faucet no greater than 5 pounds? [606.4]</p> | <p>No</p> <p>NA</p> |  |  <p>Photo #:</p> | <ul style="list-style-type: none"> • Replace faucet • Level of Priority: 3 • Plan Budget Year: 2023 <p>Replace faucet when the lavatory is replaced.</p> <p>Budget Estimate: \$500</p> |
|---|---------------------|--|---|---|


Soap Dispensers and Hand Dryers


| | | | | |
|--|--|--|--|----------------------------|
| <p>3.28 Are the operable parts of the soap dispenser within one of the following reach ranges?</p> <p>Above lavatories or counters no less than 20 inches and no greater than 25 inches deep: no higher than 44 inches above the floor? [308.2.2]</p> <p>Above lavatories less than 20 inches deep: no higher than 48 inches above the floor?</p> | <p>Yes</p> <p>Measurement: 40 inches</p> <p>NA</p> <p>Measurement:</p> |   |  <p>Photo #:</p> | <p>No change required.</p> |
|--|--|--|--|----------------------------|

| | | | | |
|--|--|---|---|--|
| <p>Not over an obstruction: no higher than 48 inches above the floor? [308.2]</p> | <p>NA Measurement:</p> |  | | |
| <p>3.29 Are the operable parts of the hand dryer or towel dispenser within one of the following reach ranges?</p> <p>Above lavatories or counters no less than 20 inches and no greater than 25 inches deep: no higher than 44 inches above the floor?</p> <p>Above lavatories less than 20 inches deep: no higher than 48 inches above the floor?</p> <p>Not over an obstruction: no higher than 48 inches above the floor? [308.2]</p> <p>Can the operable parts of the hand dryer or towel dispenser be operated without tight grasping, pinching or twisting of the wrist?</p> <p>Is the force required to activate the hand dryer or towel</p> | <p>No Measurement: 49 inches</p> <p>NA Measurement:</p> <p>NA Measurement:</p> <p>No</p> <p>NA</p> |    |  <p>Photo #:</p> | <ul style="list-style-type: none"> • Adjust dispensers • Replace with or provide additional accessible dispensers <p>• Plan Budget Year: 2023</p> <p>Budget Estimate: \$200.00</p> |

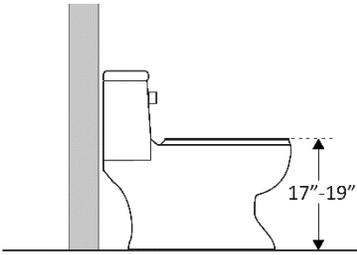
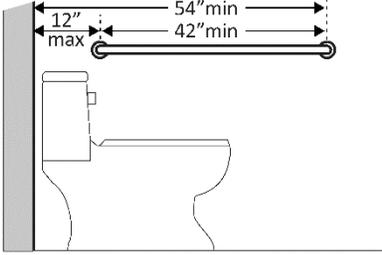
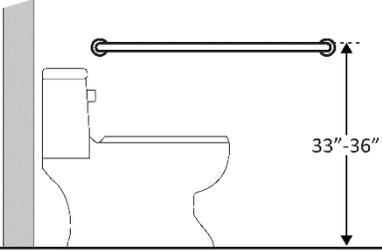

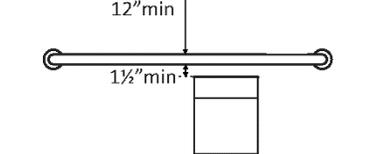
| | | | | |
|--|---------------------|--|--|--|
| <p>dispenser no greater than 5 pounds? [309.4]</p> | <p>Measurement:</p> | | | |
|--|---------------------|--|--|--|

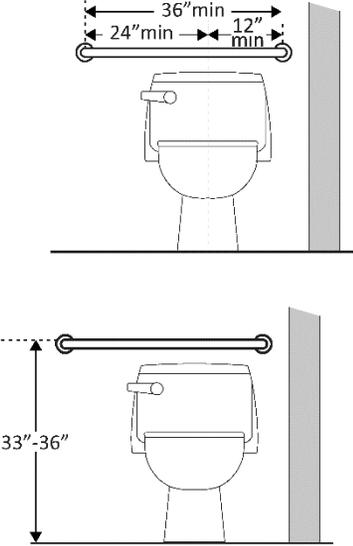
Water Closets in Single-User Toilet Rooms and Compartments (Stalls) The 2010 Standards refer to toilets as water closets.

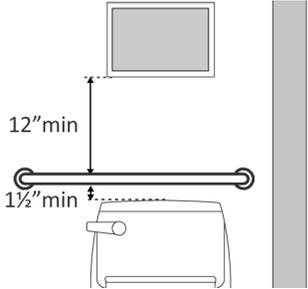
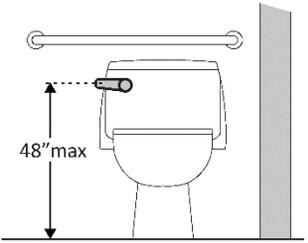
| | | | | |
|--|--|--|---|----------------------------|
| <p>3.30 Is the centerline of the water closet no less than 16 inches and no greater than 18 inches from the side wall or partition? [604.2]</p> | <p>Yes Measurement: 18 inches</p> |  |  <p>Photo #:</p> | <p>No Change Required.</p> |
|--|--|--|---|----------------------------|

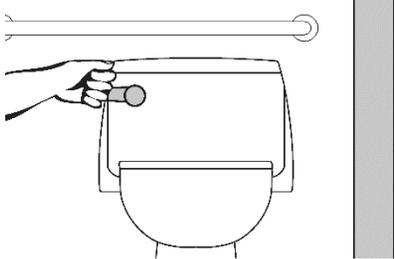
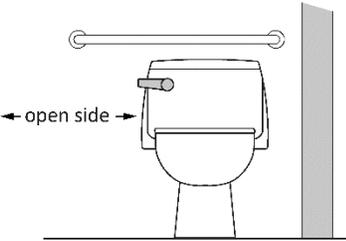
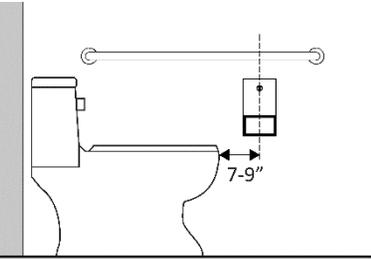
| | | | | |
|---|---|--|---|---|
| <p>3.31 Is clearance provided around the water closet measuring at least 60 inches from the side wall and at least 56 inches from the rear wall? * [604.3.1]</p> | <p>No Measurement: 2'-6" x 6'-0"</p> |  |  | <p>* If constructed before 3/15/12, clearances around water closets in single user toilet rooms can be 48 inches wide by 66 inches long or 48 inches wide by 56 inches long (depending on the approach to the</p> |
|---|---|--|---|---|

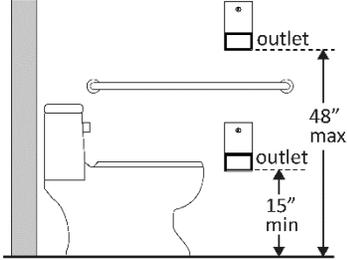
| | | | | |
|--|--|--|----------|---|
| | | | Photo #: | <p>water closet, see 1991 Standards Figure 28) and the lavatory may overlap that clearance if the door to the room does not swing into the required clearances at fixtures (such as lavatories, water closet and urinals) and the edge of the lavatory is at least 18 inches from the centerline of the water closet</p> <ul style="list-style-type: none">• Alter room/compart ment for clearance• Budget Year 2023• Budget Estimate: \$500.00 |
|--|--|--|----------|---|


| | | | | |
|---|--|--|---|--|
| <p>3.32 Is the height of the water closet no less than 17 inches and no greater than 19 inches above the floor measured to the top of the seat? [604.4]</p> | <p>No Measurement: 16 inches</p> |  |  <p>Photo #:</p> | <ul style="list-style-type: none"> • Replace toilet. • Budget Year 2023 • Budget Estimate: \$500.00 |
| <p>3.33 Is there a grab bar at least 22 inches long on the side wall? Is it located no more than 12 inches from the rear wall? Does it extend at least 54 inches from the rear wall? [604.5.1] Is it mounted no less than 33 inches and no greater than 36 inches above the floor to the top of the gripping surface? [609.4] Is there at least 12 inches clearance between the grab bar</p> | <p>Yes Measurement: Yes Measurement: No Measurement: Yes Measurement: 33 inches Yes Measurement:</p> |     |  | <ul style="list-style-type: none"> • Relocate grab bar • Budget Year 2023 • Budget Estimate: \$500.00 |

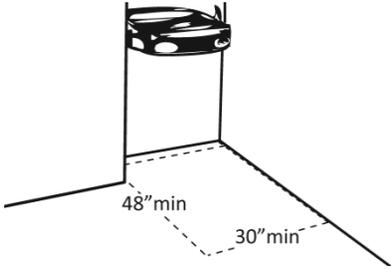
| | | | | |
|---|---|---|---|--|
| <p>and protruding objects above? *</p> <p>Is there at least 1½ inches clearance between the grab bar and projecting objects below? *</p> <p>Is the space between the wall and the grab bar 1 ½ inches? [609.3]</p> | <p>Yes Measurement:</p> <p>Yes Measurement:</p> | |  <p>Photo #:</p> | <p>* If constructed before 3/15/2012 grab bars do not need to be relocated; there are no space requirements above and below grab bars in the 1991 Standards</p> |
| <p>3.34 Is there a grab bar at least 36 inches long on the rear wall?</p> <p>Does it extend at least 12 inches from the centerline of the water closet on one side (side wall)?</p> <p>Does it extend at least 24 inches on the other (open) side? [604.5.2]</p> <p>Is it mounted no less than 33 inches and no greater than 36 inches above the floor to the top of the gripping surface? [609.4]</p> | <p>No Measurement: 30 inches</p> <p>Yes Measurement:</p> <p>No Measurement: 18 inches</p> <p>Yes Measurement: 33 inches</p> <p>Yes Measurement:</p> |  |  | <ul style="list-style-type: none"> • Install grab bar <p>No Change Required.</p> <p>* If constructed before 3/15/2012 grab bars do not need to be relocated; there are no space</p> |

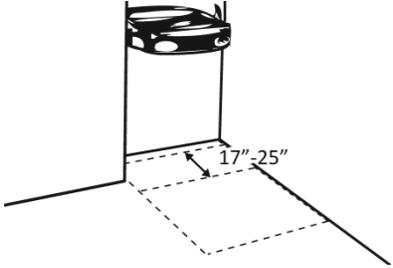
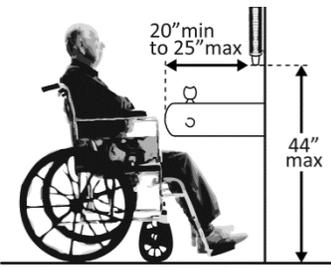
| | | | | |
|--|---|---|--|---|
| <p>Are there at least 12 inches clearance between the grab bar and protruding objects above?*</p> <p>Are there at least 1½ inches clearance between the grab bar and projecting objects below?*</p> <p>Is the space between the wall and the grab bar 1½ inches? [609.3]</p> | <p>Yes</p> <p>Measurement:</p> <p>Yes</p> <p>Measurement:</p> |  | <p>Photo #:</p> | <p>requirements above and below grab bars in the 1991 Standards</p> |
| <p>3.35 If the flush control is hand operated, is the operable part located no higher than 48 inches above the floor? [604.6]</p> | <p>Yes</p> <p>Measurement:</p> |  |  <p>Photo #:</p> | <p>No Change Required.</p> |

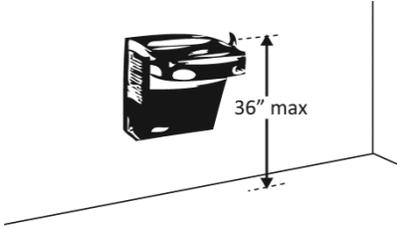
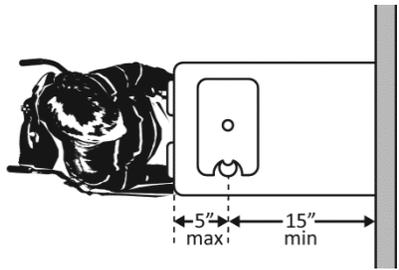
| | | | | |
|---|--|--|--|--|
| <p>3.36 If the flush control is hand operated, can it be operated with one hand and without tight grasping, pinching, or twisting of the wrist?</p> <p>Is the force required to activate the flush control no greater than 5 pounds? [605.4]</p> | <p>Yes</p> <p>Yes</p> <p>Measurement:</p> |  |  <p>Photo #:</p> | <ul style="list-style-type: none"> • Change control • Adjust control • No Change Required. |
| <p>3.37 Is the flush control on the open side of the water closet? [604.6]</p> | <p>No</p> |  |  <p>Photo #:</p> | <ul style="list-style-type: none"> • Move control • Budget Year 2023. <p>Budget Estimate: \$200.00</p> |
| <p>3.38 Is the toilet paper dispenser located no less than 7 inches and no greater than 9 inches from the front of the water closet to the centerline of the dispenser? * [604.7]</p> | <p>NA – constructed before 3/15/12</p> <p>Measurement:</p> |  | <p>Photo #:</p> | <p>* If constructed before 3/15/2012 dispenser does not need to be relocated if it is within reach from the water closet seat; the 1991 Standards do not</p> |

| | | | | |
|--|--|--|---|--|
| | | | <p>Photo #:</p> | <p>specify distance from the front of the water closet</p> <ul style="list-style-type: none"> • Relocate dispenser • No Change Required. |
| <p>3.39 Is the outlet of the dispenser:</p> <p>Located no less than 15 inches and no greater than 48 inches above the floor?</p> <p>Not located behind grab bars. [604.7]</p> | <p>Yes</p> <p>Measurement: 21 inches</p> <p>No</p> |  |  <p>Photo #:</p> | <p>No Change Required.</p> |

| | | | | |
|--|------------|--|---|----------------------------|
| <p>3.40 Does the dispenser allow continuous paper flow? [604.7]</p> | <p>Yes</p> |  |  <p>Photo #:</p> | <p>No Change Required.</p> |
|--|------------|--|---|----------------------------|

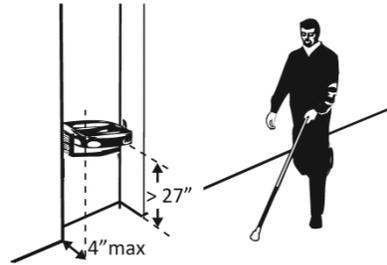
| Priority 4 – Additional Access | | Comments | Possible Solutions |
|---|----------------------------|--|--|
| Drinking Fountains | | | |
| <p>4.1 Does at least one drinking fountain have a clear floor space at least 30 inches wide x at least 48 inches long centered in front of it for a forward approach? * [See 2010 ADA Standards for Accessible Design – 602.2]</p> | <p>No Measurement:</p> |  |  <p>Photo #:</p> <p>*If installed before 3/15/2012, a parallel approach is permitted, and the clear floor space is not required to be centered.</p> <ul style="list-style-type: none"> • Alter space • Relocate drinking fountain |

| | | | | |
|--|--|--|---|--|
| | | | | <ul style="list-style-type: none"> • Install a drinking fountain in another location. <p>Budget Year 2025</p> <p>Budget Estimate: \$1,000</p> |
| <p>4.2 If there is a forward approach, do no less than 17 inches and no greater than 25 inches of the clear floor space extend under the drinking fountain? [306.2.2, 306.2.3]</p> <p>Note: If the drinking fountain is primarily for children’s use and the spout is no more than 30 inches above the floor and no more than 3 ½ inches from the edge of the unit, a parallel approach is permitted.</p> | <p>No</p> <p>Measurement:</p> |  |  <p>Photo #:</p> | <ul style="list-style-type: none"> • Alter space • Replace drinking fountain • Budget Year 2025 <p>Budget Estimate: \$1,000</p> |
| <p>4.4 If the drinking fountain is no less than 20 inches and no greater than 25 inches deep, are the operable parts no higher than 44 inches above the floor? [308.2.2]</p> | <p>Yes</p> <p>Measurement: 40 inches</p> |  |  <p>Photo #:</p> | <p>Budget Year 2025</p> <p>Budget Estimate: \$1,000</p> <p>Replace and install a new drinking fountain.</p> |

| | | | | |
|--|--|--|---|---|
| <p>4.5 Can the control be operated with one hand and without tight grasping, pinching or twisting of the wrist?</p> <p>Is the force required to activate the control no more than 5 pounds? [309.4]</p> | <p>Yes</p> <p>Yes</p> <p>Measurement:</p> |  |  <p>Photo #:</p> | <p>Budget Year 2025</p> <p>Budget Estimate: \$1,000</p> <p>Replace and install a new drinking fountain.</p> |
| <p>4.6 Is the spout outlet no higher than 36 inches above the floor? [602.4]</p> | <p>No</p> <p>Measurement:</p> |  |  <p>Photo #:</p> | <ul style="list-style-type: none"> • Adjust drinking fountain • Replace drinking fountain. <ul style="list-style-type: none"> • Budget Year 2025 <p>Budget Estimate: \$1,000</p> <p>Replace and install a new drinking fountain.</p> |
| <p>4.7 Is the spout:</p> <p>At least 15 inches from the rear of the drinking fountain?</p> <p>No more than 5 inches from the front of the drinking fountain? [602.5]</p> | <p>No</p> <p>Measurement:</p> <p>Yes</p> <p>Measurement:</p> |  | <p>Photo #:</p> | <ul style="list-style-type: none"> • Adjust spout • Replace drinking fountain • Budget Year 2025 <p>Budget Estimate: \$1,000</p> <p>Replace and install a new drinking fountain.</p> |

4.9 If the leading (bottom) edge of the fountain is higher than 27 inches above the floor, does the front of the fountain protrude no more than 4 inches into the circulation path?
[307.2]

No
Measurement:



- Adjust drinking fountain
- Replace drinking fountain
- Add tactile warning such as permanent planter or partial walls.

Budget Year 2025

Budget Estimate: \$1,000

Replace and install a new drinking fountain.

Photo #: